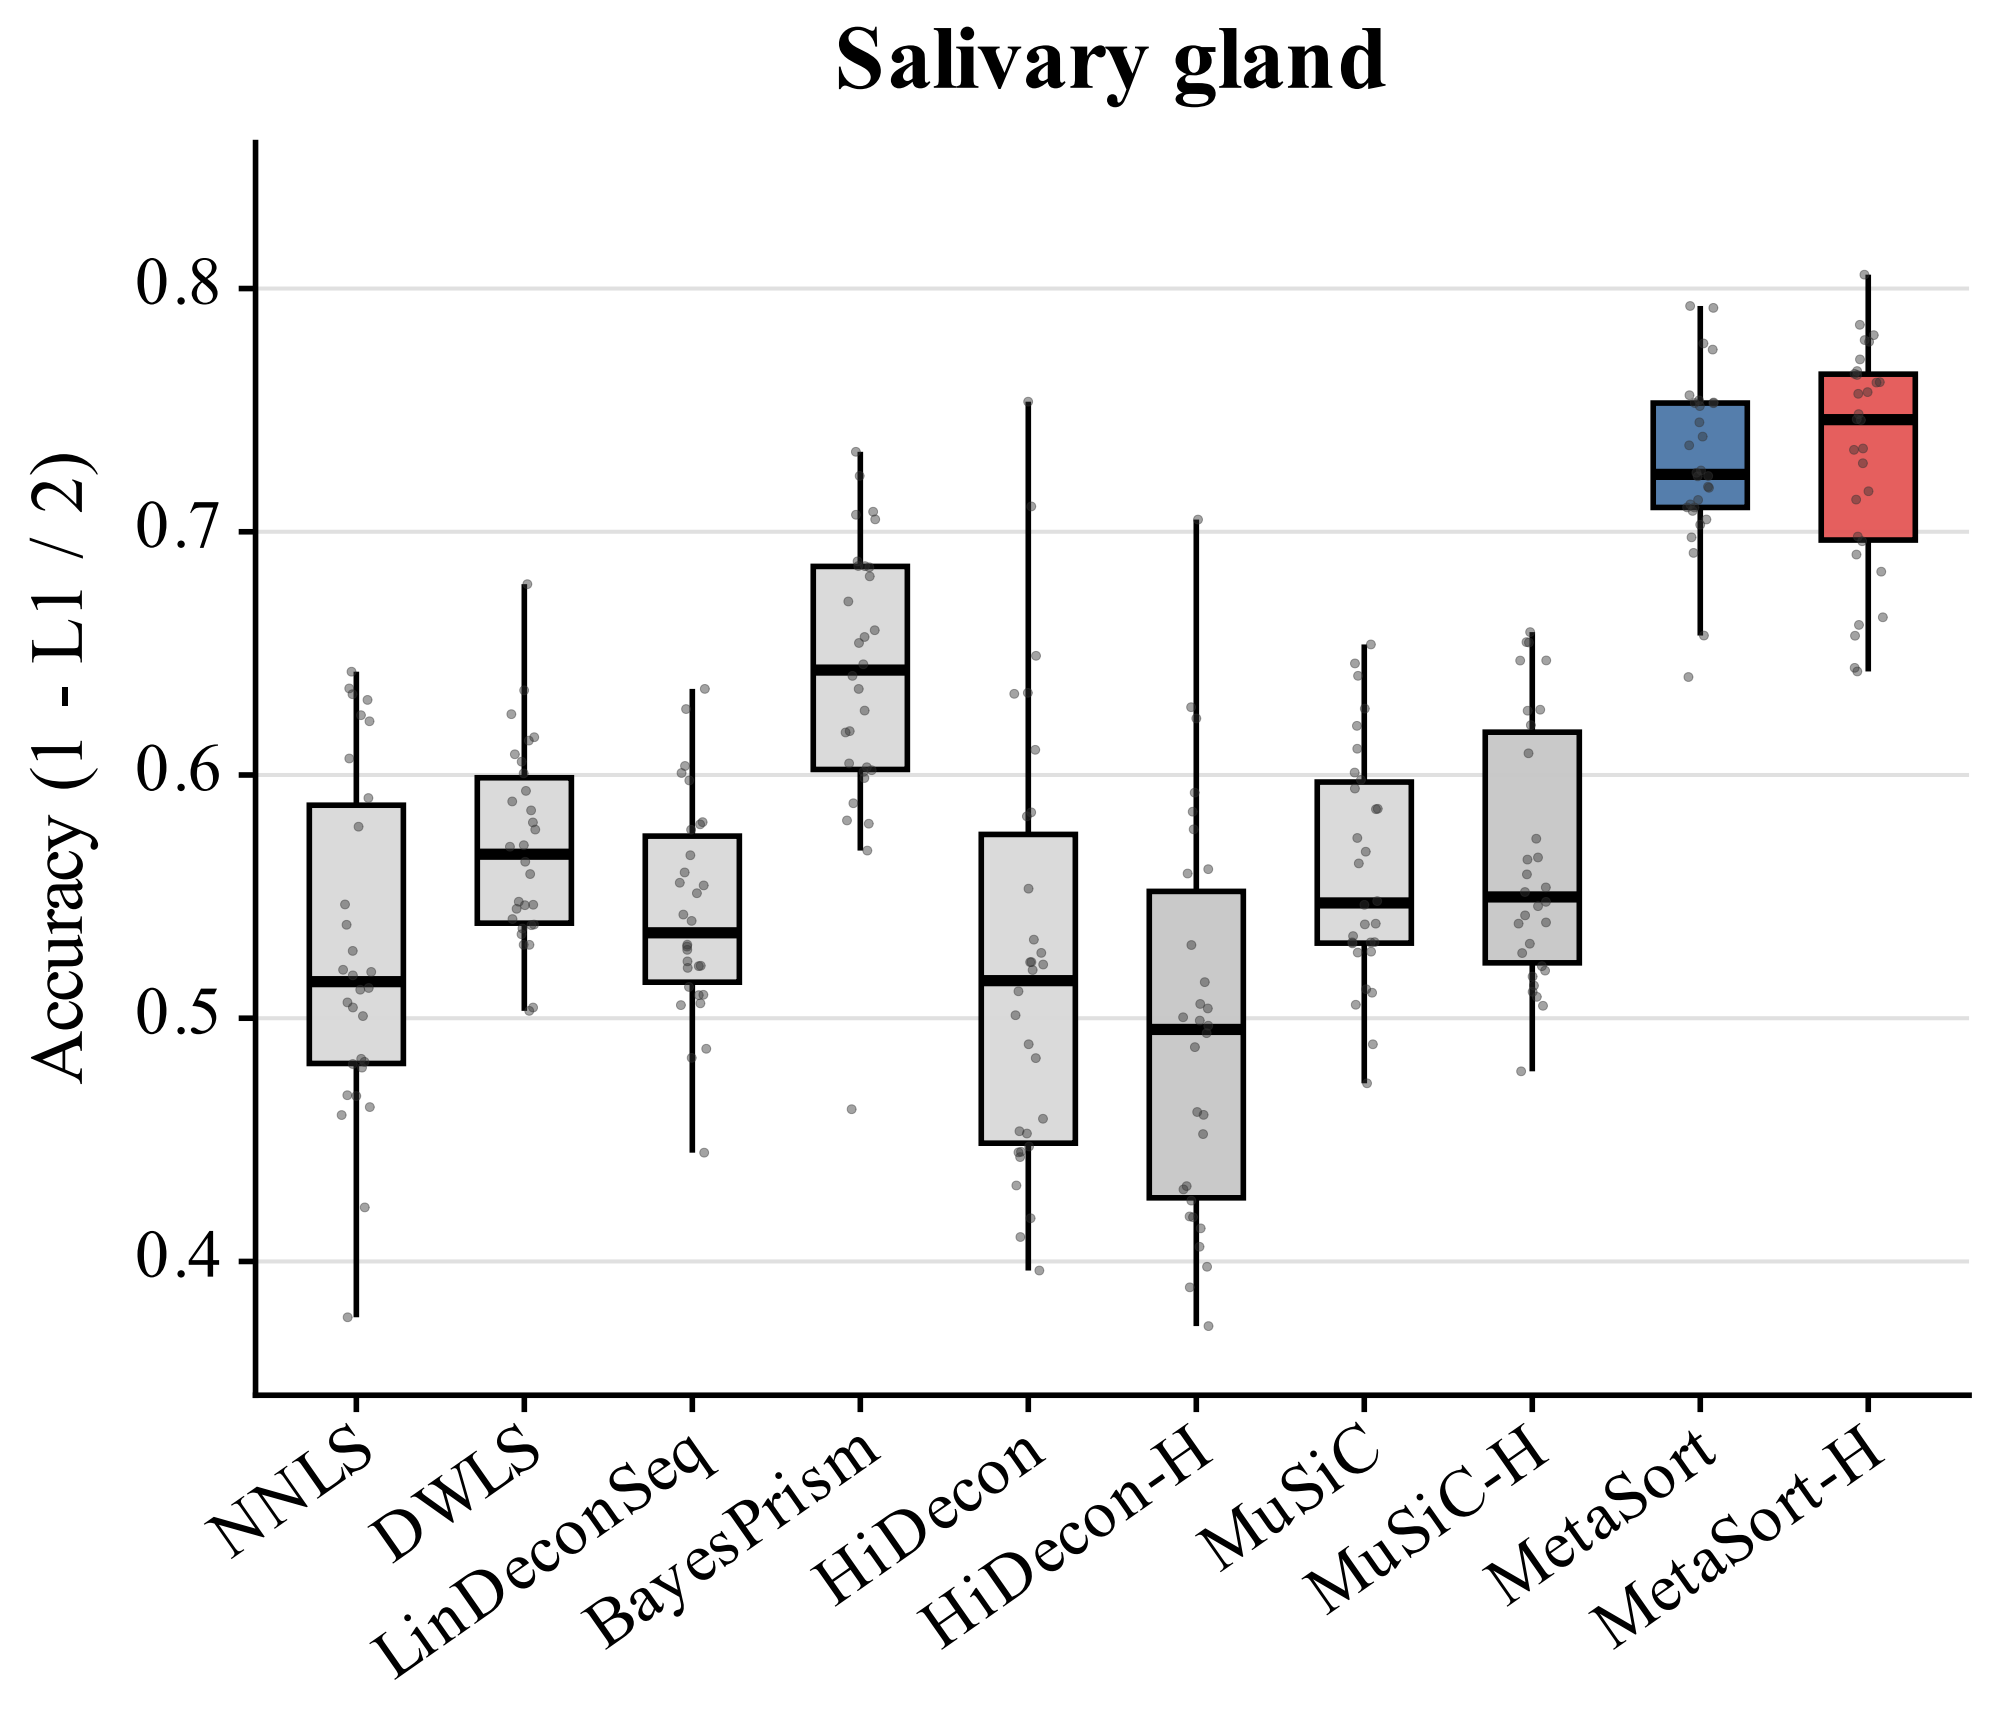
Salivary gland
Accuracy (1 - L1 / 2)
0.8
0.7
0.6
0.5
0.4
NNLS
DWLS
LinDeconSeq
BayesPrism
HiDecon
HiDecon-H
MuSiC
MuSiC-H
MetaSort
MetaSort-H