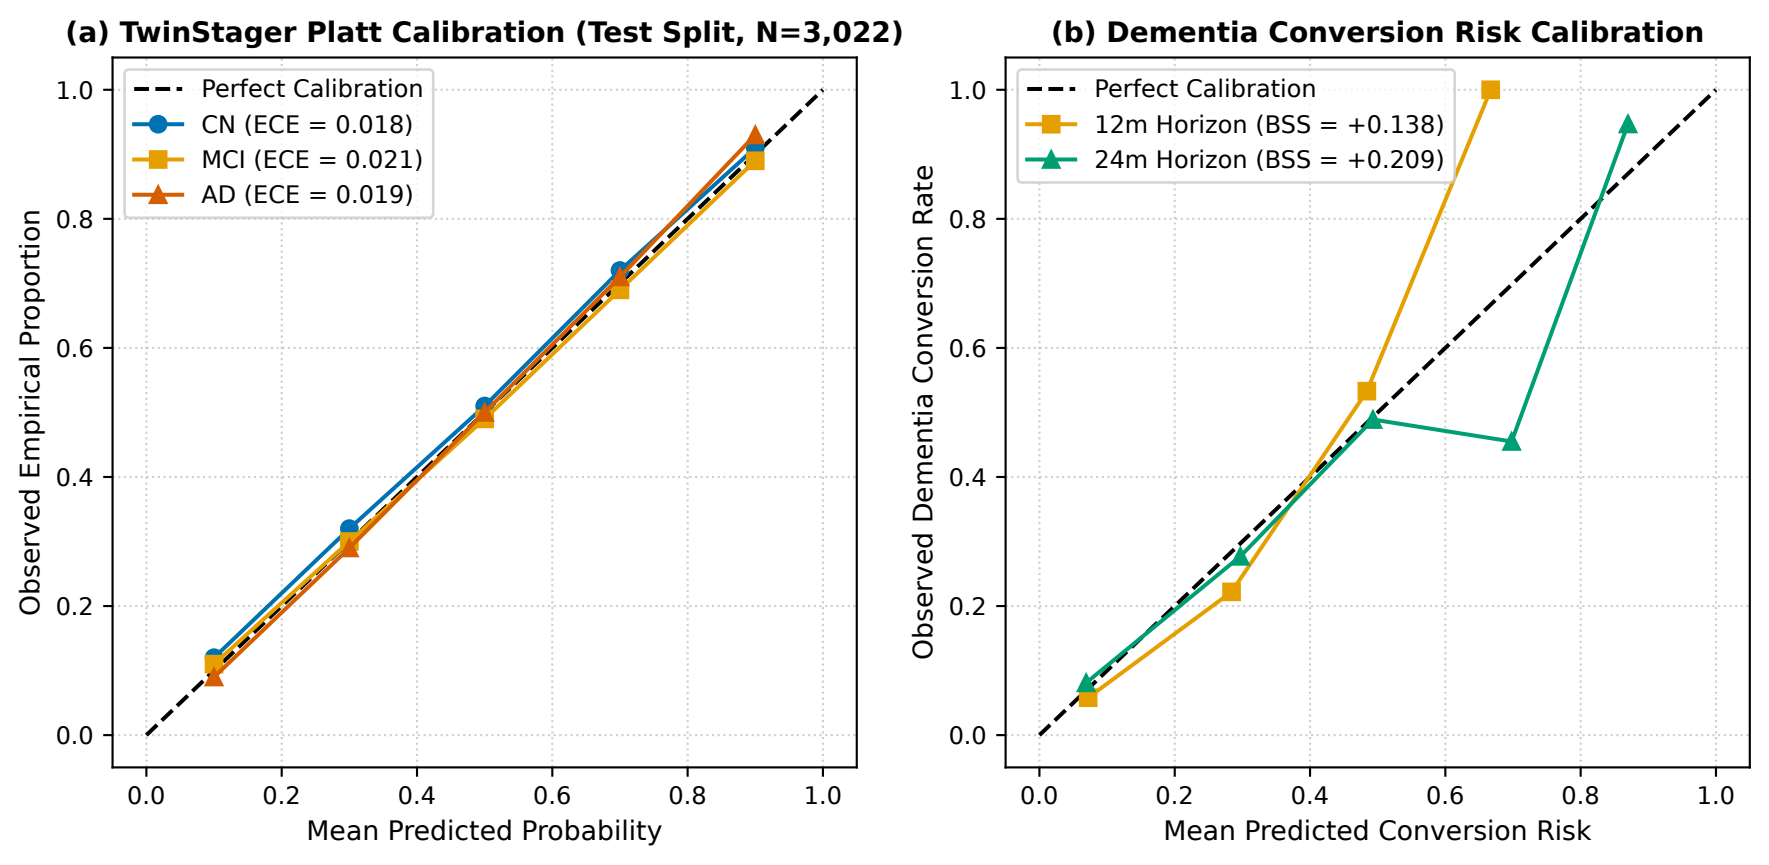
(a) TwinStager Platt Calibration (Test Split, N=3,022)
Perfect Calibration
CN (ECE = 0.018)
MCI (ECE = 0.021)
AD (ECE = 0.019)
Observed Empirical Proportion
Mean Predicted Probability
0.0
0.2
0.4
0.6
0.8
1.0
(b) Dementia Conversion Risk Calibration
Perfect Calibration
12m Horizon (BSS = +0.138)
24m Horizon (BSS = +0.209)
Observed Dementia Conversion Rate
Mean Predicted Conversion Risk