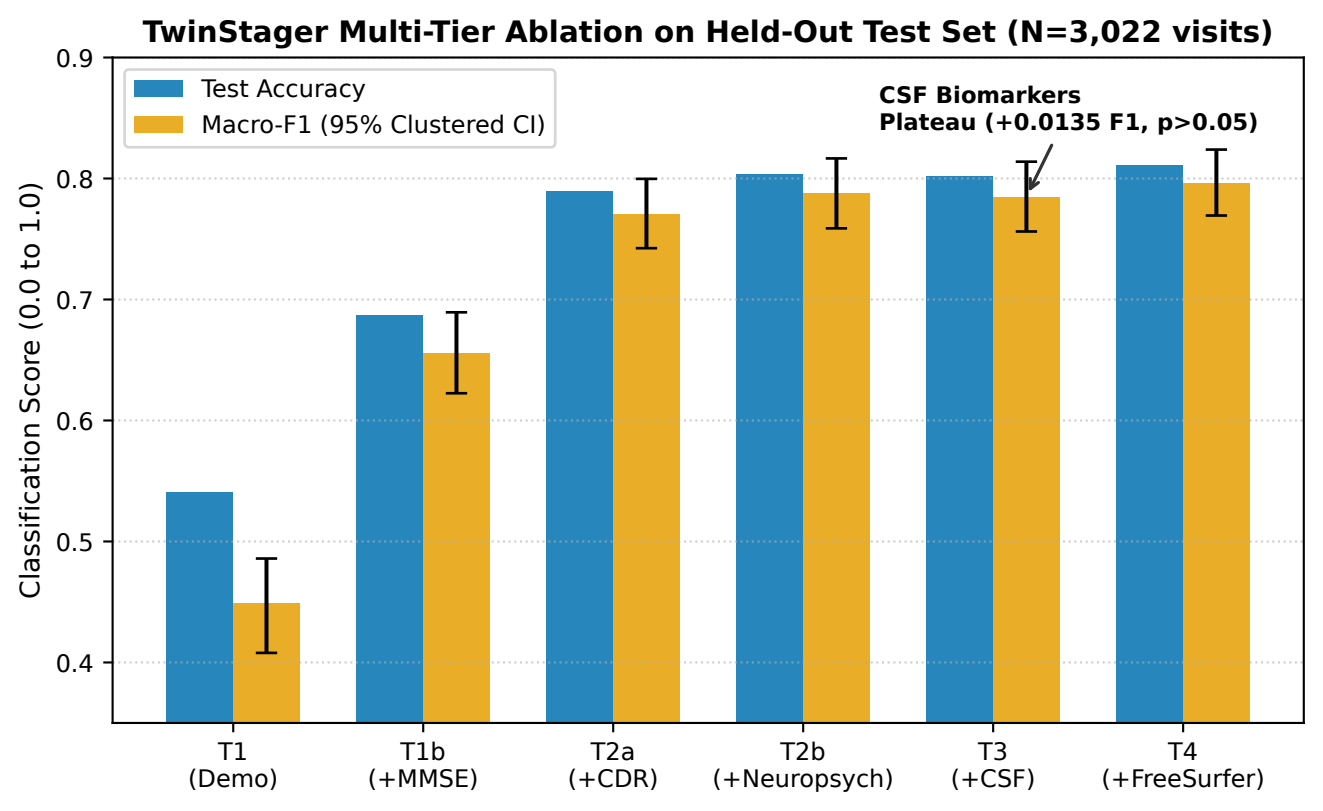
TwinStager Multi-Tier Ablation on Held-Out Test Set (N=3,022 visits)
Test Accuracy
Macro-F1 (95% Clustered CI)
CSF Biomarkers
Plateau (+0.0135 F1, p>0.05)
Classification Score (0.0 to 1.0)
0.9
0.8
0.7
0.6
0.5
0.4
T1
(Demo)
T1b
(+MMSE)
T2a
(+CDR)
T2b
(+Neuropsych)
T3
(+CSF)
T4
(+FreeSurfer)