PU901G

0
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G READY TO START FB A08PU901G_RDY
<N06:I.Slot[4].Data.2>
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G READY TO START FB TO DCS A08PU901G_RDY_PTD
<PTD_CS07_EX1[210]>

1
A08PU901G_LC_TRIP_FROM_DCS_312
<DTP_CS07_EX1[312]>
P-901 low current trip A08PU901G_LC_TRIP

2
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G TRIP FB A08PU901G_TRP
<N06:I.Slot[4].Data.0>
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G TRIP FB TO DCS A08PU901G_TRP_PTD
<PTD_CS07_EX1[208]>

3
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G RUN FB A08PU901G_RUN
<N06:I.Slot[4].Data.1>
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G RUN FB TO DCS A08PU901G_RUN_PTD
<PTD_CS07_EX1[209]>

4
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU901G_DLOC
<DTP_CS07_EX1[75]>
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G LOCAL/REMOTE SELECTOR SWITCH A08PU901G_LOC
<N06:O.Slot[10].Data.0>

5
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G LOCAL/REMOTE SELECTOR SWITCH A08PU901G_LOC
<N06:O.Slot[10].Data.0>
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU901G_LOC_PTD
<PTD_CS07_EX1[304]>

6

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G READY TO START FB A08PU901G_RDY <N06:I.Slot[4].Data.2>

P-901 low current trip A08PU901G_LC_TRIP

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G TRIP FB A08PU901G_TRP <N06:I.Slot[4].Data.0>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G RUN FB A08PU901G_RUN <N06:I.Slot[4].Data.1>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU901G_DLOC <DTP_CS07_EX1[75]>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G START PB FROM DCS A08PU901G_DSTR <DTP_CS07_EX1[76]>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G STOP PB FROM DCS A08PU901G_DSTP <DTP_CS07_EX1[77]>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G START/STOP PB A08PU901G_STR <N06:O.Slot[10].Data.1>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G RUN FB A08PU901G_RUN <N06:I.Slot[4].Data.1>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU901G_DLOC <DTP_CS07_EX1[75]>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G START/STOP PB A08PU901G_STR <N06:O.Slot[10].Data.1>

7

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G START/STOP PB A08PU901G_STR <N06:O.Slot[10].Data.1>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901G START/STOP PB TO DCS A08PU901G_STR_PTD <PTD_CS07_EX1[305]>

PU907AG

8

STEAM CONDENSATE PUMP PA-CF-907AG READY TO START FB A08PU907AG_RDY <N06:I.Slot[4].Data.5>

STEAM CONDENSATE PUMP PA-CF-907AG READY TO START FB TO DCS A08PU907AG_RDY_PTD <PTD_CS07_EX1[213]>

9
STEAM CONDENSATE PUMP PA-CF-907AG TRIP FB
A08PU907AG_TRP
<N06:I.Slot[4].Data.3>

STEAM CONDENSATE PUMP PA-CF-907AG TRIP FB TO DCS
A08PU907AG_TRP_PTD
<PTD_CS07_EX1[211]>

10
STEAM CONDENSATE PUMP PA-CF-907AG RUN FB
A08PU907AG_RUN
<N06:I.Slot[4].Data.4>

STEAM CONDENSATE PUMP PA-CF-907AG RUN FB TO DCS
A08PU907AG_RUN_PTD
<PTD_CS07_EX1[212]>

11
STEAM CONDENSATE PUMP PA-CF-907AG LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU907AG_DLOC
<DTP_CS07_EX1[78]>

STEAM CONDENSATE PUMP PA-CF-907AG LOCAL/REMOTE SELECTOR SWITCH
A08PU907AG_LOC
<N06:O.Slot[10].Data.2>

12
STEAM CONDENSATE PUMP PA-CF-907AG LOCAL/REMOTE SELECTOR SWITCH
A08PU907AG_LOC
<N06:O.Slot[10].Data.2>

STEAM CONDENSATE PUMP PA-CF-907AG LOCAL/REMOTE SELECTOR SWITCH TO DCS
A08PU907AG_LOC_PTD
<PTD_CS07_EX1[306]>

13

STEAM CONDENSATE PUMP PA-CF-907AG READY TO START FB A08PU907AG_RDY <N06:I.Slot[4].Data.5>

STEAM CONDENSATE PUMP PA-CF-907AG TRIP FB A08PU907AG_TRP <N06:I.Slot[4].Data.3>

STEAM CONDENSATE PUMP PA-CF-907AG RUN FB A08PU907AG_RUN <N06:I.Slot[4].Data.4>

STEAM CONDENSATE PUMP PA-CF-907AG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU907AG_DLOC <DTP_CS07_EX1[78]>

STEAM CONDENSATE PUMP PA-CF-907AG START PB FROM DCS A08PU907AG_DSTR <DTP_CS07_EX1[79]>

STEAM CONDENSATE PUMP PA-CF-907AG STOP PB FROM DCS A08PU907AG_DSTP <DTP_CS07_EX1[80]>

STEAM CONDENSATE PUMP PA-CF-907AG START/STOP PB A08PU907AG_STR <N06:O.Slot[10].Data.3>

STEAM CONDENSATE PUMP PA-CF-907AG RUN FB A08PU907AG_RUN <N06:I.Slot[4].Data.4>

STEAM CONDENSATE PUMP PA-CF-907AG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU907AG_DLOC <DTP_CS07_EX1[78]>

STEAM CONDENSATE PUMP PA-CF-907AG START/STOP PB A08PU907AG_STR <N06:O.Slot[10].Data.3>

14

STEAM CONDENSATE PUMP PA-CF-907AG START/STOP PB A08PU907AG_STR <N06:O.Slot[10].Data.3>

STEAM CONDENSATE PUMP PA-CF-907AG START/STOP PB TO DCS A08PU907AG_STR_PTD <PTD_CS07_EX1[307]>

PU907BG

15

STEAM CONDENSATE PUMP PA-CF-907BG READY TO START FB A08PU907BG_RDY <N06:I.Slot[4].Data.8>

STEAM CONDENSATE PUMP PA-CF-907BG READY TO START FB TO DCS A08PU907BG_RDY_PTD <PTD_CS07_EX1[216]>

16

STEAM CONDENSATE PUMP PA-CF-907BG TRIP FB A08PU907BG_TRP <N06:I.Slot[4].Data.6>

STEAM CONDENSATE PUMP PA-CF-907BG TRIP FB TO DCS A08PU907BG_TRP_PTD <PTD_CS07_EX1[214]>

17
STEAM CONDENSATE PUMP PA-CF-907BG RUN FB A08PU907BG_RUN <N06:I.Slot[4].Data.7>
STEAM CONDENSATE PUMP PA-CF-907BG RUN FB TO DCS A08PU907BG_RUN_PTD <PTD_CS07_EX1[215]>

18
STEAM CONDENSATE PUMP PA-CF-907BG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU907BG_DLOC <DTP_CS07_EX1[81]> /
STEAM CONDENSATE PUMP PA-CF-907BG LOCAL/REMOTE SELECTOR SWITCH A08PU907BG_LOC <N06:O.Slot[10].Data.4>

19
STEAM CONDENSATE PUMP PA-CF-907BG LOCAL/REMOTE SELECTOR SWITCH A08PU907BG_LOC <N06:O.Slot[10].Data.4>
STEAM CONDENSATE PUMP PA-CF-907BG LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU907BG_LOC_PTD <PTD_CS07_EX1[308]>

20
STEAM CONDENSATE PUMP PA-CF-907BG READY TO START FB A08PU907BG_RDY <N06:I.Slot[4].Data.8>
STEAM CONDENSATE PUMP PA-CF-907BG TRIP FB A08PU907BG_TRP <N06:I.Slot[4].Data.6> /
STEAM CONDENSATE PUMP PA-CF-907BG RUN FB A08PU907BG_RUN <N06:I.Slot[4].Data.7>
STEAM CONDENSATE PUMP PA-CF-907BG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU907BG_DLOC <DTP_CS07_EX1[81]> /
STEAM CONDENSATE PUMP PA-CF-907BG START PB FROM DCS A08PU907BG_DSTR <DTP_CS07_EX1[82]>
STEAM CONDENSATE PUMP PA-CF-907BG STOP PB FROM DCS A08PU907BG_DSTP <DTP_CS07_EX1[83]> /
STEAM CONDENSATE PUMP PA-CF-907BG START/STOP PB A08PU907BG_STR <N06:O.Slot[10].Data.5>
STEAM CONDENSATE PUMP PA-CF-907BG RUN FB A08PU907BG_RUN <N06:I.Slot[4].Data.7>
STEAM CONDENSATE PUMP PA-CF-907BG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU907BG_DLOC <DTP_CS07_EX1[81]>
STEAM CONDENSATE PUMP PA-CF-907BG START/STOP PB A08PU907BG_STR <N06:O.Slot[10].Data.5>

21
STEAM CONDENSATE PUMP PA-CF-907BG START/STOP PB A08PU907BG_STR <N06:O.Slot[10].Data.5>
STEAM CONDENSATE PUMP PA-CF-907BG START/STOP PB TO DCS A08PU907BG_STR_PTD <PTD_CS07_EX1[309]>

PU902G

22
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G READY TO START FB A08PU902G_RDY <N06:I.Slot[4].Data.11>
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G READY TO START FB TO DCS A08PU902G_RDY_PTD <PTD_CS07_EX1[219]>

23
A08PU902G_LC_TRP_FROM_DCS <DTP_CS07_EX1[307]>
P-902 low current trip A08PU902G_LC_TRP

24
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G TRIP FB A08PU902G_TRP <N06:I.Slot[4].Data.9>
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G TRIP FB TO DCS A08PU902G_TRP_PTD <PTD_CS07_EX1[217]>

25
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G RUN FB A08PU902G_RUN <N06:I.Slot[4].Data.10>
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G RUN FB TO DCS A08PU902G_RUN_PTD <PTD_CS07_EX1[218]>

26
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU902G_DLOC <DTP_CS07_EX1[84]>
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G LOCAL/REMOTE SELECTOR SWITCH A08PU902G_LOC <N06:O.Slot[10].Data.6>

27
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G LOCAL/REMOTE SELECTOR SWITCH A08PU902G_LOC <N06:O.Slot[10].Data.6>
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU902G_LOC_PTD <PTD_CS07_EX1[310]>

28

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G READY TO START FB A08PU902G_RDY <N06:I.Slot[4].Data.11>

P-902 low current trip A08PU902G_LC_TRP

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G TRIP FB A08PU902G_TRP <N06:I.Slot[4].Data.9>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G RUN FB A08PU902G_RUN <N06:I.Slot[4].Data.10>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU902G_DLOC <DTP_CS07_EX1[84]>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G START PB FROM DCS A08PU902G_DSTR <DTP_CS07_EX1[85]>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G STOP PB FROM DCS A08PU902G_DSTP <DTP_CS07_EX1[86]>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G START/STOP PB A08PU902G_STR <N06:O.Slot[10].Data.7>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G RUN FB A08PU902G_RUN <N06:I.Slot[4].Data.10>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU902G_DLOC <DTP_CS07_EX1[84]>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G START/STOP PB A08PU902G_STR <N06:O.Slot[10].Data.7>

29

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G START/STOP PB A08PU902G_STR <N06:O.Slot[10].Data.7>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902G START/STOP PB TO DCS A08PU902G_STR_PTD <PTD_CS07_EX1[311]>

30

PU908G

JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G READY TO START FB A08PU908PUG_RDY <N06:I.Slot[5].Data.8>

JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G READY TO START FB TO DCS A08PU908PUG_RDY_PTD <PTD_CS07_EX1[232]>

31
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G TRIP FB A08PU908PUG_TRP <N06:I.Slot[5].Data.6>
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G TRIP FB TO DCS A08PU908PUG_TRP_PTD <PTD_CS07_EX1[230]>

32
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G RUN FB A08PU908PUG_RUN <N06:I.Slot[5].Data.7>
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G RUN FB TO DCS A08PU908PUG_RUN_PTD <PTD_CS07_EX1[231]>

33
P 908 BATTERY G LOW CURRENT TRIP A08PU908G_LC_TRIP <DTP_CS07_EX1[330]>
P 908 BATTERY G LOW CURRENT TRIP A08PU908G_LC_TRIP <DTP_CS07_EX1[330]>

34
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU908PUG_DLOC <DTP_CS07_EX1[93]> /
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G LOCAL/REMOTE SELECTOR SWITCH A08PU908PUG_LOC <N06:O.Slot[10].Data.12>

35
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G READY TO START FB A08PU908PUG_RDY <N06:I.Slot[5].Data.8>
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G RUN FB A08PU908PUG_RUN <N06:I.Slot[5].Data.7>
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU908PUG_DLOC <DTP_CS07_EX1[93]> /
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G START/STOP PB A08PU908PUG_STR <N06:O.Slot[10].Data.13>
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G START PB FROM DCS A08PU908PUG_DSTR <DTP_CS07_EX1[94]>
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G RUN FB A08PU908PUG_RUN <N06:I.Slot[5].Data.7>
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU908PUG_DLOC <DTP_CS07_EX1[93]>
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G STOP PB FROM DCS A08PU908PUG_DSTP <DTP_CS07_EX1[95]> /
P 908 BATTERY G LOW CURRENT TRIP A08PU908G_LC_TRIP <DTP_CS07_EX1[330]> /
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G TRIP FB A08PU908PUG_TRP <N06:I.Slot[5].Data.6> /
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G START/STOP PB A08PU908PUG_STR <N06:O.Slot[10].Data.13>

36
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G LOCAL/REMOTE SELECTOR SWITCH A08PU908PUG_LOC <N06:O.Slot[10].Data.12>
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU908PUG_LOC_PTD <PTD_CS07_EX1[316]>

37
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G START/STOP PB A08PU908PUG_STR <N06:O.Slot[10].Data.13>
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908G START/STOP PB TO DCS A08PU908PUG_STR_PTD <PTD_CS07_EX1[317]>

PU909AG

38
2nd EFFECT CONDENSATE PUMP PA-CF-909AG READY TO START FB A08PU909AG_RDY <N06:I.Slot[5].Data.2>
2nd EFFECT CONDENSATE PUMP PA-CF-909AG READY TO START FB TO DCS A08PU909AG_RDY_PTD <PTD_CS07_EX1[226]>

39
2nd EFFECT CONDENSATE PUMP PA-CF-909AG TRIP FB A08PU909AG_TRP <N06:I.Slot[5].Data.0>
2nd EFFECT CONDENSATE PUMP PA-CF-909AG TRIP FB TO DCS A08PU909AG_TRP_PTD <PTD_CS07_EX1[224]>

40
2nd EFFECT CONDENSATE PUMP PA-CF-909AG RUN FB A08PU909AG_RUN <N06:I.Slot[5].Data.1>
2nd EFFECT CONDENSATE PUMP PA-CF-909AG RUN FB TO DCS A08PU909AG_RUN_PTD <PTD_CS07_EX1[225]>

41
2nd EFFECT CONDENSATE PUMP PA-CF-909AG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU909AG_DLOC <DTP_CS07_EX1[87]>
2nd EFFECT CONDENSATE PUMP PA-CF-909AG LOCAL/REMOTE SELECTOR SWITCH A08PU909AG_LOC <N06:O.Slot[10].Data.8>

42
2nd EFFECT CONDENSATE PUMP PA-CF-909AG LOCAL/REMOTE SELECTOR SWITCH A08PU909AG_LOC <N06:O.Slot[10].Data.8>
2nd EFFECT CONDENSATE PUMP PA-CF-909AG LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU909AG_LOC_PTD <PTD_CS07_EX1[312]>

43

2nd EFFECT CONDENSATE PUMP PA-CF-909AG READY TO START FB A08PU909AG_RDY <N06:I.Slot[5].Data.2>

2nd EFFECT CONDENSATE PUMP PA-CF-909AG TRIP FB A08PU909AG_TRP <N06:I.Slot[5].Data.0>

2nd EFFECT CONDENSATE PUMP PA-CF-909AG RUN FB A08PU909AG_RUN <N06:I.Slot[5].Data.1>

2nd EFFECT CONDENSATE PUMP PA-CF-909AG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU909AG_DLOC <DTP_CS07_EX1[87]>

2nd EFFECT CONDENSATE PUMP PA-CF-909AG START PB FROM DCS A08PU909AG_DSTR <DTP_CS07_EX1[88]>

2nd EFFECT CONDENSATE PUMP PA-CF-909AG STOP PB FROM DCS A08PU909AG_DSTP <DTP_CS07_EX1[89]>

2nd EFFECT CONDENSATE PUMP PA-CF-909AG START/STOP PB A08PU909AG_STR <N06:O.Slot[10].Data.9>

2nd EFFECT CONDENSATE PUMP PA-CF-909AG RUN FB A08PU909AG_RUN <N06:I.Slot[5].Data.1>

2nd EFFECT CONDENSATE PUMP PA-CF-909AG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU909AG_DLOC <DTP_CS07_EX1[87]>

2nd EFFECT CONDENSATE PUMP PA-CF-909AG START/STOP PB A08PU909AG_STR <N06:O.Slot[10].Data.9>

44

2nd EFFECT CONDENSATE PUMP PA-CF-909AG START/STOP PB A08PU909AG_STR <N06:O.Slot[10].Data.9>

2nd EFFECT CONDENSATE PUMP PA-CF-909AG START/STOP PB TO DCS A08PU909AG_STR_PTD <PTD_CS07_EX1[313]>

PU909BG

45

2nd EFFECT CONDENSATE PUMP PA-CF-909BG READY TO START FB A08PU909BG_RDY <N06:I.Slot[5].Data.5>

2nd EFFECT CONDENSATE PUMP PA-CF-909BG READY TO START FB TO DCS A08PU909BG_RDY_PTD <PTD_CS07_EX1[229]>

46
2nd EFFECT CONDENSATE PUMP PA-CF-909BG TRIP FB A08PU909BG_TRP <N06:I.Slot[5].Data.3>
2nd EFFECT CONDENSATE PUMP PA-CF-909BG TRIP FB TO DCS A08PU909BG_TRP_PTD <PTD_CS07_EX1[227]>

47
2nd EFFECT CONDENSATE PUMP PA-CF-909BG RUN FB A08PU909BG_RUN <N06:I.Slot[5].Data.4>
2nd EFFECT CONDENSATE PUMP PA-CF-909BG RUN FB TO DCS A08PU909BG_RUN_PTD <PTD_CS07_EX1[228]>

48
2nd EFFECT CONDENSATE PUMP PA-CF-909BG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU909BG_DLOC <DTP_CS07_EX1[90]>
2nd EFFECT CONDENSATE PUMP PA-CF-909BG LOCAL/REMOTE SELECTOR SWITCH A08PU909BG_LOC <N06:O.Slot[10].Data.10>

49
2nd EFFECT CONDENSATE PUMP PA-CF-909BG LOCAL/REMOTE SELECTOR SWITCH A08PU909BG_LOC <N06:O.Slot[10].Data.10>
2nd EFFECT CONDENSATE PUMP PA-CF-909BG LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU909BG_LOC_PTD <PTD_CS07_EX1[314]>

50

2nd EFFECT CONDENSATE PUMP PA-CF-909BG READY TO START FB A08PU909BG_RDY <N06:I.Slot[5].Data.5>

2nd EFFECT CONDENSATE PUMP PA-CF-909BG TRIP FB A08PU909BG_TRP <N06:I.Slot[5].Data.3>

2nd EFFECT CONDENSATE PUMP PA-CF-909BG RUN FB A08PU909BG_RUN <N06:I.Slot[5].Data.4>

2nd EFFECT CONDENSATE PUMP PA-CF-909BG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU909BG_DLOC <DTP_CS07_EX1[90]>

2nd EFFECT CONDENSATE PUMP PA-CF-909BG START PB FROM DCS A08PU909BG_DSTR <DTP_CS07_EX1[91]>

2nd EFFECT CONDENSATE PUMP PA-CF-909BG STOP PB FROM DCS A08PU909BG_DSTP <DTP_CS07_EX1[92]>

2nd EFFECT CONDENSATE PUMP PA-CF-909BG START/STOP PB A08PU909BG_STR <N06:O.Slot[10].Data.11>

2nd EFFECT CONDENSATE PUMP PA-CF-909BG RUN FB A08PU909BG_RUN <N06:I.Slot[5].Data.4>

2nd EFFECT CONDENSATE PUMP PA-CF-909BG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU909BG_DLOC <DTP_CS07_EX1[90]>

2nd EFFECT CONDENSATE PUMP PA-CF-909BG START/STOP PB A08PU909BG_STR <N06:O.Slot[10].Data.11>

51

2nd EFFECT CONDENSATE PUMP PA-CF-909BG START/STOP PB A08PU909BG_STR <N06:O.Slot[10].Data.11>

2nd EFFECT CONDENSATE PUMP PA-CF-909BG START/STOP PB TO DCS A08PU909BG_STR_PTD <PTD_CS07_EX1[315]>

PU903G

52

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G READY TO START FB A08PU903G_RDY <N06:I.Slot[5].Data.11>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G READY TO START FB TO DCS A08PU903G_RDY_PTD <PTD_CS07_EX1[235]>

53
A08PU903G_LC_TRP_DCS
<DTP_CS07_EX1[308]>
A08PU903G_LC_TRP

54
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G TRIP FB A08PU903G_TRP
<N06:I.Slot[5].Data.9>
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G TRIP FB TO DCS A08PU903G_TRP_PTD
<PTD_CS07_EX1[233]>

55
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G RUN FB A08PU903G_RUN
<N06:I.Slot[5].Data.10>
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G RUN FB TO DCS A08PU903G_RUN_PTD
<PTD_CS07_EX1[234]>

56
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU903G_DLOC
<DTP_CS07_EX1[96]>
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G LOCAL/REMOTE SELECTOR SWITCH A08PU903G_LOC
<N06:O.Slot[11].Data.0>

57
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G LOCAL/REMOTE SELECTOR SWITCH A08PU903G_LOC
<N06:O.Slot[11].Data.0>
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU903G_LOC_PTD
<PTD_CS07_EX1[320]>

58

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G READY TO START FB A08PU903G_RDY <N06:I.Slot[5].Data.11>

A08PU903G_LC_TRP

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G TRIP FB A08PU903G_TRP <N06:I.Slot[5].Data.9>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G RUN FB A08PU903G_RUN <N06:I.Slot[5].Data.10>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU903G_DLOC <DTP_CS07_EX1[96]>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G START PB FROM DCS A08PU903G_DSTR <DTP_CS07_EX1[97]>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G STOP PB FROM DCS A08PU903G_DSTP <DTP_CS07_EX1[98]>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G START/STOP PB A08PU903G_STR <N06:O.Slot[11].Data.1>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G RUN FB A08PU903G_RUN <N06:I.Slot[5].Data.10>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU903G_DLOC <DTP_CS07_EX1[96]>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G START/STOP PB A08PU903G_STR <N06:O.Slot[11].Data.1>

59

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G START/STOP PB A08PU903G_STR <N06:O.Slot[11].Data.1>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903G START/STOP PB TO DCS A08PU903G_STR_PTD <PTD_CS07_EX1[321]>

PU910G

60

PRODUCT PUMP PA-CF-910G TRIP FB A08PU910G_TRP <N06:I.Slot[6].Data.3>

PRODUCT PUMP PA-CF-910G TRIP FB TO DCS A08PU910G_TRP_PTD <PTD_CS07_EX1[243]>

61
P_910 BAT-G LOW CURRENT TRIP A08PU_910G_LC_TRIP <DTP_CS07_EX1[331]>
P_910 BAT-G LOW CURRENT TRIP A08PU_910G_LC_TRIP <DTP_CS07_EX1[331]>

62
PRODUCT PUMP PA-CF-910G RUN FB A08PU910G_RUN <N06:I.Slot[6].Data.4>
PRODUCT PUMP PA-CF-910G RUN FB TO DCS A08PU910G_RUN_PTD <PTD_CS07_EX1[244]>

63
A08PU910G_RDY <N06:I.Slot[6].Data.5>
A08PU910G_RDY_PTD <PTD_CS07_EX1[245]>

64
PRODUCT PUMP PA-CF-910G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU910G_DLOC <DTP_CS07_EX1[102]> /
PRODUCT PUMP PA-CF-910G LOCAL/REMOTE SELECTOR SWITCH A08PU910G_LOC <N06:O.Slot[11].Data.4>

65
PRODUCT PUMP PA-CF-910G LOCAL/REMOTE SELECTOR SWITCH A08PU910G_LOC <N06:O.Slot[11].Data.4>
PRODUCT PUMP PA-CF-910G LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU910G_LOC_PTD <PTD_CS07_EX1[324]>

66
A08PU910G_RDY <N06:I.Slot[6].Data.5>
P_910 BAT-G LOW CURRENT TRIP A08PU_910G_LC_TRIP <DTP_CS07_EX1[331]> /
PRODUCT PUMP PA-CF-910G TRIP FB A08PU910G_TRP <N06:I.Slot[6].Data.3> /
PRODUCT PUMP PA-CF-910G RUN FB A08PU910G_RUN <N06:I.Slot[6].Data.4>

PRODUCT PUMP PA-CF-910G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU910G_DLOC <DTP_CS07_EX1[102]> /
PRODUCT PUMP PA-CF-910G START PB FROM DCS A08PU910G_DSTR <DTP_CS07_EX1[103]>
PRODUCT PUMP PA-CF-910G STOP PB FROM DCS A08PU910G_DSTP <DTP_CS07_EX1[104]> /
PRODUCT PUMP PA-CF-910G START/STOP PB A08PU910G_STR <N06:O.Slot[11].Data.5>
PRODUCT PUMP PA-CF-910G START/STOP PB A08PU910G_STR <N06:O.Slot[11].Data.5>
PRODUCT PUMP PA-CF-910G RUN FB A08PU910G_RUN <N06:I.Slot[6].Data.4>
PRODUCT PUMP PA-CF-910G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU910G_DLOC <DTP_CS07_EX1[102]>

67
PRODUCT PUMP PA-CF-910G START/STOP PB A08PU910G_STR <N06:O.Slot[11].Data.5>
PRODUCT PUMP PA-CF-910G START/STOP PB TO DCS A08PU910G_STR_PTD <PTD_CS07_EX1[325]>

PU911G

68
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G TRIP FB A08PU911G_TRP <N06:I.Slot[6].Data.0>
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G TRIP FB TO DCS A08PU911G_TRP_PTD <PTD_CS07_EX1[240]>

69
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G RUN FB A08PU911G_RUN <N06:I.Slot[6].Data.1>
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G RUN FB TO DCS A08PU911G_RUN_PTD <PTD_CS07_EX1[241]>

70
P_911 BAT-G LOW CURRENT TRIP FROM DCS A08PU911_LC_TRIP <DTP_CS07_EX1[336]>
P_911 BAT-G LOW CURRENT TRIP FROM DCS A08PU911_LC_TRIP <DTP_CS07_EX1[336]>

71
A08PU911G_RDY <N06:I.Slot[6].Data.2>
A08PU911G_RDY_PTD <PTD_CS07_EX1[242]>

72
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU911G_DLOC <DTP_CS07_EX1[99]>
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G LOCAL/REMOTE SELECTOR SWITCH A08PU911G_LOC <N06:O.Slot[11].Data.2>

73
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G LOCAL/REMOTE SELECTOR SWITCH A08PU911G_LOC <N06:O.Slot[11].Data.2>
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU911G_LOC_PTD <PTD_CS07_EX1[322]>

74

A08PU911G_RDY
<N06:I.Slot[6].Data.2>

P_911 BAT-G LOW CURRENT TRIP FROM DCS
A08PU911_LC_TRIP
<DTP_CS07_EX1[336]>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G TRIP FB
A08PU911G_TRP
<N06:I.Slot[6].Data.0>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G RUN FB
A08PU911G_RUN
<N06:I.Slot[6].Data.1>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU911G_DLOC
<DTP_CS07_EX1[99]>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G START PB FROM DCS
A08PU911G_DSTR
<DTP_CS07_EX1[100]>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G STOP PB FROM DCS
A08PU911G_DSTP
<DTP_CS07_EX1[101]>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G START/STOP PB
A08PU911G_STR
<N06:O.Slot[11].Data.3>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G RUN FB
A08PU911G_RUN
<N06:I.Slot[6].Data.1>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU911G_DLOC
<DTP_CS07_EX1[99]>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G START/STOP PB
A08PU911G_STR
<N06:O.Slot[11].Data.3>

75

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G START/STOP PB
A08PU911G_STR
<N06:O.Slot[11].Data.3>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911G START/STOP PB TO DCS
A08PU911G_STR_PTD
<PTD_CS07_EX1[323]>

PU904G

76

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G READY TO START FB
A08PU904G_RDY
<N06:I.Slot[6].Data.8>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G READY TO START FB TO DCS
A08PU904G_RDY_PTD
<PTD_CS07_EX1[248]>

77

A08PU904G_LC_TRP_FROM_DCS
<DTP_CS07_EX1[309]>

A08PU904G_LC_TRP

78
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G TRIP FB A08PU904G_TRP <N06:I.Slot[6].Data.6>
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G TRIP FB TO DCS A08PU904G_TRP_PTD <PTD_CS07_EX1[246]>

79
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G RUN FB A08PU904G_RUN <N06:I.Slot[6].Data.7>
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G RUN FB TO DCS A08PU904G_RUN_PTD <PTD_CS07_EX1[247]>

80
LEVEL HIGH SWITCH ON TANK AFRM AREA SUMP TV-FB-922G A08_LAH_919G <N11:I.Slot[2].Data.0>
LEVEL HIGH SWITCH ON TANK AFRM AREA SUMP TV-FB-922G TO DCS A08_LAH_904G_PTD <PTD_CS07_EX3[304]>

81
LEVEL LOW SWITCH ON TANK AFRM AREA SUMP TV-FB-922G A08_LAL_904G <N11:I.Slot[2].Data.1>
LEVEL LOW SWITCH ON TANK AFRM AREA SUMP TV-FB-922G TO DCS A08_LAL_904G_PTD <PTD_CS07_EX3[305]>

82
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU904G_DLOC <DTP_CS07_EX1[105]>
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G LOCAL/REMOTE SELECTOR SWITCH A08PU904G_LOC <N06:O.Slot[11].Data.6>

83
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G LOCAL/REMOTE SELECTOR SWITCH A08PU904G_LOC <N06:O.Slot[11].Data.6>
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU904G_LOC_PTD <PTD_CS07_EX1[326]>

84

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G READY TO START FB A08PU904G_RDY <N06:I.Slot[6].Data.8>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G RUN FB A08PU904G_RUN <N06:I.Slot[6].Data.7>

A08PU904G_LC_TRP

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G TRIP FB A08PU904G_TRP <N06:I.Slot[6].Data.6>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU904G_DLOC <DTP_CS07_EX1[105]>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G START PB FROM DCS A08PU904G_DSTR <DTP_CS07_EX1[106]>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G STOP PB FROM DCS A08PU904G_DSTP <DTP_CS07_EX1[107]>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G START/STOP PB A08PU904G_STR <N06:O.Slot[11].Data.7>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G RUN FB A08PU904G_RUN <N06:I.Slot[6].Data.7>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU904G_DLOC <DTP_CS07_EX1[105]>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G START/STOP PB A08PU904G_STR <N06:O.Slot[11].Data.7>

85

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G START/STOP PB A08PU904G_STR <N06:O.Slot[11].Data.7>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904G START/STOP PB TO DCS A08PU904G_STR_PTD <PTD_CS07_EX1[327]>

PU912G

86

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G TRIP FB A08PU912G_TRP <N06:I.Slot[6].Data.9>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G TRIP FB TO DCS A08PU912G_TRP_PTD <PTD_CS07_EX1[249]>

87
JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G RUN FB A08PU912G_RUN
<N06:I.Slot[6].Data.10>
JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G RUN FB TO DCS A08PU912G_RUN_PTD
<PTD_CS07_EX1[250]>

88
A08PU912G_RDY
<N06:I.Slot[6].Data.11>
A08PU912G_RDY_PTD
<PTD_CS07_EX1[251]>

89
JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU912G_DLOC
<DTP_CS07_EX1[108]>
JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G LOCAL/REMOTE SELECTOR SWITCH A08PU912G_LOC
<N06:O.Slot[11].Data.8>

90
JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G LOCAL/REMOTE SELECTOR SWITCH A08PU912G_LOC
<N06:O.Slot[11].Data.8>
JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU912G_LOC_PTD
<PTD_CS07_EX1[328]>

91

A08PU912G_RDY
<N06:I.Slot[6].Data.11>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G TRIP FB A08PU912G_TRP
<N06:I.Slot[6].Data.9>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G RUN FB A08PU912G_RUN
<N06:I.Slot[6].Data.10>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU912G_DLOC
<DTP_CS07_EX1[108]>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G START PB FROM DCS A08PU912G_DSTR
<DTP_CS07_EX1[109]>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G STOP PB FROM DCS A08PU912G_DSTP
<DTP_CS07_EX1[110]>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G START/STOP PB A08PU912G_STR
<N06:O.Slot[11].Data.9>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G RUN FB A08PU912G_RUN
<N06:I.Slot[6].Data.10>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU912G_DLOC
<DTP_CS07_EX1[108]>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G START/STOP PB A08PU912G_STR
<N06:O.Slot[11].Data.9>

92

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G START/STOP PB A08PU912G_STR
<N06:O.Slot[11].Data.9>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912G START/STOP PB TO DCS A08PU912G_STR_PTD
<PTD_CS07_EX1[329]>

PU905G

93

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G READY TO START FB A08PU905G_RDY
<N06:I.Slot[7].Data.2>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G READY TO START FB TO DCS A08PU905G_RDY_PTD
<PTD_CS07_EX1[258]>

94

A08PU905G_LC_TRP_FROM_DCS
<DTP_CS07_EX1[310]>

A08PU905_LC_TRP

95
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G TRIP FB A08PU905G_TRP <N06:I.Slot[7].Data.0>
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G TRIP FB TO DCS A08PU905G_TRP_PTD <PTD_CS07_EX1[256]>

96
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G RUN FB A08PU905G_RUN <N06:I.Slot[7].Data.1>
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G RUN FB TO DCS A08PU905G_RUN_PTD <PTD_CS07_EX1[257]>

97
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU905G_DLOC <DTP_CS07_EX1[111]> /
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G LOCAL/REMOTE SELECTOR SWITCH A08PU905G_LOC <N06:O.Slot[11].Data.10>

98
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G LOCAL/REMOTE SELECTOR SWITCH A08PU905G_LOC <N06:O.Slot[11].Data.10>
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU905G_LOC_PTD <PTD_CS07_EX1[330]>

99

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G READY TO START FB A08PU905G_RDY <N06:I.Slot[7].Data.2>

A08PU905_LC_TRP

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G TRIP FB A08PU905G_TRP <N06:I.Slot[7].Data.0>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G RUN FB A08PU905G_RUN <N06:I.Slot[7].Data.1>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU905G_DLOC <DTP_CS07_EX1[111]>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G START PB FROM DCS A08PU905G_DSTR <DTP_CS07_EX1[112]>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G STOP PB FROM DCS A08PU905G_DSTP <DTP_CS07_EX1[113]>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G START/STOP PB A08PU905G_STR <N06:O.Slot[11].Data.11>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G RUN FB A08PU905G_RUN <N06:I.Slot[7].Data.1>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU905G_DLOC <DTP_CS07_EX1[111]>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G START/STOP PB A08PU905G_STR <N06:O.Slot[11].Data.11>

100

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G START/STOP PB A08PU905G_STR <N06:O.Slot[11].Data.11>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905G START/STOP PB TO DCS A08PU905G_STR_PTD <PTD_CS07_EX1[331]>

PU913G

101

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G TRIP FB A08PU913G_TRP <N06:I.Slot[7].Data.3>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G TRIP FB TO DCS A08PU913G_TRP_PTD <PTD_CS07_EX1[259]>

102
JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G RUN FB A08PU913G_RUN <N06:I.Slot[7].Data.4>
JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G RUN FB TO DCS A08PU913G_RUN_PTD <PTD_CS07_EX1[260]>

103
A08PU913G_RDY <N06:I.Slot[7].Data.5>
A08PU913G_RDY_PTD <PTD_CS07_EX1[261]>

104
JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU913G_DLOC <DTP_CS07_EX1[114]>
JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G LOCAL/REMOTE SELECTOR SWITCH A08PU913G_LOC <N06:O.Slot[11].Data.12>

105
JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G LOCAL/REMOTE SELECTOR SWITCH A08PU913G_LOC <N06:O.Slot[11].Data.12>
JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU913G_LOC_PTD <PTD_CS07_EX1[332]>

106

A08PU913G_RDY
<N06:I.Slot[7].Data.5>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G TRIP FB A08PU913G_TRP
<N06:I.Slot[7].Data.3>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G RUN FB A08PU913G_RUN
<N06:I.Slot[7].Data.4>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU913G_DLOC
<DTP_CS07_EX1[114]>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G START PB FROM DCS A08PU913G_DSTR
<DTP_CS07_EX1[115]>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G STOP PB FROM DCS A08PU913G_DSTP
<DTP_CS07_EX1[116]>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G START/STOP PB A08PU913G_STR
<N06:O.Slot[11].Data.13>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G RUN FB A08PU913G_RUN
<N06:I.Slot[7].Data.4>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU913G_DLOC
<DTP_CS07_EX1[114]>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G START/STOP PB A08PU913G_STR
<N06:O.Slot[11].Data.13>

107

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G START/STOP PB A08PU913G_STR
<N06:O.Slot[11].Data.13>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913G START/STOP PB TO DCS A08PU913G_STR_PTD
<PTD_CS07_EX1[333]>

PU914AG

108

SODIC CONDENSATE PUMP PA-CF-914AG TRIP FB A08PU914AG_TRP
<N06:I.Slot[7].Data.6>

SODIC CONDENSATE PUMP PA-CF-914AG TRIP FB TO DCS A08PU914AG_TRP_PTD
<PTD_CS07_EX1[262]>

109
SODIC CONDENSATE PUMP PA-CF-914AG RUN FB
A08PU914AG_RUN
<N06:I.Slot[7].Data.7>
SODIC CONDENSATE PUMP PA-CF-914AG RUN FB TO DCS
A08PU914AG_RUN_PTD
<PTD_CS07_EX1[263]>

110
A08PU914AG_RDY
<N06:I.Slot[7].Data.8>
A08PU914AG_RDY_PTD
<PTD_CS07_EX1[264]>

111
SODIC CONDENSATE PUMP PA-CF-914AG LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU914AG_DLOC
<DTP_CS07_EX1[117]>
SODIC CONDENSATE PUMP PA-CF-914AG LOCAL/REMOTE SELECTOR SWITCH
A08PU914AG_LOC
<N06:O.Slot[12].Data.0>

112
SODIC CONDENSATE PUMP PA-CF-914AG LOCAL/REMOTE SELECTOR SWITCH
A08PU914AG_LOC
<N06:O.Slot[12].Data.0>
SODIC CONDENSATE PUMP PA-CF-914AG LOCAL/REMOTE SELECTOR SWITCH TO DCS
A08PU914AG_LOC_PTD
<PTD_CS07_EX1[336]>

113

A08PU914AG_RDY
<N06:I.Slot[7].Data.8>

SODIC CONDENSATE PUMP PA-CF-914AG TRIP FB
A08PU914AG_TRP
<N06:I.Slot[7].Data.6>

SODIC CONDENSATE PUMP PA-CF-914AG RUN FB
A08PU914AG_RUN
<N06:I.Slot[7].Data.7>

SODIC CONDENSATE PUMP PA-CF-914AG LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU914AG_DLOC
<DTP_CS07_EX1[117]>

SODIC CONDENSATE PUMP PA-CF-914AG START PB FROM DCS
A08PU914AG_DSTR
<DTP_CS07_EX1[118]>

SODIC CONDENSATE PUMP PA-CF-914AG STOP PB FROM DCS
A08PU914AG_DSTP
<DTP_CS07_EX1[119]>

SODIC CONDENSATE PUMP PA-CF-914AG START/STOP PB
A08PU914AG_STR
<N06:O.Slot[12].Data.1>

SODIC CONDENSATE PUMP PA-CF-914AG RUN FB
A08PU914AG_RUN
<N06:I.Slot[7].Data.7>

SODIC CONDENSATE PUMP PA-CF-914AG LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU914AG_DLOC
<DTP_CS07_EX1[117]>

SODIC CONDENSATE PUMP PA-CF-914AG START/STOP PB
A08PU914AG_STR
<N06:O.Slot[12].Data.1>

114

SODIC CONDENSATE PUMP PA-CF-914AG START/STOP PB
A08PU914AG_STR
<N06:O.Slot[12].Data.1>

SODIC CONDENSATE PUMP PA-CF-914AG START/STOP PB TO DCS
A08PU914AG_STR_PTD
<PTD_CS07_EX1[337]>

PU914BG

115

SODIC CONDENSATE PUMP PA-CF-914BG TRIP FB
A08PU914BG_TRP
<N06:I.Slot[7].Data.9>

SODIC CONDENSATE PUMP PA-CF-914BG TRIP FB TO DCS
A08PU914BG_TRP_PTD
<PTD_CS07_EX1[265]>

116

A08PU914BG_RUN
<N06:I.Slot[7].Data.10>

SODIC CONDENSATE PUMP PA-CF-914BG RUN FB TO DCS
A08PU914BG_RUN_PTD
<PTD_CS07_EX1[266]>

117
A08_PU914BG_RDY
<N06:I.Slot[7].Data.11>
A08PU914BG_RDY_PTD
<PTD_CS07_EX1[267]>

118
SODIC CONDENSATE PUMP PA-CF-914BG LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU914BG_DLOC
<DTP_CS07_EX1[120]>
SODIC CONDENSATE PUMP PA-CF-914BG LOCAL/REMOTE SELECTOR SWITCH
A08PU914BG_LOC
<N06:O.Slot[12].Data.2>

119
SODIC CONDENSATE PUMP PA-CF-914BG LOCAL/REMOTE SELECTOR SWITCH
A08PU914BG_LOC
<N06:O.Slot[12].Data.2>
SODIC CONDENSATE PUMP PA-CF-914BG LOCAL/REMOTE SELECTOR SWITCH TO DCS
A08PU914BG_LOC_PTD
<PTD_CS07_EX1[338]>

120
A08_PU914BG_RDY
<N06:I.Slot[7].Data.11>
A08PU914BG_RUN
<N06:I.Slot[7].Data.10>
SODIC CONDENSATE PUMP PA-CF-914BG TRIP FB
A08PU914BG_TRP
<N06:I.Slot[7].Data.9>
SODIC CONDENSATE PUMP PA-CF-914BG LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU914BG_DLOC
<DTP_CS07_EX1[120]>
SODIC CONDENSATE PUMP PA-CF-914BG START/STOP PB
A08PU914BG_STR
<N06:O.Slot[12].Data.3>
SODIC CONDENSATE PUMP PA-CF-914BG LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU914BG_DLOC
<DTP_CS07_EX1[120]>
SODIC CONDENSATE PUMP PA-CF-914BG START PB FROM DCS
A08PU914BG_DSTR
<DTP_CS07_EX1[121]>
A08PU914BG_RUN
<N06:I.Slot[7].Data.10>
SODIC CONDENSATE PUMP PA-CF-914BG STOP PB FROM DCS
A08PU914BG_DSTP
<DTP_CS07_EX1[122]>
SODIC CONDENSATE PUMP PA-CF-914BG START/STOP PB
A08PU914BG_STR
<N06:O.Slot[12].Data.3>

121
SODIC CONDENSATE PUMP PA-CF-914BG START/STOP PB
A08PU914BG_STR
<N06:O.Slot[12].Data.3>
SODIC CONDENSATE PUMP PA-CF-914BG START/STOP PB TO DCS
A08PU914BG_STR_PTD
<PTD_CS07_EX1[339]>

122
PU906G
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G READY TO START FB
A08PU906G_RDY
<N06:I.Slot[8].Data.2>
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G READY TO START FB TO DCS
A08PU906G_RDY_PTD
<PTD_CS07_EX1[274]>

123
A08PU906_LC_TRP_ROM_DCS
<DTP_CS07_EX1[311]>
A08PU906G_LC_TRP

124
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G TRIP FB A08PU906G_TRP
<N06:I.Slot[8].Data.0>
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G TRIP FB TO DCS A08PU906G_TRP_PTD
<PTD_CS07_EX1[272]>

125
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G RUN FB A08PU906G_RUN
<N06:I.Slot[8].Data.1>
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G RUN FB TO DCS A08PU906G_RUN_PTD
<PTD_CS07_EX1[273]>

126
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU906G_DLOC
<DTP_CS07_EX1[123]>
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G LOCAL/REMOTE SELECTOR SWITCH A08PU906G_LOC
<N06:O.Slot[12].Data.4>

127
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G LOCAL/REMOTE SELECTOR SWITCH A08PU906G_LOC
<N06:O.Slot[12].Data.4>
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU906G_LOC_PTD
<PTD_CS07_EX1[340]>

128

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G READY TO START FB A08PU906G_RDY <N06:I.Slot[8].Data.2>

A08PU906G_LC_TRP

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G TRIP FB A08PU906G_TRP <N06:I.Slot[8].Data.0>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G RUN FB A08PU906G_RUN <N06:I.Slot[8].Data.1>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU906G_DLOC <DTP_CS07_EX1[123]>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G START PB FROM DCS A08PU906G_DSTR <DTP_CS07_EX1[124]>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G STOP PB FROM DCS A08PU906G_DSTP <DTP_CS07_EX1[125]>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G START/STOP PB A08PU906G_STR <N06:O.Slot[12].Data.5>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G RUN FB A08PU906G_RUN <N06:I.Slot[8].Data.1>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU906G_DLOC <DTP_CS07_EX1[123]>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G START/STOP PB A08PU906G_STR <N06:O.Slot[12].Data.5>

129

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G START/STOP PB A08PU906G_STR <N06:O.Slot[12].Data.5>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906G START/STOP PB TO DCS A08PU906G_STR_PTD <PTD_CS07_EX1[341]>

PU915G

130

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G TRIP FB A08PU915G_TRP <N06:I.Slot[8].Data.3>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G TRIP FB TO DCS A08PU915G_TRP_PTD <PTD_CS07_EX1[275]>

131
JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G RUN FB A08PU915G_RUN <N06:I.Slot[8].Data.4>
JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G RUN FB TO DCS A08PU915G_RUN_PTD <PTD_CS07_EX1[276]>

132
A08PU915G_RDY <N06:I.Slot[8].Data.5>
A08PU915G_RDY_PTD <PTD_CS07_EX1[277]>

133
JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU915G_DLOC <DTP_CS07_EX1[126]>
JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G LOCAL/REMOTE SELECTOR SWITCH A08PU915G_LOC <N06:O.Slot[12].Data.6>

134
JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G LOCAL/REMOTE SELECTOR SWITCH A08PU915G_LOC <N06:O.Slot[12].Data.6>
JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU915G_LOC_PTD <PTD_CS07_EX1[342]>

135

A08PU915G_RDY
<N06:I.Slot[8].Data.5>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G TRIP FB A08PU915G_TRP
<N06:I.Slot[8].Data.3>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G RUN FB A08PU915G_RUN
<N06:I.Slot[8].Data.4>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU915G_DLOC
<DTP_CS07_EX1[126]>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G START PB FROM DCS A08PU915G_DSTR
<DTP_CS07_EX1[127]>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G STOP PB FROM DCS A08PU915G_DSTP
<DTP_CS07_EX1[128]>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G START/STOP PB A08PU915G_STR
<N06:O.Slot[12].Data.7>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G RUN FB A08PU915G_RUN
<N06:I.Slot[8].Data.4>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU915G_DLOC
<DTP_CS07_EX1[126]>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G START/STOP PB A08PU915G_STR
<N06:O.Slot[12].Data.7>

136

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G START/STOP PB A08PU915G_STR
<N06:O.Slot[12].Data.7>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915G START/STOP PB TO DCS A08PU915G_STR_PTD
<PTD_CS07_EX1[343]>

PU916AG

137

COOLING WATER PUMP PA-CF-916AG TRIP FB A08PU916AG_TRP
<N06:I.Slot[8].Data.6>

COOLING WATER PUMP PA-CF-916AG TRIP FB TO DCS A08PU916AG_TRP_PTD
<PTD_CS07_EX1[278]>

138
COOLING WATER PUMP PA-CF-916AG RUN FB A08PU916AG_RUN <N06:I.Slot[8].Data.7>
COOLING WATER PUMP PA-CF-916AG RUN FB TO DCS A08PU916AG_RUN_PTD <PTD_CS07_EX1[279]>

139
A08PU916AG_RDY <N06:I.Slot[8].Data.8>
A08PU916AG_RDY_PTD <PTD_CS07_EX1[280]>

140
COOLING WATER PUMP PA-CF-916AG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU916AG_DLOC <DTP_CS07_EX1[129]>
COOLING WATER PUMP PA-CF-916AG LOCAL/REMOTE SELECTOR SWITCH A08PU916AG_LOC <N06:O.Slot[12].Data.8>

141
COOLING WATER PUMP PA-CF-916AG LOCAL/REMOTE SELECTOR SWITCH A08PU916AG_LOC <N06:O.Slot[12].Data.8>
COOLING WATER PUMP PA-CF-916AG LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU916AG_LOC_PTD <PTD_CS07_EX1[344]>

142

A08PU916AG_RDY
<N06:I.Slot[8].Data.8>

COOLING WATER PUMP
PA-CF-916AG TRIP FB
A08PU916AG_TRP
<N06:I.Slot[8].Data.6>

COOLING WATER PUMP
PA-CF-916AG RUN FB
A08PU916AG_RUN
<N06:I.Slot[8].Data.7>

COOLING WATER PUMP
PA-CF-916AG
LOCAL/REMOTE
SELECTOR SWITCH FROM
DCS
A08PU916AG_DLOC
<DTP_CS07_EX1[129]>

COOLING WATER PUMP
PA-CF-916AG START PB
FROM DCS
A08PU916AG_DSTR
<DTP_CS07_EX1[130]>

COOLING WATER PUMP
PA-CF-916AG STOP PB
FROM DCS
A08PU916AG_DSTP
<DTP_CS07_EX1[131]>

COOLING WATER PUMP
PA-CF-916AG
START/STOP PB
A08PU916AG_STR
<N06:O.Slot[12].Data.9>

COOLING WATER PUMP
PA-CF-916AG RUN FB
A08PU916AG_RUN
<N06:I.Slot[8].Data.7>

COOLING WATER PUMP
PA-CF-916AG
LOCAL/REMOTE
SELECTOR SWITCH FROM
DCS
A08PU916AG_DLOC
<DTP_CS07_EX1[129]>

COOLING WATER PUMP
PA-CF-916AG
START/STOP PB
A08PU916AG_STR
<N06:O.Slot[12].Data.9>

143

COOLING WATER PUMP
PA-CF-916AG
START/STOP PB
A08PU916AG_STR
<N06:O.Slot[12].Data.9>

COOLING WATER PUMP
PA-CF-916AG
START/STOP PB TO DCS
A08PU916AG_STR_PTD
<PTD_CS07_EX1[345]>

PU916BG

144

COOLING WATER PUMP
PA-CF-916BG TRIP FB
A08PU916BG_TRP
<N06:I.Slot[8].Data.9>

COOLING WATER PUMP
PA-CF-916BG TRIP FB
TO DCS
A08PU916BG_TRP_PTD
<PTD_CS07_EX1[281]>

145

COOLING WATER PUMP
PA-CF-916BG RUN FB
A08PU916BG_RUN
<N06:I.Slot[8].Data.10>

COOLING WATER PUMP
PA-CF-916BG RUN FB
TO DCS
A08PU916BG_RUN_PTD
<PTD_CS07_EX1[282]>

146

A08PU916BG_RDY
<N06:I.Slot[8].Data.11>

A08PU916BG_RDY_PTD
<PTD_CS07_EX1[283]>

147
COOLING WATER PUMP PA-CF-916BG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU916BG_DLOC <DTP_CS07_EX1[132]> /
COOLING WATER PUMP PA-CF-916BG LOCAL/REMOTE SELECTOR SWITCH A08PU916BG_LOC <N06:O.Slot[12].Data.10>

148
COOLING WATER PUMP PA-CF-916BG LOCAL/REMOTE SELECTOR SWITCH A08PU916BG_LOC <N06:O.Slot[12].Data.10>
COOLING WATER PUMP PA-CF-916BG LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU916BG_LOC_PTD <PTD_CS07_EX1[346]>

149
A08PU916BG_RDY <N06:I.Slot[8].Data.11>
COOLING WATER PUMP PA-CF-916BG TRIP FB A08PU916BG_TRP <N06:I.Slot[8].Data.9> /
COOLING WATER PUMP PA-CF-916BG RUN FB A08PU916BG_RUN <N06:I.Slot[8].Data.10>
COOLING WATER PUMP PA-CF-916BG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU916BG_DLOC <DTP_CS07_EX1[132]> /
COOLING WATER PUMP PA-CF-916BG START PB FROM DCS A08PU916BG_DSTR <DTP_CS07_EX1[133]>
COOLING WATER PUMP PA-CF-916BG STOP PB FROM DCS A08PU916BG_DSTP <DTP_CS07_EX1[134]> /
COOLING WATER PUMP PA-CF-916BG START/STOP PB A08PU916BG_STR <N06:O.Slot[12].Data.11>
COOLING WATER PUMP PA-CF-916BG RUN FB A08PU916BG_RUN <N06:I.Slot[8].Data.10>
COOLING WATER PUMP PA-CF-916BG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU916BG_DLOC <DTP_CS07_EX1[132]>
COOLING WATER PUMP PA-CF-916BG START/STOP PB A08PU916BG_STR <N06:O.Slot[12].Data.11>

150
COOLING WATER PUMP PA-CF-916BG START/STOP PB A08PU916BG_STR <N06:O.Slot[12].Data.11>
COOLING WATER PUMP PA-CF-916BG START/STOP PB TO DCS A08PU916BG_STR_PTD <PTD_CS07_EX1[347]>

PU916CG

151
COOLING WATER PUMP PA-CF-916CG TRIP FB A08PU916CG_TRP <N06:I.Slot[9].Data.0>
COOLING WATER PUMP PA-CF-916CG TRIP FB TO DCS A08PU916CG_TRP_PTD <PTD_CS07_EX1[288]>

152
COOLING WATER PUMP PA-CF-916CG RUN FB A08PU916CG_RUN <N06:I.Slot[9].Data.1>
COOLING WATER PUMP PA-CF-916CG RUN FB TO DCS A08PU916CG_RUN_PTD <PTD_CS07_EX1[289]>

153
A08PU916CG_RDY <N06:I.Slot[9].Data.2>
A08PU916CG_RDY_PTD <PTD_CS07_EX1[290]>

154
COOLING WATER PUMP PA-CF-916CG LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU916CG_DLOC <DTP_CS07_EX1[135]>
COOLING WATER PUMP PA-CF-916CG LOCAL/REMOTE SELECTOR SWITCH A08PU916CG_LOC <N06:O.Slot[12].Data.12>

155
COOLING WATER PUMP PA-CF-916CG LOCAL/REMOTE SELECTOR SWITCH A08PU916CG_LOC <N06:O.Slot[12].Data.12>
COOLING WATER PUMP PA-CF-916CG LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU916CG_LOC_PTD <PTD_CS07_EX1[348]>

156

A08PU916CG_RDY
<N06:I.Slot[9].Data.2>

COOLING WATER PUMP
PA-CF-916CG TRIP FB
A08PU916CG_TRP
<N06:I.Slot[9].Data.0>

COOLING WATER PUMP
PA-CF-916CG RUN FB
A08PU916CG_RUN
<N06:I.Slot[9].Data.1>

COOLING WATER PUMP
PA-CF-916CG
LOCAL/REMOTE
SELECTOR SWITCH FROM
DCS
A08PU916CG_DLOC
<DTP_CS07_EX1[135]>

COOLING WATER PUMP
PA-CF-916CG START PB
FROM DCS
A08PU916CG_DSTR
<DTP_CS07_EX1[136]>

COOLING WATER PUMP
PA-CF-916CG STOP PB
FROM DCS
A08PU916CG_DSTP
<DTP_CS07_EX1[137]>

COOLING WATER PUMP
PA-CF-916CG
START/STOP PB
A08PU916CG_STR
<N06:O.Slot[12].Data.13>

COOLING WATER PUMP
PA-CF-916CG RUN FB
A08PU916CG_RUN
<N06:I.Slot[9].Data.1>

COOLING WATER PUMP
PA-CF-916CG
LOCAL/REMOTE
SELECTOR SWITCH FROM
DCS
A08PU916CG_DLOC
<DTP_CS07_EX1[135]>

COOLING WATER PUMP
PA-CF-916CG
START/STOP PB
A08PU916CG_STR
<N06:O.Slot[12].Data.13>

157

COOLING WATER PUMP
PA-CF-916CG
START/STOP PB
A08PU916CG_STR
<N06:O.Slot[12].Data.13>

COOLING WATER PUMP
PA-CF-916CG
START/STOP PB TO DCS
A08PU916CG_STR_PTD
<PTD_CS07_EX1[349]>

PU918G

158

ACID RETURN PUMP
PA-CF-918G READY TO
START FB
A08PU918G_RDY
<N06:I.Slot[9].Data.5>

ACID RETURN PUMP
PA-CF-918G READY TO
START FB TO DCS
A08PU918G_RDY_PTD
<PTD_CS07_EX1[293]>

159

ACID RETURN PUMP
PA-CF-918G TRIP FB
A08PU918G_TRP
<N06:I.Slot[9].Data.3>

ACID RETURN PUMP
PA-CF-918G TRIP FB
TO DCS
A08PU918G_TRP_PTD
<PTD_CS07_EX1[291]>

160
ACID RETURN PUMP PA-CF-918G RUN FB A08PU918G_RUN <N06:I.Slot[9].Data.4>
ACID RETURN PUMP PA-CF-918G RUN FB TO DCS A08PU918G_RUN_PTD <PTD_CS07_EX1[292]>

161
ACID RETURN PUMP PA-CF-918G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU918G_DLOC <DTP_CS07_EX1[138]> /
ACID RETURN PUMP PA-CF-918G LOCAL/REMOTE SELECTOR SWITCH A08PU918G_LOC <N06:O.Slot[13].Data.0>

162
ACID RETURN PUMP PA-CF-918G LOCAL/REMOTE SELECTOR SWITCH A08PU918G_LOC <N06:O.Slot[13].Data.0>
ACID RETURN PUMP PA-CF-918G LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU918G_LOC_PTD <PTD_CS07_EX1[352]>

163
ACID RETURN PUMP PA-CF-918G READY TO START FB A08PU918G_RDY <N06:I.Slot[9].Data.5>
ACID RETURN PUMP PA-CF-918G TRIP FB A08PU918G_TRP <N06:I.Slot[9].Data.3> /
ACID RETURN PUMP PA-CF-918G RUN FB A08PU918G_RUN <N06:I.Slot[9].Data.4>
ACID RETURN PUMP PA-CF-918G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU918G_DLOC <DTP_CS07_EX1[138]> /
ACID RETURN PUMP PA-CF-918G START PB FROM DCS A08PU918G_DSTR <DTP_CS07_EX1[139]>
ACID RETURN PUMP PA-CF-918G STOP PB FROM DCS A08PU918G_DSTP <DTP_CS07_EX1[140]> /
ACID RETURN PUMP PA-CF-918G START/STOP PB A08PU918G_STR <N06:O.Slot[13].Data.1>
ACID RETURN PUMP PA-CF-918G RUN FB A08PU918G_RUN <N06:I.Slot[9].Data.4>
ACID RETURN PUMP PA-CF-918G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU918G_DLOC <DTP_CS07_EX1[138]>
ACID RETURN PUMP PA-CF-918G START/STOP PB A08PU918G_STR <N06:O.Slot[13].Data.1>

164
ACID RETURN PUMP PA-CF-918G START/STOP PB A08PU918G_STR <N06:O.Slot[13].Data.1>
ACID RETURN PUMP PA-CF-918G START/STOP PB TO DCS A08PU918G_STR_PTD <PTD_CS07_EX1[353]>

SOV-901BG

165
SPARE N09S9C6 <N09:O.Slot[9].Data.6>
SPARE TO DCS N09S9C6_PTD <PTD_CS07_EX2[454]>

166
SPARE N09S9C7 <N09:O.Slot[9].Data.7>
SPARE TO DCS N09S9C7_PTD <PTD_CS07_EX2[455]>

SOV-901AG

167
SPARE N09S9C8 <N09:O.Slot[9].Data.8>
SPARE TO DCS N09S9C8_PTD <PTD_CS07_EX2[456]>

168
SPARE N09S9C9 <N09:O.Slot[9].Data.9>
SPARE TO DCS N09S9C9_PTD <PTD_CS07_EX2[457]>

SOV-902BG

169
SPARE N09S9C10 <N09:O.Slot[9].Data.10>
SPARE TO DCS N09S9C10_PTD <PTD_CS07_EX2[458]>

170
SPARE N09S9C11 <N09:O.Slot[9].Data.11>
SPARE TO DCS N09S9C11_PTD <PTD_CS07_EX2[459]>

SOV-902AG

171
SPARE N10S10C0 <N10:O.Slot[10].Data.0>
SPARE TO DCS N10S10C0_PTD <PTD_CS07_EX3[176]>

172
SPARE N10S10C1 <N10:O.Slot[10].Data.1>
SPARE TO DCS N10S10C1_PTD <PTD_CS07_EX3[177]>

SOV-922AG

173
SPARE N10S10C2 <N10:O.Slot[10].Data.2>
SPARE TO DCS N10S10C2_PTD <PTD_CS07_EX3[178]>

174
SPARE N10S10C3 <N10:O.Slot[10].Data.3>
SPARE TO DCS N10S10C3_PTD <PTD_CS07_EX3[179]>

SOV-922BG

175
SPARE
N10S10C4
<N10:O.Slot[10].Data.4>
SPARE TO DCS
N10S10C4_PTD
<PTD_CS07_EX3[180]>

176
SPARE
N10S10C5
<N10:O.Slot[10].Data.5>
SPARE TO DCS
N10S10C5_PTD
<PTD_CS07_EX3[181]>

SOV-903G

177
SPARE
N10S10C6
<N10:O.Slot[10].Data.6>
SPARE TO DCS
N10S10C6_PTD
<PTD_CS07_EX3[182]>

178
SPARE
N10S10C7
<N10:O.Slot[10].Data.7>
SPARE TO DCS
N10S10C7_PTD
<PTD_CS07_EX3[183]>

179
SPARE
N10S10C8
<N10:O.Slot[10].Data.8>
14400 SEC TIMER
TON
Timer On Delay
Timer TM_08KS903G
Preset 14400000
Accum 0
EN
DN

SOV-919G

180
SPARE
N10S10C9
<N10:O.Slot[10].Data.9>
SPARE TO DCS
N10S10C9_PTD
<PTD_CS07_EX3[185]>

181
SPARE
N10S10C10
<N10:O.Slot[10].Data.10>
SPARE TO DCS
N10S10C10_PTD
<PTD_CS07_EX3[186]>

182
SPARE
N10S10C11
<N10:O.Slot[10].Data.11>
300 SEC TIMER
TON
Timer On Delay
Timer TM_KS919G
Preset 300000
Accum 0
EN
DN

PU919G

183
SUMP PUMP PUMP
PA-CF-919G READY TO
START FB
A08PU919G_RDY
<N06:I.Slot[9].Data.8>
SUMP PUMP PUMP
PA-CF-919G READY TO
START FB TO DCS
A08PU919G_RDY_PTD
<PTD_CS07_EX1[296]>

184
SUMP PUMP PUMP
PA-CF-919G TRIP FB
A08PU919G_TRP
<N06:I.Slot[9].Data.6>
SUMP PUMP PUMP
PA-CF-919G TRIP FB
TO DCS
A08PU919G_TRP_PTD
<PTD_CS07_EX1[294]>

185
SUMP PUMP PUMP PA-CF-919G RUN FB A08PU919G_RUN <N06:I.Slot[9].Data.7>
SUMP PUMP PUMP PA-CF-919G RUN FB TO DCS A08PU919G_RUN_PTD <PTD_CS07_EX1[295]>

186
A04PU919G AUTO SELECTED FROM DCS AM_PU919G_DTP <DTP_CS07_EX1[256]>
SUMP PUMP PUMP PA-CF-919G LOCAL/REMOTE SELECTOR SWITCH A08PU919G_LOC <N06:O.Slot[13].Data.2>
A04PU919G AUTO SELECTED FROM DCS AM_PU919G_DTP <DTP_CS07_EX1[256]> /
SUMP PUMP PUMP PA-CF-919G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU919G_DLOC <DTP_CS07_EX1[141]> /

187
SUMP PUMP PUMP PA-CF-919G LOCAL/REMOTE SELECTOR SWITCH A08PU919G_LOC <N06:O.Slot[13].Data.2>
SUMP PUMP PUMP PA-CF-919G LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU919G_LOC_PTD <PTD_CS07_EX1[354]>

188
LEVEL HIGH SWITCH ON TANK AFRM AREA SUMP TV-FB-922G A08_LAH_919G <N11:I.Slot[2].Data.0>
LEVEL HIGH SWITCH ON TANK AFRM AREA SUMP TV-FB-922G TO DCS A08_LAH_904G_PTD <PTD_CS07_EX3[304]>

189
LEVEL LOW SWITCH ON TANK AFRM AREA SUMP TV-FB-922G A08_LAL_904G <N11:I.Slot[2].Data.1>
LEVEL LOW SWITCH ON TANK AFRM AREA SUMP TV-FB-922G TO DCS A08_LAL_904G_PTD <PTD_CS07_EX3[305]>

190

SUMP PUMP PUMP PA-CF-919G READY TO START FB A08PU919G_RDY <N06:I.Slot[9].Data.8>

SUMP PUMP PUMP PA-CF-919G TRIP FB A08PU919G_TRP <N06:I.Slot[9].Data.6>

A04PU919G AUTO SELECTED FROM DCS AM_PU919G_DTP <DTP_CS07_EX1[256]>

SUMP PUMP PUMP PA-CF-919G START PB FROM DCS A08PU919G_DSTR <DTP_CS07_EX1[142]>

SUMP PUMP PUMP PA-CF-919G RUN FB A08PU919G_RUN <N06:I.Slot[9].Data.7>

SUMP PUMP PUMP PA-CF-919G START/STOP PB A08PU919G_STR <N06:O.Slot[13].Data.3>

SUMP PUMP PUMP PA-CF-919G RUN FB A08PU919G_RUN <N06:I.Slot[9].Data.7>

SUMP PUMP PUMP PA-CF-919G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU919G_DLOC <DTP_CS07_EX1[141]>

A04PU919G AUTO SELECTED FROM DCS AM_PU919G_DTP <DTP_CS07_EX1[256]>

LEVEL HIGH SWITCH ON TANK AFRM AREA SUMP TV-FB-922G A08_LAH_919G <N11:I.Slot[2].Data.0>

SUMP PUMP PUMP PA-CF-919G RUN FB A08PU919G_RUN <N06:I.Slot[9].Data.7>

LEVEL LOW SWITCH ON TANK AFRM AREA SUMP TV-FB-922G A08_LAL_904G <N11:I.Slot[2].Data.1>

TIMER_PU919G.DN

SUMP PUMP PUMP PA-CF-919G STOP PB FROM DCS A08PU919G_DSTP <DTP_CS07_EX1[143]>

SUMP PUMP PUMP PA-CF-919G START/STOP PB A08PU919G_STR <N06:O.Slot[13].Data.3>

191

SUMP PUMP PUMP PA-CF-919G START/STOP PB A08PU919G_STR <N06:O.Slot[13].Data.3>

LEVEL HIGH SWITCH ON TANK AFRM AREA SUMP TV-FB-922G A08_LAH_919G <N11:I.Slot[2].Data.0>

TON
Timer On Delay
Timer TIMER_PU919G
Preset 180000
Accum 0
EN
DN

192

SUMP PUMP PUMP PA-CF-919G START/STOP PB A08PU919G_STR <N06:O.Slot[13].Data.3>

SUMP PUMP PUMP PA-CF-919G START/STOP PB TO DCS A08PU919G_STR_PTD <PTD_CS07_EX1[355]>

MV901G

193

08-MV-901G OPEN PB A08MV901G_OP <N06:O.Slot[13].Data.6>

08-MV-901G OPEN PB TO DCS A08MV901G_OP_PTD <PTD_CS07_EX1[358]>

194
08-MV-901G CLOSE PB
A08MV901G_CL
<N06:O.Slot[13].Data.7>
08-MV-901G CLOSE PB
TO DCS
A08MV901G_CL_PTD
<PTD_CS07_EX1[359]>

195
08-MV-901G LOCAL /
REMOTE SELECTOR
SWITCH FROM DCS
A08MV901G_DLOC
<DTP_CS07_EX1[149]>
08-MV-901G LOCAL /
REMOTE SELECTOR
SWITCH
A08MV901G_LOC
<N06:O.Slot[13].Data.8>

196
08-MV-901G LOCAL /
REMOTE SELECTOR
SWITCH
A08MV901G_LOC
<N06:O.Slot[13].Data.8>
08-MV-901G LOCAL /
REMOTE SELECTOR
SWITCH TO DCS
A08MV901G_LOC_PTD
<PTD_CS07_EX1[360]>

197
08-MV-901G LOCAL /
REMOTE SELECTOR
SWITCH FROM DCS
A08MV901G_DLOC
<DTP_CS07_EX1[149]>
08-MV-901G OPEN PB
FROM DCS
A08MV901G_DOPN
<DTP_CS07_EX1[147]>
08-MV-901G CLOSE PB
FROM DCS
A08MV901G_DCLS
<DTP_CS07_EX1[148]>
08-MV-901G OPEN PB
A08MV901G_OP
<N06:O.Slot[13].Data.6>
08-MV-901G OPEN PB
A08MV901G_OP
<N06:O.Slot[13].Data.6>
08-MV-901G OPEN PB
TO DCS
A08MV901G_OP_PTD
<PTD_CS07_EX1[358]>
08-MV-901G LOCAL /
REMOTE SELECTOR
SWITCH FROM DCS
A08MV901G_DLOC
<DTP_CS07_EX1[149]>

198
08-MV-901G LOCAL /
REMOTE SELECTOR
SWITCH FROM DCS
A08MV901G_DLOC
<DTP_CS07_EX1[149]>
08-MV-901G CLOSE PB
FROM DCS
A08MV901G_DCLS
<DTP_CS07_EX1[148]>
08-MV-901G OPEN PB
FROM DCS
A08MV901G_DOPN
<DTP_CS07_EX1[147]>
08TAHH930G
A08_TAHH_930G
<N11:I.Slot[2].Data.8>
08-MV-901G CLOSE PB
A08MV901G_CL
<N06:O.Slot[13].Data.7>
08-MV-901G CLOSE PB
TO DCS
A08MV901G_CL_PTD
<PTD_CS07_EX1[359]>
08-MV-901G LOCAL /
REMOTE SELECTOR
SWITCH FROM DCS
A08MV901G_DLOC
<DTP_CS07_EX1[149]>
08-MV-901G CLOSE PB
A08MV901G_CL
<N06:O.Slot[13].Data.7>

199
A08PUG901G_RDY
<N06:I.Slot[9].Data.11>
A08PUG901G_RDY_PTD
<PTD_CS07_EX1[299]>

200
SUMP AGITATOR PUMP TM-00-901G TRIP FB A08PUG901G_TRP <N06:I.Slot[9].Data.9>
SUMP AGITATOR PUMP TM-00-901G TRIP FB TO DCS A08PUG901G_TRP_PTD <PTD_CS07_EX1[297]>

201
SUMP AGITATOR PUMP TM-00-901G RUN FB A08PUG901G_RUN <N06:I.Slot[9].Data.10>
SUMP AGITATOR PUMP TM-00-901G RUN FB TO DCS A08PUG901G_RUN_PTD <PTD_CS07_EX1[298]>

202
SUMP AGITATOR PUMP TM-00-901G LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PUG901G_DLOC <DTP_CS07_EX1[144]>
SUMP AGITATOR PUMP TM-00-901G LOCAL/REMOTE SELECTOR SWITCH A08PUG901G_LOC <N06:O.Slot[13].Data.4>

203
SUMP AGITATOR PUMP TM-00-901G LOCAL/REMOTE SELECTOR SWITCH A08PUG901G_LOC <N06:O.Slot[13].Data.4>
SUMP AGITATOR PUMP TM-00-901G LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PUG901G_LOC_PTD <PTD_CS07_EX1[356]>

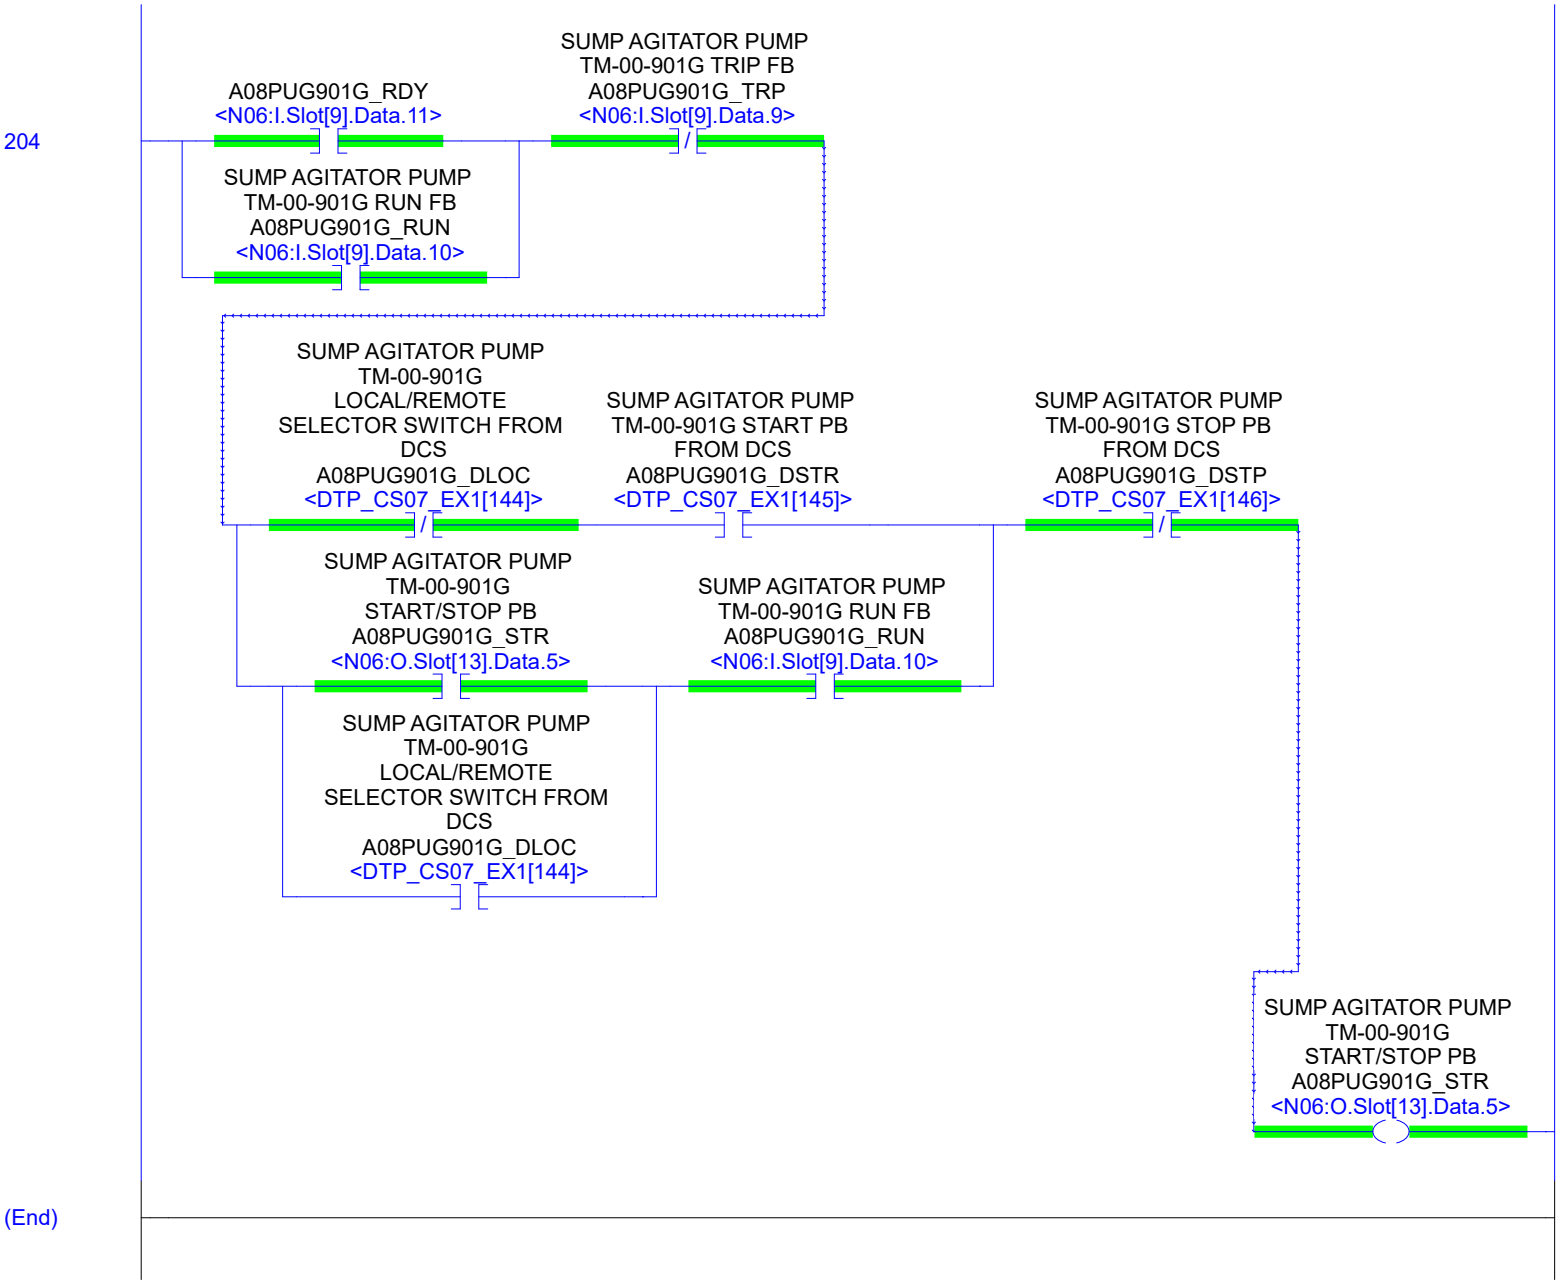
204
A08PUG901G_RDY
<N06:I.Slot[9].Data.11>
SUMP AGITATOR PUMP
TM-00-901G TRIP FB
A08PUG901G_TRP
<N06:I.Slot[9].Data.9>
SUMP AGITATOR PUMP
TM-00-901G RUN FB
A08PUG901G_RUN
<N06:I.Slot[9].Data.10>
SUMP AGITATOR PUMP
TM-00-901G
LOCAL/REMOTE
SELECTOR SWITCH FROM
DCS
A08PUG901G_DLOC
<DTP_CS07_EX1[144]>
SUMP AGITATOR PUMP
TM-00-901G START PB
FROM DCS
A08PUG901G_DSTR
<DTP_CS07_EX1[145]>
SUMP AGITATOR PUMP
TM-00-901G STOP PB
FROM DCS
A08PUG901G_DSTP
<DTP_CS07_EX1[146]>
SUMP AGITATOR PUMP
TM-00-901G
START/STOP PB
A08PUG901G_STR
<N06:O.Slot[13].Data.5>
SUMP AGITATOR PUMP
TM-00-901G RUN FB
A08PUG901G_RUN
<N06:I.Slot[9].Data.10>
SUMP AGITATOR PUMP
TM-00-901G
LOCAL/REMOTE
SELECTOR SWITCH FROM
DCS
A08PUG901G_DLOC
<DTP_CS07_EX1[144]>
SUMP AGITATOR PUMP
TM-00-901G
START/STOP PB
A08PUG901G_STR
<N06:O.Slot[13].Data.5>
(End)