PU901H

0
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H READY TO START FB A08PU901H_RDY
<N05:I.Slot[3].Data.2>
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H READY TO START FB TO DCS A08PU901H_RDY_PTD
<PTD_CS07_EX1[2]>

1
A08PU901H_LC_TRIP_FROM_DCS
<DTP_CS07_EX1[313]>
A08PU901H_LC_TRIP

2
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H TRIP FB A08PU901H_TRP
<N05:I.Slot[3].Data.0>
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H TRIP FB TO DCS A08PU901H_TRP_PTD
<PTD_CS07_EX1[0]>

3
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H RUN FB A08PU901H_RUN
<N05:I.Slot[3].Data.1>
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H RUN FB TO DCS A08PU901H_RUN_PTD
<PTD_CS07_EX1[1]>

4
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU901H_DLOC
<DTP_CS07_EX1[0]>
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H LOCAL/REMOTE SELECTOR SWITCH A08PU901H_LOC
<N05:O.Slot[10].Data.0>

5
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H LOCAL/REMOTE SELECTOR SWITCH A08PU901H_LOC
<N05:O.Slot[10].Data.0>
JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU901H_LOC_PTD
<PTD_CS07_EX1[112]>

6

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H READY TO START FB A08PU901H_RDY <N05:I.Slot[3].Data.2>

A08PU901H_LC_TRIP

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H TRIP FB A08PU901H_TRP <N05:I.Slot[3].Data.0>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H RUN FB A08PU901H_RUN <N05:I.Slot[3].Data.1>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU901H_DLOC <DTP_CS07_EX1[0]>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H START PB FROM DCS A08PU901H_DSTR <DTP_CS07_EX1[1]>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H STOP PB FROM DCS A08PU901H_DSTP <DTP_CS07_EX1[2]>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H START/STOP PB A08PU901H_STR <N05:O.Slot[10].Data.1>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H RUN FB A08PU901H_RUN <N05:I.Slot[3].Data.1>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU901H_DLOC <DTP_CS07_EX1[0]>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H START/STOP PB A08PU901H_STR <N05:O.Slot[10].Data.1>

7

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H START/STOP PB A08PU901H_STR <N05:O.Slot[10].Data.1>

JE-FF-901 1st EFFECT CIRCULATION PUMP PA-CF-901H START/STOP PB TO DCS A08PU901H_STR_PTD <PTD_CS07_EX1[113]>

8

PU907AH

STEAM CONDENSATE PUMP PA-CF-907AH READY TO START FB A08PU907AH_RDY <N05:I.Slot[3].Data.5>

STEAM CONDENSATE PUMP PA-CF-907AH READY TO START FB TO DCS A08PU907AH_RDY_PTD <PTD_CS07_EX1[5]>

9
STEAM CONDENSATE PUMP PA-CF-907AH TRIP FB A08PU907AH_TRP <N05:I.Slot[3].Data.3>
STEAM CONDENSATE PUMP PA-CF-907AH TRIP FB TO DCS A08PU907AH_TRP_PTD <PTD_CS07_EX1[3]>

10
STEAM CONDENSATE PUMP PA-CF-907AH RUN FB A08PU907AH_RUN <N05:I.Slot[3].Data.4>
STEAM CONDENSATE PUMP PA-CF-907AH RUN FB TO DCS A08PU907AH_RUN_PTD <PTD_CS07_EX1[4]>

11
STEAM CONDENSATE PUMP PA-CF-907AH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU907AH_DLOC <DTP_CS07_EX1[3]>
STEAM CONDENSATE PUMP PA-CF-907AH LOCAL/REMOTE SELECTOR SWITCH A08PU907AH_LOC <N05:O.Slot[10].Data.2>

12
STEAM CONDENSATE PUMP PA-CF-907AH LOCAL/REMOTE SELECTOR SWITCH A08PU907AH_LOC <N05:O.Slot[10].Data.2>
STEAM CONDENSATE PUMP PA-CF-907AH LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU907AH_LOC_PTD <PTD_CS07_EX1[114]>

13

STEAM CONDENSATE PUMP PA-CF-907AH READY TO START FB A08PU907AH_RDY <N05:I.Slot[3].Data.5>

STEAM CONDENSATE PUMP PA-CF-907AH TRIP FB A08PU907AH_TRP <N05:I.Slot[3].Data.3>

STEAM CONDENSATE PUMP PA-CF-907AH RUN FB A08PU907AH_RUN <N05:I.Slot[3].Data.4>

STEAM CONDENSATE PUMP PA-CF-907AH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU907AH_DLOC <DTP_CS07_EX1[3]>

STEAM CONDENSATE PUMP PA-CF-907AH START PB FROM DCS A08PU907AH_DSTR <DTP_CS07_EX1[4]>

STEAM CONDENSATE PUMP PA-CF-907AH STOP PB FROM DCS A08PU907AH_DSTP <DTP_CS07_EX1[5]>

STEAM CONDENSATE PUMP PA-CF-907AH START/STOP PB A08PU907AH_STR <N05:O.Slot[10].Data.3>

STEAM CONDENSATE PUMP PA-CF-907AH RUN FB A08PU907AH_RUN <N05:I.Slot[3].Data.4>

STEAM CONDENSATE PUMP PA-CF-907AH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU907AH_DLOC <DTP_CS07_EX1[3]>

STEAM CONDENSATE PUMP PA-CF-907AH START/STOP PB A08PU907AH_STR <N05:O.Slot[10].Data.3>

14

STEAM CONDENSATE PUMP PA-CF-907AH START/STOP PB A08PU907AH_STR <N05:O.Slot[10].Data.3>

STEAM CONDENSATE PUMP PA-CF-907AH START/STOP PB TO DCS A08PU907AH_STR_PTD <PTD_CS07_EX1[115]>

PU907BH

15

STEAM CONDENSATE PUMP PA-CF-907BH READY TO START FB A08PU907BH_RDY <N05:I.Slot[3].Data.8>

STEAM CONDENSATE PUMP PA-CF-907BH READY TO START FB TO DCS A08PU907BH_RDY_PTD <PTD_CS07_EX1[8]>

16

STEAM CONDENSATE PUMP PA-CF-907BH TRIP FB A08PU907BH_TRP <N05:I.Slot[3].Data.6>

STEAM CONDENSATE PUMP PA-CF-907BH TRIP FB TO DCS A08PU907BH_TRP_PTD <PTD_CS07_EX1[6]>

17
STEAM CONDENSATE PUMP PA-CF-907BH RUN FB A08PU907BH_RUN <N05:I.Slot[3].Data.7>
STEAM CONDENSATE PUMP PA-CF-907BH RUN FB TO DCS A08PU907BH_RUN_PTD <PTD_CS07_EX1[7]>

18
STEAM CONDENSATE PUMP PA-CF-907BH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU907BH_DLOC <DTP_CS07_EX1[6]> /
STEAM CONDENSATE PUMP PA-CF-907BH LOCAL/REMOTE SELECTOR SWITCH A08PU907BH_LOC <N05:O.Slot[10].Data.4>

19
STEAM CONDENSATE PUMP PA-CF-907BH LOCAL/REMOTE SELECTOR SWITCH A08PU907BH_LOC <N05:O.Slot[10].Data.4>
STEAM CONDENSATE PUMP PA-CF-907BH LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU907BH_LOC_PTD <PTD_CS07_EX1[116]>

20
STEAM CONDENSATE PUMP PA-CF-907BH READY TO START FB A08PU907BH_RDY <N05:I.Slot[3].Data.8>
STEAM CONDENSATE PUMP PA-CF-907BH TRIP FB A08PU907BH_TRP <N05:I.Slot[3].Data.6> /
STEAM CONDENSATE PUMP PA-CF-907BH RUN FB A08PU907BH_RUN <N05:I.Slot[3].Data.7>
STEAM CONDENSATE PUMP PA-CF-907BH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU907BH_DLOC <DTP_CS07_EX1[6]> /
STEAM CONDENSATE PUMP PA-CF-907BH START PB FROM DCS A08PU907BH_DSTR <DTP_CS07_EX1[7]>
STEAM CONDENSATE PUMP PA-CF-907BH STOP PB FROM DCS A08PU907BH_DSTP <DTP_CS07_EX1[8]> /
STEAM CONDENSATE PUMP PA-CF-907BH START/STOP PB A08PU907BH_STR <N05:O.Slot[10].Data.5>
STEAM CONDENSATE PUMP PA-CF-907BH RUN FB A08PU907BH_RUN <N05:I.Slot[3].Data.7>
STEAM CONDENSATE PUMP PA-CF-907BH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU907BH_DLOC <DTP_CS07_EX1[6]>
STEAM CONDENSATE PUMP PA-CF-907BH START/STOP PB A08PU907BH_STR <N05:O.Slot[10].Data.5>

21
STEAM CONDENSATE PUMP PA-CF-907BH START/STOP PB A08PU907BH_STR <N05:O.Slot[10].Data.5>
STEAM CONDENSATE PUMP PA-CF-907BH START/STOP PB TO DCS A08PU907BH_STR_PTD <PTD_CS07_EX1[117]>

PU902H

22
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H READY TO START FB A08PU902H_RDY <N05:I.Slot[3].Data.11>
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H READY TO START FB TO DCS A08PU902H_RDY_PTD <PTD_CS07_EX1[11]>

23
A08PUP902H_LC_TRIP_FROM_DCS <DTP_CS07_EX1[314]>
A08PU902H_LC_TRIP

24
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H TRIP FB A08PU902H_TRP <N05:I.Slot[3].Data.9>
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H TRIP FB TO DCS A08PU902H_TRP_PTD <PTD_CS07_EX1[9]>

25
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H RUN FB A08PU902H_RUN <N05:I.Slot[3].Data.10>
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H RUN FB TO DCS A08PU902H_RUN_PTD <PTD_CS07_EX1[10]>

26
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU902H_DLOC <DTP_CS07_EX1[9]>
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H LOCAL/REMOTE SELECTOR SWITCH A08PU902H_LOC <N05:O.Slot[10].Data.6>

27
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H LOCAL/REMOTE SELECTOR SWITCH A08PU902H_LOC <N05:O.Slot[10].Data.6>
JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU902H_LOC_PTD <PTD_CS07_EX1[118]>

28

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H READY TO START FB A08PU902H_RDY <N05:I.Slot[3].Data.11>

A08PU902H_LC_TRIP

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H TRIP FB A08PU902H_TRP <N05:I.Slot[3].Data.9>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H RUN FB A08PU902H_RUN <N05:I.Slot[3].Data.10>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU902H_DLOC <DTP_CS07_EX1[9]>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H START PB FROM DCS A08PU902H_DSTR <DTP_CS07_EX1[10]>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H STOP PB FROM DCS A08PU902H_DSTP <DTP_CS07_EX1[11]>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H START/STOP PB A08PU902H_STR <N05:O.Slot[10].Data.7>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H RUN FB A08PU902H_RUN <N05:I.Slot[3].Data.10>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU902H_DLOC <DTP_CS07_EX1[9]>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H START/STOP PB A08PU902H_STR <N05:O.Slot[10].Data.7>

29

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H START/STOP PB A08PU902H_STR <N05:O.Slot[10].Data.7>

JE-FF-902 1st EFFECT CIRCULATION PUMP PA-CF-902H START/STOP PB TO DCS A08PU902H_STR_PTD <PTD_CS07_EX1[119]>

30

PU908H

JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H TRIP FB A08PU908PUH_TRP <N05:I.Slot[4].Data.6>

JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H TRIP FB TO DCS A08PU908PUH_TRP_PTD <PTD_CS07_EX1[22]>

31
P_908 BAT-H LOW CURRENT TRIP A08PU908H_LC_TRIP <DTP_CS07_EX1[332]>
P_908 BAT-H LOW CURRENT TRIP A08PU908H_LC_TRIP <DTP_CS07_EX1[332]>

32
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H RUN FB A08PU908PUH_RUN <N05:I.Slot[4].Data.7>
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H RUN FB TO DCS A08PU908PUH_RUN_PTD <PTD_CS07_EX1[23]>

33
A08PU908PUH_RDY <N05:I.Slot[4].Data.8>
A08PU908PUH_RDY_PTD <PTD_CS07_EX1[24]>

34
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU908PUH_DLOC <DTP_CS07_EX1[18]>
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H LOCAL/REMOTE SELECTOR SWITCH A08PU908PUH_LOC <N05:O.Slot[10].Data.12>

35
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H LOCAL/REMOTE SELECTOR SWITCH A08PU908PUH_LOC <N05:O.Slot[10].Data.12>
JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU908PUH_LOC_PTD <PTD_CS07_EX1[124]>

36

A08PU908PUH_RDY
<N05:I.Slot[4].Data.8>

P_908 BAT-H LOW CURRENT TRIP
A08PU908H_LC_TRIP
<DTP_CS07_EX1[332]>

JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H TRIP FB
A08PU908PUH_TRP
<N05:I.Slot[4].Data.6>

JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H RUN FB
A08PU908PUH_RUN
<N05:I.Slot[4].Data.7>

JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU908PUH_DLOC
<DTP_CS07_EX1[18]>

JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H START PB FROM DCS
A08PU908PUH_DSTR
<DTP_CS07_EX1[19]>

JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H STOP PB FROM DCS
A08PU908PUH_DSTP
<DTP_CS07_EX1[20]>

JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H START/STOP PB
A08PU908PUH_STR
<N05:O.Slot[10].Data.13>

JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H RUN FB
A08PU908PUH_RUN
<N05:I.Slot[4].Data.7>

JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU908PUH_DLOC
<DTP_CS07_EX1[18]>

JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H START/STOP PB
A08PU908PUH_STR
<N05:O.Slot[10].Data.13>

37

JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H START/STOP PB
A08PU908PUH_STR
<N05:O.Slot[10].Data.13>

JE-FF-902 2nd EFFECT TRANSFER PUMP PA-CF-908H START/STOP PB TO DCS
A08PU908PUH_STR_PTD
<PTD_CS07_EX1[125]>

38

PU909AH

2nd EFFECT CONDENSATE PUMP PA-CF-909AH READY TO START FB
A08PU909AH_RDY
<N05:I.Slot[4].Data.2>

2nd EFFECT CONDENSATE PUMP PA-CF-909AH READY TO START FB TO DCS
A08PU909AH_RDY_PTD
<PTD_CS07_EX1[18]>

39
2nd EFFECT CONDENSATE PUMP PA-CF-909AH TRIP FB A08PU909AH_TRP <N05:I.Slot[4].Data.0>
2nd EFFECT CONDENSATE PUMP PA-CF-909AH TRIP FB TO DCS A08PU909AH_TRP_PTD <PTD_CS07_EX1[16]>

40
2nd EFFECT CONDENSATE PUMP PA-CF-909AH RUN FB A08PU909AH_RUN <N05:I.Slot[4].Data.1>
2nd EFFECT CONDENSATE PUMP PA-CF-909AH RUN FB TO DCS A08PU909AH_RUN_PTD <PTD_CS07_EX1[17]>

41
2nd EFFECT CONDENSATE PUMP PA-CF-909AH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU909AH_DLOC <DTP_CS07_EX1[12]> /
2nd EFFECT CONDENSATE PUMP PA-CF-909AH LOCAL/REMOTE SELECTOR SWITCH A08PU909AH_LOC <N05:O.Slot[10].Data.8>

42
2nd EFFECT CONDENSATE PUMP PA-CF-909AH LOCAL/REMOTE SELECTOR SWITCH A08PU909AH_LOC <N05:O.Slot[10].Data.8>
2nd EFFECT CONDENSATE PUMP PA-CF-909AH LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU909AH_LOC_PTD <PTD_CS07_EX1[120]>

43

2nd EFFECT CONDENSATE PUMP PA-CF-909AH READY TO START FB A08PU909AH_RDY <N05:I.Slot[4].Data.2>

2nd EFFECT CONDENSATE PUMP PA-CF-909AH TRIP FB A08PU909AH_TRP <N05:I.Slot[4].Data.0> /

2nd EFFECT CONDENSATE PUMP PA-CF-909AH RUN FB A08PU909AH_RUN <N05:I.Slot[4].Data.1>

2nd EFFECT CONDENSATE PUMP PA-CF-909AH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU909AH_DLOC <DTP_CS07_EX1[12]> /

2nd EFFECT CONDENSATE PUMP PA-CF-909AH START PB FROM DCS A08PU909AH_DSTR <DTP_CS07_EX1[13]>

2nd EFFECT CONDENSATE PUMP PA-CF-909AH STOP PB FROM DCS A08PU909AH_DSTP <DTP_CS07_EX1[14]> /

2nd EFFECT CONDENSATE PUMP PA-CF-909AH START/STOP PB A08PU909AH_STR <N05:O.Slot[10].Data.9>

2nd EFFECT CONDENSATE PUMP PA-CF-909AH RUN FB A08PU909AH_RUN <N05:I.Slot[4].Data.1>

2nd EFFECT CONDENSATE PUMP PA-CF-909AH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU909AH_DLOC <DTP_CS07_EX1[12]>

2nd EFFECT CONDENSATE PUMP PA-CF-909AH START/STOP PB A08PU909AH_STR <N05:O.Slot[10].Data.9>

44

2nd EFFECT CONDENSATE PUMP PA-CF-909AH START/STOP PB A08PU909AH_STR <N05:O.Slot[10].Data.9>

2nd EFFECT CONDENSATE PUMP PA-CF-909AH START/STOP PB TO DCS A08PU909AH_STR_PTD <PTD_CS07_EX1[121]>

PU909BH

45

2nd EFFECT CONDENSATE PUMP PA-CF-909BH READY TO START FB A08PU909BH_RDY <N05:I.Slot[4].Data.5>

2nd EFFECT CONDENSATE PUMP PA-CF-909BH READY TO START FB TO DCS A08PU909BH_RDY_PTD <PTD_CS07_EX1[21]>

46
2nd EFFECT CONDENSATE PUMP PA-CF-909BH TRIP FB A08PU909BH_TRP <N05:I.Slot[4].Data.3>
2nd EFFECT CONDENSATE PUMP PA-CF-909BH TRIP FB TO DCS A08PU909BH_TRP_PTD <PTD_CS07_EX1[19]>

47
2nd EFFECT CONDENSATE PUMP PA-CF-909BH RUN FB A08PU909BH_RUN <N05:I.Slot[4].Data.4>
2nd EFFECT CONDENSATE PUMP PA-CF-909BH RUN FB TO DCS A08PU909BH_RUN_PTD <PTD_CS07_EX1[20]>

48
2nd EFFECT CONDENSATE PUMP PA-CF-909BH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU909BH_DLOC <DTP_CS07_EX1[15]>
2nd EFFECT CONDENSATE PUMP PA-CF-909BH LOCAL/REMOTE SELECTOR SWITCH A08PU909BH_LOC <N05:O.Slot[10].Data.10>

49
2nd EFFECT CONDENSATE PUMP PA-CF-909BH LOCAL/REMOTE SELECTOR SWITCH A08PU909BH_LOC <N05:O.Slot[10].Data.10>
2nd EFFECT CONDENSATE PUMP PA-CF-909BH LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU909BH_LOC_PTD <PTD_CS07_EX1[122]>

50

2nd EFFECT CONDENSATE PUMP PA-CF-909BH READY TO START FB A08PU909BH_RDY <N05:I.Slot[4].Data.5>

2nd EFFECT CONDENSATE PUMP PA-CF-909BH TRIP FB A08PU909BH_TRP <N05:I.Slot[4].Data.3>

2nd EFFECT CONDENSATE PUMP PA-CF-909BH RUN FB A08PU909BH_RUN <N05:I.Slot[4].Data.4>

2nd EFFECT CONDENSATE PUMP PA-CF-909BH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU909BH_DLOC <DTP_CS07_EX1[15]>

2nd EFFECT CONDENSATE PUMP PA-CF-909BH START PB FROM DCS A08PU909BH_DSTR <DTP_CS07_EX1[16]>

2nd EFFECT CONDENSATE PUMP PA-CF-909BH STOP PB FROM DCS A08PU909BH_DSTP <DTP_CS07_EX1[17]>

2nd EFFECT CONDENSATE PUMP PA-CF-909BH START/STOP PB A08PU909BH_STR <N05:O.Slot[10].Data.11>

2nd EFFECT CONDENSATE PUMP PA-CF-909BH RUN FB A08PU909BH_RUN <N05:I.Slot[4].Data.4>

2nd EFFECT CONDENSATE PUMP PA-CF-909BH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU909BH_DLOC <DTP_CS07_EX1[15]>

2nd EFFECT CONDENSATE PUMP PA-CF-909BH START/STOP PB A08PU909BH_STR <N05:O.Slot[10].Data.11>

51

2nd EFFECT CONDENSATE PUMP PA-CF-909BH START/STOP PB A08PU909BH_STR <N05:O.Slot[10].Data.11>

2nd EFFECT CONDENSATE PUMP PA-CF-909BH START/STOP PB TO DCS A08PU909BH_STR_PTD <PTD_CS07_EX1[123]>

PU903H

52

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H READY TO START FB A08PU903H_RDY <N05:I.Slot[4].Data.11>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H READY TO START FB TO DCS A08PU903H_RDY_PTD <PTD_CS07_EX1[27]>

53
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H TRIP FB A08PU903H_TRP <N05:I.Slot[4].Data.9>
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H TRIP FB TO DCS A08PU903H_TRP_PTD <PTD_CS07_EX1[25]>

54
A08PUP903H_LC_TRIP_FROM_DCS <DTP_CS07_EX1[315]>
A08PU903H_LC_TRIP

55
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H RUN FB A08PU903H_RUN <N05:I.Slot[4].Data.10>
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H RUN FB TO DCS A08PU903H_RUN_PTD <PTD_CS07_EX1[26]>

56
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU903H_DLOC <DTP_CS07_EX1[21]>
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H LOCAL/REMOTE SELECTOR SWITCH A08PU903H_LOC <N05:O.Slot[11].Data.0>

57
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H LOCAL/REMOTE SELECTOR SWITCH A08PU903H_LOC <N05:O.Slot[11].Data.0>
JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU903H_LOC_PTD <PTD_CS07_EX1[128]>

58

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H READY TO START FB A08PU903H_RDY <N05:I.Slot[4].Data.11>

A08PU903H_LC_TRIP

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H TRIP FB A08PU903H_TRP <N05:I.Slot[4].Data.9>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H RUN FB A08PU903H_RUN <N05:I.Slot[4].Data.10>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU903H_DLOC <DTP_CS07_EX1[21]>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H START PB FROM DCS A08PU903H_DSTR <DTP_CS07_EX1[22]>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H STOP PB FROM DCS A08PU903H_DSTP <DTP_CS07_EX1[23]>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H START/STOP PB A08PU903H_STR <N05:O.Slot[11].Data.1>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H RUN FB A08PU903H_RUN <N05:I.Slot[4].Data.10>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU903H_DLOC <DTP_CS07_EX1[21]>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H START/STOP PB A08PU903H_STR <N05:O.Slot[11].Data.1>

59

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H START/STOP PB A08PU903H_STR <N05:O.Slot[11].Data.1>

JE-FF-903 3rd EFFECT CIRCULATION PUMP PA-CF-903H START/STOP PB TO DCS A08PU903H_STR_PTD <PTD_CS07_EX1[129]>

PU910H

60

PRODUCT PUMP PA-CF-910H TRIP FB A08PU910H_TRP <N05:I.Slot[5].Data.3>

PRODUCT PUMP PA-CF-910H TRIP FB TO DCS A08PU910H_TRP_PTD <PTD_CS07_EX1[35]>

61
BAT-H P-910 LOW CURRENT TRIP A08PU910H_LC_TRIP <DTP_CS07_EX1[333]>
BAT-H P-910 LOW CURRENT TRIP A08PU910H_LC_TRIP <DTP_CS07_EX1[333]>

62
PRODUCT PUMP PA-CF-910H RUN FB A08PU910H_RUN <N05:I.Slot[5].Data.4>
PRODUCT PUMP PA-CF-910H RUN FB TO DCS A08PU910H_RUN_PTD <PTD_CS07_EX1[36]>

63
A08PU910H_RDY <N05:I.Slot[5].Data.5>
A08PU910H_RDY_PTD <PTD_CS07_EX1[37]>

64
PRODUCT PUMP PA-CF-910H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU910H_DLOC <DTP_CS07_EX1[27]>
PRODUCT PUMP PA-CF-910H LOCAL/REMOTE SELECTOR SWITCH A08PU910H_LOC <N05:O.Slot[11].Data.4>

65
PRODUCT PUMP PA-CF-910H LOCAL/REMOTE SELECTOR SWITCH A08PU910H_LOC <N05:O.Slot[11].Data.4>
PRODUCT PUMP PA-CF-910H LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU910H_LOC_PTD <PTD_CS07_EX1[132]>

66
A08PU910H_RDY <N05:I.Slot[5].Data.5>
BAT-H P-910 LOW CURRENT TRIP A08PU910H_LC_TRIP <DTP_CS07_EX1[333]>
PRODUCT PUMP PA-CF-910H TRIP FB A08PU910H_TRP <N05:I.Slot[5].Data.3>
PRODUCT PUMP PA-CF-910H RUN FB A08PU910H_RUN <N05:I.Slot[5].Data.4>

PRODUCT PUMP PA-CF-910H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU910H_DLOC <DTP_CS07_EX1[27]>
PRODUCT PUMP PA-CF-910H START PB FROM DCS A08PU910H_DSTR <DTP_CS07_EX1[28]>
PRODUCT PUMP PA-CF-910H STOP PB FROM DCS A08PU910H_DSTP <DTP_CS07_EX1[29]>
PRODUCT PUMP PA-CF-910H START/STOP PB A08PU910H_STR <N05:O.Slot[11].Data.5>
PRODUCT PUMP PA-CF-910H START/STOP PB A08PU910H_STR <N05:O.Slot[11].Data.5>
PRODUCT PUMP PA-CF-910H RUN FB A08PU910H_RUN <N05:I.Slot[5].Data.4>
PRODUCT PUMP PA-CF-910H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU910H_DLOC <DTP_CS07_EX1[27]>

67
PRODUCT PUMP PA-CF-910H START/STOP PB A08PU910H_STR <N05:O.Slot[11].Data.5>
PRODUCT PUMP PA-CF-910H START/STOP PB TO DCS A08PU910H_STR_PTD <PTD_CS07_EX1[133]>

PU911H

68
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H TRIP FB A08PU911H_TRP <N05:I.Slot[5].Data.0>
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H TRIP FB TO DCS A08PU911H_TRP_PTD <PTD_CS07_EX1[32]>

69
P-911 BAT-H LOW CURRENT TRIP FROM DCS A08PU911H_LC_TRIP <DTP_CS07_EX1[337]>
P-911 BAT-H LOW CURRENT TRIP FROM DCS A08PU911H_LC_TRIP <DTP_CS07_EX1[337]>

70
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H RUN FB A08PU911H_RUN <N05:I.Slot[5].Data.1>
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H RUN FB TO DCS A08PU911H_RUN_PTD <PTD_CS07_EX1[33]>

71
A08PU911H_RDY <N05:I.Slot[5].Data.2>
A08PU911H_RDY_PTD <PTD_CS07_EX1[34]>

72
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU911H_DLOC <DTP_CS07_EX1[24]>
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H LOCAL/REMOTE SELECTOR SWITCH A08PU911H_LOC <N05:O.Slot[11].Data.2>

73
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H LOCAL/REMOTE SELECTOR SWITCH A08PU911H_LOC <N05:O.Slot[11].Data.2>
JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU911H_LOC_PTD <PTD_CS07_EX1[130]>

74

A08PU911H_RDY
<N05:I.Slot[5].Data.2>

P-911 BAT-H LOW CURRENT TRIP FROM DCS
A08PU911H_LC_TRIP
<DTP_CS07_EX1[337]>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H TRIP FB
A08PU911H_TRP
<N05:I.Slot[5].Data.0>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H RUN FB
A08PU911H_RUN
<N05:I.Slot[5].Data.1>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU911H_DLOC
<DTP_CS07_EX1[24]>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H START PB FROM DCS
A08PU911H_DSTR
<DTP_CS07_EX1[25]>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H STOP PB FROM DCS
A08PU911H_DSTP
<DTP_CS07_EX1[26]>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H START/STOP PB
A08PU911H_STR
<N05:O.Slot[11].Data.3>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H RUN FB
A08PU911H_RUN
<N05:I.Slot[5].Data.1>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU911H_DLOC
<DTP_CS07_EX1[24]>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H START/STOP PB
A08PU911H_STR
<N05:O.Slot[11].Data.3>

75

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H START/STOP PB
A08PU911H_STR
<N05:O.Slot[11].Data.3>

JE-FF-903 3rd EFFECT TRANSFER PUMP PA-CF-911H START/STOP PB TO DCS
A08PU911H_STR_PTD
<PTD_CS07_EX1[131]>

76

PU904H

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H READY TO START FB
A08PU904H_RDY
<N05:I.Slot[5].Data.8>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H READY TO START FB TO DCS
A08PU904H_RDY_PTD
<PTD_CS07_EX1[40]>

77

A08PUP904H_LC_TRIP_FROM_DCS
<DTP_CS07_EX1[316]>

A08PU904H_LC_TRIP

78
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H TRIP FB A08PU904H_TRP <N05:I.Slot[5].Data.6>
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H TRIP FB TO DCS A08PU904H_TRP_PTD <PTD_CS07_EX1[38]>

79
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H RUN FB A08PU904H_RUN <N05:I.Slot[5].Data.7>
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H RUN FB TO DCS A08PU904H_RUN_PTD <PTD_CS07_EX1[39]>

80
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU904H_DLOC <DTP_CS07_EX1[30]>
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H LOCAL/REMOTE SELECTOR SWITCH A08PU904H_LOC <N05:O.Slot[11].Data.6>

81
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H LOCAL/REMOTE SELECTOR SWITCH A08PU904H_LOC <N05:O.Slot[11].Data.6>
JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU904H_LOC_PTD <PTD_CS07_EX1[134]>

82

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H READY TO START FB A08PU904H_RDY <N05:I.Slot[5].Data.8>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H RUN FB A08PU904H_RUN <N05:I.Slot[5].Data.7>

A08PU904H_LC_TRIP

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H TRIP FB A08PU904H_TRP <N05:I.Slot[5].Data.6>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU904H_DLOC <DTP_CS07_EX1[30]>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H START/STOP PB A08PU904H_STR <N05:O.Slot[11].Data.7>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H START PB FROM DCS A08PU904H_DSTR <DTP_CS07_EX1[31]>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H RUN FB A08PU904H_RUN <N05:I.Slot[5].Data.7>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU904H_DLOC <DTP_CS07_EX1[30]>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H STOP PB FROM DCS A08PU904H_DSTP <DTP_CS07_EX1[32]>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H START/STOP PB A08PU904H_STR <N05:O.Slot[11].Data.7>

83

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H START/STOP PB A08PU904H_STR <N05:O.Slot[11].Data.7>

JE-FF-904 4th EFFECT CIRCULATION PUMP PA-CF-904H START/STOP PB TO DCS A08PU904H_STR_PTD <PTD_CS07_EX1[135]>

84

PU912H

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H TRIP FB A08PU912H_TRP <N05:I.Slot[5].Data.9>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H TRIP FB TO DCS A08PU912H_TRP_PTD <PTD_CS07_EX1[41]>

85
JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H RUN FB A08PU912H_RUN
<N05:I.Slot[5].Data.10>
JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H RUN FB TO DCS A08PU912H_RUN_PTD
<PTD_CS07_EX1[42]>

86
A08PU912H_RDY
<N05:I.Slot[5].Data.11>
A08PU912H_RDY_PTD
<PTD_CS07_EX1[43]>

87
JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU912H_DLOC
<DTP_CS07_EX1[33]>
JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H LOCAL/REMOTE SELECTOR SWITCH A08PU912H_LOC
<N05:O.Slot[11].Data.8>

88
JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H LOCAL/REMOTE SELECTOR SWITCH A08PU912H_LOC
<N05:O.Slot[11].Data.8>
JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU912H_LOC_PTD
<PTD_CS07_EX1[136]>

89

A08PU912H_RDY
<N05:I.Slot[5].Data.11>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H TRIP FB A08PU912H_TRP
<N05:I.Slot[5].Data.9>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H RUN FB A08PU912H_RUN
<N05:I.Slot[5].Data.10>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU912H_DLOC
<DTP_CS07_EX1[33]>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H START PB FROM DCS A08PU912H_DSTR
<DTP_CS07_EX1[34]>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H STOP PB FROM DCS A08PU912H_DSTP
<DTP_CS07_EX1[35]>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H START/STOP PB A08PU912H_STR
<N05:O.Slot[11].Data.9>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H RUN FB A08PU912H_RUN
<N05:I.Slot[5].Data.10>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU912H_DLOC
<DTP_CS07_EX1[33]>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H START/STOP PB A08PU912H_STR
<N05:O.Slot[11].Data.9>

90

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H START/STOP PB A08PU912H_STR
<N05:O.Slot[11].Data.9>

JE-FF-904 4th EFFECT TRANSFER PUMP PA-CF-912H START/STOP PB TO DCS A08PU912H_STR_PTD
<PTD_CS07_EX1[137]>

PU905H

91

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H READY TO START FB A08PU905H_RDY
<N05:I.Slot[6].Data.2>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H READY TO START FB TO DCS A08PU905H_RDY_PTD
<PTD_CS07_EX1[50]>

92

A08PUP905H_LC_TRIP_FROM_DCS
<DTP_CS07_EX1[317]>

A08PU905H_LC_TRIP

93
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H TRIP FB A08PU905H_TRP <N05:I.Slot[6].Data.0>
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H TRIP FB TO DCS A08PU905H_TRP_PTD <PTD_CS07_EX1[48]>

94
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H RUN FB A08PU905H_RUN <N05:I.Slot[6].Data.1>
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H RUN FB TO DCS A08PU905H_RUN_PTD <PTD_CS07_EX1[49]>

95
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU905H_DLOC <DTP_CS07_EX1[36]> /
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H LOCAL/REMOTE SELECTOR SWITCH A08PU905H_LOC <N05:O.Slot[11].Data.10>

96
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H LOCAL/REMOTE SELECTOR SWITCH A08PU905H_LOC <N05:O.Slot[11].Data.10>
JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU905H_LOC_PTD <PTD_CS07_EX1[138]>

97

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H READY TO START FB A08PU905H_RDY <N05:I.Slot[6].Data.2>

A08PU905H_LC_TRIP

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H TRIP FB A08PU905H_TRP <N05:I.Slot[6].Data.0>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H RUN FB A08PU905H_RUN <N05:I.Slot[6].Data.1>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU905H_DLOC <DTP_CS07_EX1[36]>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H START PB FROM DCS A08PU905H_DSTR <DTP_CS07_EX1[37]>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H STOP PB FROM DCS A08PU905H_DSTP <DTP_CS07_EX1[38]>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H START/STOP PB A08PU905H_STR <N05:O.Slot[11].Data.11>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H RUN FB A08PU905H_RUN <N05:I.Slot[6].Data.1>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU905H_DLOC <DTP_CS07_EX1[36]>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H START/STOP PB A08PU905H_STR <N05:O.Slot[11].Data.11>

98

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H START/STOP PB A08PU905H_STR <N05:O.Slot[11].Data.11>

JE-FF-905 5th EFFECT CIRCULATION PUMP PA-CF-905H START/STOP PB TO DCS A08PU905H_STR_PTD <PTD_CS07_EX1[139]>

99

PU913H

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H TRIP FB A08PU913H_TRP <N05:I.Slot[6].Data.3>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H TRIP FB TO DCS A08PU913H_TRP_PTD <PTD_CS07_EX1[51]>

100
JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H RUN FB A08PU913H_RUN <N05:I.Slot[6].Data.4>
JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H RUN FB TO DCS A08PU913H_RUN_PTD <PTD_CS07_EX1[52]>

101
A08PU913H_RDY <N05:I.Slot[6].Data.5>
A08PU913H_RDY_PTD <PTD_CS07_EX1[53]>

102
JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU913H_DLOC <DTP_CS07_EX1[39]>
JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H LOCAL/REMOTE SELECTOR SWITCH A08PU913H_LOC <N05:O.Slot[11].Data.12>

103
JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H LOCAL/REMOTE SELECTOR SWITCH A08PU913H_LOC <N05:O.Slot[11].Data.12>
JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU913H_LOC_PTD <PTD_CS07_EX1[140]>

104

A08PU913H_RDY
<N05:I.Slot[6].Data.5>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H TRIP FB A08PU913H_TRP
<N05:I.Slot[6].Data.3>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H RUN FB A08PU913H_RUN
<N05:I.Slot[6].Data.4>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU913H_DLOC
<DTP_CS07_EX1[39]>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H START PB FROM DCS A08PU913H_DSTR
<DTP_CS07_EX1[40]>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H STOP PB FROM DCS A08PU913H_DSTP
<DTP_CS07_EX1[41]>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H START/STOP PB A08PU913H_STR
<N05:O.Slot[11].Data.13>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H RUN FB A08PU913H_RUN
<N05:I.Slot[6].Data.4>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU913H_DLOC
<DTP_CS07_EX1[39]>

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H START/STOP PB A08PU913H_STR
<N05:O.Slot[11].Data.13>

105

JE-FF-905 5th EFFECT TRANSFER PUMP PA-CF-913H START/STOP PB TO DCS A08PU913H_STR_PTD
<PTD_CS07_EX1[141]>

PU914AH

106

SODIC CONDENSATE PUMP PA-CF-914AH TRIP FB A08PU914AH_TRP
<N05:I.Slot[6].Data.6>

SODIC CONDENSATE PUMP PA-CF-914AH TRIP FB TO DCS A08PU914AH_TRP_PTD
<PTD_CS07_EX1[54]>

107
SODIC CONDENSATE PUMP PA-CF-914AH RUN FB
A08PU914AH_RUN
<N05:I.Slot[6].Data.7>
SODIC CONDENSATE PUMP PA-CF-914AH RUN FB TO DCS
A08PU914AH_RUN_PTD
<PTD_CS07_EX1[55]>

108
A08PU914AH_RDY
<N05:I.Slot[6].Data.8>
A08PU914AH_RDY_PTD
<PTD_CS07_EX1[56]>

109
SODIC CONDENSATE PUMP PA-CF-914AH LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU914AH_DLOC
<DTP_CS07_EX1[42]>
SODIC CONDENSATE PUMP PA-CF-914AH LOCAL/REMOTE SELECTOR SWITCH
A08PU914AH_LOC
<N05:O.Slot[12].Data.0>

110
SODIC CONDENSATE PUMP PA-CF-914AH LOCAL/REMOTE SELECTOR SWITCH
A08PU914AH_LOC
<N05:O.Slot[12].Data.0>
SODIC CONDENSATE PUMP PA-CF-914AH LOCAL/REMOTE SELECTOR SWITCH TO DCS
A08PU914AH_LOC_PTD
<PTD_CS07_EX1[144]>

111

A08PU914AH_RDY
<N05:I.Slot[6].Data.8>

SODIC CONDENSATE PUMP PA-CF-914AH TRIP FB
A08PU914AH_TRP
<N05:I.Slot[6].Data.6>

SODIC CONDENSATE PUMP PA-CF-914AH RUN FB
A08PU914AH_RUN
<N05:I.Slot[6].Data.7>

SODIC CONDENSATE PUMP PA-CF-914AH LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU914AH_DLOC
<DTP_CS07_EX1[42]>

SODIC CONDENSATE PUMP PA-CF-914AH START PB FROM DCS
A08PU914AH_DSTR
<DTP_CS07_EX1[43]>

SODIC CONDENSATE PUMP PA-CF-914AH STOP PB FROM DCS
A08PU914AH_DSTP
<DTP_CS07_EX1[44]>

SODIC CONDENSATE PUMP PA-CF-914AH START/STOP PB
A08PU914AH_STR
<N05:O.Slot[12].Data.1>

SODIC CONDENSATE PUMP PA-CF-914AH RUN FB
A08PU914AH_RUN
<N05:I.Slot[6].Data.7>

SODIC CONDENSATE PUMP PA-CF-914AH LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU914AH_DLOC
<DTP_CS07_EX1[42]>

SODIC CONDENSATE PUMP PA-CF-914AH START/STOP PB
A08PU914AH_STR
<N05:O.Slot[12].Data.1>

112

SODIC CONDENSATE PUMP PA-CF-914AH START/STOP PB
A08PU914AH_STR
<N05:O.Slot[12].Data.1>

SODIC CONDENSATE PUMP PA-CF-914AH START/STOP PB TO DCS
A08PU914AH_STR_PTD
<PTD_CS07_EX1[145]>

PU914BH

113

SODIC CONDENSATE PUMP PA-CF-914BH TRIP FB
A08PU914BH_TRP
<N05:I.Slot[6].Data.9>

SODIC CONDENSATE PUMP PA-CF-914BH TRIP FB TO DCS
A08PU914BH_TRP_PTD
<PTD_CS07_EX1[57]>

114

SODIC CONDENSATE PUMP PA-CF-914BH RUN FB
A08PU914BH_RUN
<N05:I.Slot[6].Data.10>

SODIC CONDENSATE PUMP PA-CF-914BH RUN FB TO DCS
A08PU914BH_RUN_PTD
<PTD_CS07_EX1[58]>

115
A08PU914BH_RDY
<N05:I.Slot[6].Data.11>
A08PU914BH_RDY_PTD
<PTD_CS07_EX1[59]>

116
SODIC CONDENSATE PUMP PA-CF-914BH LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU914BH_DLOC
<DTP_CS07_EX1[45]>
SODIC CONDENSATE PUMP PA-CF-914BH LOCAL/REMOTE SELECTOR SWITCH
A08PU914BH_LOC
<N05:O.Slot[12].Data.2>

117
SODIC CONDENSATE PUMP PA-CF-914BH LOCAL/REMOTE SELECTOR SWITCH
A08PU914BH_LOC
<N05:O.Slot[12].Data.2>
SODIC CONDENSATE PUMP PA-CF-914BH LOCAL/REMOTE SELECTOR SWITCH TO DCS
A08PU914BH_LOC_PTD
<PTD_CS07_EX1[146]>

118
A08PU914BH_RDY
<N05:I.Slot[6].Data.11>
SODIC CONDENSATE PUMP PA-CF-914BH TRIP FB
A08PU914BH_TRP
<N05:I.Slot[6].Data.9>
SODIC CONDENSATE PUMP PA-CF-914BH RUN FB
A08PU914BH_RUN
<N05:I.Slot[6].Data.10>
SODIC CONDENSATE PUMP PA-CF-914BH LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU914BH_DLOC
<DTP_CS07_EX1[45]>
SODIC CONDENSATE PUMP PA-CF-914BH START PB FROM DCS
A08PU914BH_DSTR
<DTP_CS07_EX1[46]>
SODIC CONDENSATE PUMP PA-CF-914BH STOP PB FROM DCS
A08PU914BH_DSTP
<DTP_CS07_EX1[47]>
SODIC CONDENSATE PUMP PA-CF-914BH START/STOP PB
A08PU914BH_STR
<N05:O.Slot[12].Data.3>
SODIC CONDENSATE PUMP PA-CF-914BH RUN FB
A08PU914BH_RUN
<N05:I.Slot[6].Data.10>
SODIC CONDENSATE PUMP PA-CF-914BH LOCAL/REMOTE SELECTOR SWITCH FROM DCS
A08PU914BH_DLOC
<DTP_CS07_EX1[45]>
SODIC CONDENSATE PUMP PA-CF-914BH START/STOP PB
A08PU914BH_STR
<N05:O.Slot[12].Data.3>

119
SODIC CONDENSATE PUMP PA-CF-914BH START/STOP PB A08PU914BH_STR <N05:O.Slot[12].Data.3>
SODIC CONDENSATE PUMP PA-CF-914BH START/STOP PB TO DCS A08PU914BH_STR_PTD <PTD_CS07_EX1[147]>

PU906H

120
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H READY TO START FB A08PU906H_RDY <N05:I.Slot[7].Data.2>
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H READY TO START FB TO DCS A08PU906H_RDY_PTD <PTD_CS07_EX1[66]>

121
A08PUP906H_LC_TRIP_FROM_DCS <DTP_CS07_EX1[318]>
A08PU906H_LC_TRIP

122
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H TRIP FB A08PU906H_TRP <N05:I.Slot[7].Data.0>
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H TRIP FB TO DCS A08PU906H_TRP_PTD <PTD_CS07_EX1[64]>

123
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H RUN FB A08PU906H_RUN <N05:I.Slot[7].Data.1>
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H RUN FB TO DCS A08PU906H_RUN_PTD <PTD_CS07_EX1[65]>

124
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU906H_DLOC <DTP_CS07_EX1[48]> /
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H LOCAL/REMOTE SELECTOR SWITCH A08PU906H_LOC <N05:O.Slot[12].Data.4>

125
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H LOCAL/REMOTE SELECTOR SWITCH A08PU906H_LOC <N05:O.Slot[12].Data.4>
JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU906H_LOC_PTD <PTD_CS07_EX1[148]>

126

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H READY TO START FB A08PU906H_RDY <N05:I.Slot[7].Data.2>

A08PU906H_LC_TRIP

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H TRIP FB A08PU906H_TRP <N05:I.Slot[7].Data.0>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H RUN FB A08PU906H_RUN <N05:I.Slot[7].Data.1>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU906H_DLOC <DTP_CS07_EX1[48]>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H START PB FROM DCS A08PU906H_DSTR <DTP_CS07_EX1[49]>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H STOP PB FROM DCS A08PU906H_DSTP <DTP_CS07_EX1[50]>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H START/STOP PB A08PU906H_STR <N05:O.Slot[12].Data.5>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H RUN FB A08PU906H_RUN <N05:I.Slot[7].Data.1>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU906H_DLOC <DTP_CS07_EX1[48]>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H START/STOP PB A08PU906H_STR <N05:O.Slot[12].Data.5>

127

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H START/STOP PB A08PU906H_STR <N05:O.Slot[12].Data.5>

JE-FF-906 6th EFFECT CIRCULATION PUMP PA-CF-906H START/STOP PB TO DCS A08PU906H_STR_PTD <PTD_CS07_EX1[149]>

PU915H

128

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H TRIP FB A08PU915H_TRP <N05:I.Slot[7].Data.3>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H TRIP FB TO DCS A08PU915H_TRP_PTD <PTD_CS07_EX1[67]>

129
JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H RUN FB A08PU915H_RUN <N05:I.Slot[7].Data.4>
JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H RUN FB TO DCS A08PU915H_RUN_PTD <PTD_CS07_EX1[68]>

130
A08PU915H_RDY <N05:I.Slot[7].Data.5>
A08PU915H_RDY_PTD <PTD_CS07_EX1[69]>

131
JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU915H_DLOC <DTP_CS07_EX1[51]>
JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H LOCAL/REMOTE SELECTOR SWITCH A08PU915H_LOC <N05:O.Slot[12].Data.6>

132
JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H LOCAL/REMOTE SELECTOR SWITCH A08PU915H_LOC <N05:O.Slot[12].Data.6>
JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU915H_LOC_PTD <PTD_CS07_EX1[150]>

133

A08PU915H_RDY
<N05:I.Slot[7].Data.5>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H TRIP FB A08PU915H_TRP
<N05:I.Slot[7].Data.3>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H RUN FB A08PU915H_RUN
<N05:I.Slot[7].Data.4>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU915H_DLOC
<DTP_CS07_EX1[51]>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H START PB FROM DCS A08PU915H_DSTR
<DTP_CS07_EX1[52]>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H STOP PB FROM DCS A08PU915H_DSTP
<DTP_CS07_EX1[53]>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H START/STOP PB A08PU915H_STR
<N05:O.Slot[12].Data.7>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H RUN FB A08PU915H_RUN
<N05:I.Slot[7].Data.4>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU915H_DLOC
<DTP_CS07_EX1[51]>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H START/STOP PB A08PU915H_STR
<N05:O.Slot[12].Data.7>

134

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H START/STOP PB A08PU915H_STR
<N05:O.Slot[12].Data.7>

JE-FF-906 6th EFFECT TRANSFER PUMP PA-CF-915H START/STOP PB TO DCS A08PU915H_STR_PTD
<PTD_CS07_EX1[151]>

PU916AH

135

COOLING WATER PUMP PA-CF-916AH TRIP FB A08PU916AH_TRP
<N05:I.Slot[7].Data.6>

COOLING WATER PUMP PA-CF-916AH TRIP FB TO DCS A08PU916AH_TRP_PTD
<PTD_CS07_EX1[70]>

136
COOLING WATER PUMP PA-CF-916AH RUN FB A08PU916AH_RUN <N05:I.Slot[7].Data.7>
COOLING WATER PUMP PA-CF-916AH RUN FB TO DCS A08PU916AH_RUN_PTD <PTD_CS07_EX1[71]>

137
A08PU916AH_RDY <N05:I.Slot[7].Data.8>
A08PU916AH_RDY_PTD <PTD_CS07_EX1[72]>

138
COOLING WATER PUMP PA-CF-916AH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU916AH_DLOC <DTP_CS07_EX1[54]>
COOLING WATER PUMP PA-CF-916AH LOCAL/REMOTE SELECTOR SWITCH A08PU916AH_LOC <N05:O.Slot[12].Data.8>

139
COOLING WATER PUMP PA-CF-916AH LOCAL/REMOTE SELECTOR SWITCH A08PU916AH_LOC <N05:O.Slot[12].Data.8>
COOLING WATER PUMP PA-CF-916AH LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU916AH_LOC_PTD <PTD_CS07_EX1[152]>

140

A08PU916AH_RDY
<N05:I.Slot[7].Data.8>

COOLING WATER PUMP
PA-CF-916AH TRIP FB
A08PU916AH_TRP
<N05:I.Slot[7].Data.6>

COOLING WATER PUMP
PA-CF-916AH RUN FB
A08PU916AH_RUN
<N05:I.Slot[7].Data.7>

COOLING WATER PUMP
PA-CF-916AH
LOCAL/REMOTE
SELECTOR SWITCH FROM
DCS
A08PU916AH_DLOC
<DTP_CS07_EX1[54]>

COOLING WATER PUMP
PA-CF-916AH START PB
FROM DCS
A08PU916AH_DSTR
<DTP_CS07_EX1[55]>

COOLING WATER PUMP
PA-CF-916AH STOP PB
FROM DCS
A08PU916AH_DSTP
<DTP_CS07_EX1[56]>

COOLING WATER PUMP
PA-CF-916AH
START/STOP PB
A08PU916AH_STR
<N05:O.Slot[12].Data.9>

COOLING WATER PUMP
PA-CF-916AH RUN FB
A08PU916AH_RUN
<N05:I.Slot[7].Data.7>

COOLING WATER PUMP
PA-CF-916AH
LOCAL/REMOTE
SELECTOR SWITCH FROM
DCS
A08PU916AH_DLOC
<DTP_CS07_EX1[54]>

COOLING WATER PUMP
PA-CF-916AH
START/STOP PB
A08PU916AH_STR
<N05:O.Slot[12].Data.9>

141

COOLING WATER PUMP
PA-CF-916AH
START/STOP PB
A08PU916AH_STR
<N05:O.Slot[12].Data.9>

COOLING WATER PUMP
PA-CF-916AH
START/STOP PB TO DCS
A08PU916AH_STR_PTD
<PTD_CS07_EX1[153]>

PU916BH

142

COOLING WATER PUMP
PA-CF-916BH TRIP FB
A08PU916BH_TRP
<N05:I.Slot[7].Data.9>

COOLING WATER PUMP
PA-CF-916BH TRIP FB
TO DCS
A08PU916BH_TRP_PTD
<PTD_CS07_EX1[73]>

143

COOLING WATER PUMP
PA-CF-916BH RUN FB
A08PU916BH_RUN
<N05:I.Slot[7].Data.10>

COOLING WATER PUMP
PA-CF-916BH RUN FB
TO DCS
A08PU916BH_RUN_PTD
<PTD_CS07_EX1[74]>

144

A08PU916BH_RDY
<N05:I.Slot[7].Data.11>

A08PU916BH_RDY_PTD
<PTD_CS07_EX1[75]>

145
COOLING WATER PUMP PA-CF-916BH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU916BH_DLOC <DTP_CS07_EX1[57]> /
COOLING WATER PUMP PA-CF-916BH LOCAL/REMOTE SELECTOR SWITCH A08PU916BH_LOC <N05:O.Slot[12].Data.10>

146
COOLING WATER PUMP PA-CF-916BH LOCAL/REMOTE SELECTOR SWITCH A08PU916BH_LOC <N05:O.Slot[12].Data.10>
COOLING WATER PUMP PA-CF-916BH LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU916BH_LOC_PTD <PTD_CS07_EX1[154]>

147
A08PU916BH_RDY <N05:I.Slot[7].Data.11>
COOLING WATER PUMP PA-CF-916BH TRIP FB A08PU916BH_TRP <N05:I.Slot[7].Data.9> /
COOLING WATER PUMP PA-CF-916BH RUN FB A08PU916BH_RUN <N05:I.Slot[7].Data.10>
COOLING WATER PUMP PA-CF-916BH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU916BH_DLOC <DTP_CS07_EX1[57]> /
COOLING WATER PUMP PA-CF-916BH START PB FROM DCS A08PU916BH_DSTR <DTP_CS07_EX1[58]>
COOLING WATER PUMP PA-CF-916BH STOP PB FROM DCS A08PU916BH_DSTP <DTP_CS07_EX1[59]> /
COOLING WATER PUMP PA-CF-916BH START/STOP PB A08PU916BH_STR <N05:O.Slot[12].Data.11>
COOLING WATER PUMP PA-CF-916BH RUN FB A08PU916BH_RUN <N05:I.Slot[7].Data.10>
COOLING WATER PUMP PA-CF-916BH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU916BH_DLOC <DTP_CS07_EX1[57]>
COOLING WATER PUMP PA-CF-916BH START/STOP PB A08PU916BH_STR <N05:O.Slot[12].Data.11>

148
COOLING WATER PUMP PA-CF-916BH START/STOP PB A08PU916BH_STR <N05:O.Slot[12].Data.11>
COOLING WATER PUMP PA-CF-916BH START/STOP PB TO DCS A08PU916BH_STR_PTD <PTD_CS07_EX1[155]>

PU916CH

149
COOLING WATER PUMP PA-CF-916CH TRIP FB A08PU916CH_TRP <N05:I.Slot[8].Data.0>
COOLING WATER PUMP PA-CF-916CH TRIP FB TO DCS A08PU916CH_TRP_PTD <PTD_CS07_EX1[80]>

150
AFI
FAULTY A08PU916CH_RUN <N05:I.Slot[8].Data.1>
;NL N05S8C12 <N05:I.Slot[8].Data.12>
COOLING WATER PUMP PA-CF-916CH RUN FB TO DCS A08PU916CH_RUN_PTD <PTD_CS07_EX1[81]>

151
A08PU916CH_RDY <N05:I.Slot[8].Data.2>
A08PU916CH_RDY_PTD <PTD_CS07_EX1[82]>

152
COOLING WATER PUMP PA-CF-916CH LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU916CH_DLOC <DTP_CS07_EX1[60]>
/
COOLING WATER PUMP PA-CF-916CH LOCAL/REMOTE SELECTOR SWITCH A08PU916CH_LOC <N05:O.Slot[12].Data.12>

153
COOLING WATER PUMP PA-CF-916CH LOCAL/REMOTE SELECTOR SWITCH A08PU916CH_LOC <N05:O.Slot[12].Data.12>
COOLING WATER PUMP PA-CF-916CH LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU916CH_LOC_PTD <PTD_CS07_EX1[156]>

154

A08PU916CH_RDY
<N05:I.Slot[8].Data.2>

COOLING WATER PUMP
PA-CF-916CH TRIP FB
A08PU916CH_TRP
<N05:I.Slot[8].Data.0>

FAULTY
A08PU916CH_RUN
<N05:I.Slot[8].Data.1>

AFI

;NL
N05S8C12
<N05:I.Slot[8].Data.12>

COOLING WATER PUMP
PA-CF-916CH
LOCAL/REMOTE
SELECTOR SWITCH FROM
DCS
A08PU916CH_DLOC
<DTP_CS07_EX1[60]>

COOLING WATER PUMP
PA-CF-916CH START PB
FROM DCS
A08PU916CH_DSTR
<DTP_CS07_EX1[61]>

COOLING WATER PUMP
PA-CF-916CH STOP PB
FROM DCS
A08PU916CH_DSTP
<DTP_CS07_EX1[62]>

A08PU916CH_STR
<N05:O.Slot[12].Data.13>

FAULTY
A08PU916CH_RUN
<N05:I.Slot[8].Data.1>

AFI

COOLING WATER PUMP
PA-CF-916CH
LOCAL/REMOTE
SELECTOR SWITCH FROM
DCS
A08PU916CH_DLOC
<DTP_CS07_EX1[60]>

;NL
N05S8C12
<N05:I.Slot[8].Data.12>

A08PU916CH_STR
<N05:O.Slot[12].Data.13>

155

A08PU916CH_STR
<N05:O.Slot[12].Data.13>

COOLING WATER PUMP
PA-CF-916CH
START/STOP PB TO DCS
A08PU916CH_STR_PTD
<PTD_CS07_EX1[157]>

PU918H

156

ACID RETURN PUMP
PA-CF-918H READY TO
START FB
A08PU918H_RDY
<N05:I.Slot[8].Data.5>

ACID RETURN PUMP
PA-CF-918H READY TO
START FB TO DCS
A08PU918H_RDY_PTD
<PTD_CS07_EX1[85]>

157

ACID RETURN PUMP
PA-CF-918H TRIP FB
A08PU918H_TRP
<N05:I.Slot[8].Data.3>

ACID RETURN PUMP
PA-CF-918H TRIP FB
TO DCS
A08PU918H_TRP_PTD
<PTD_CS07_EX1[83]>

158
ACID RETURN PUMP PA-CF-918H RUN FB A08PU918H_RUN <N05:I.Slot[8].Data.4>
ACID RETURN PUMP PA-CF-918H RUN FB TO DCS A08PU918H_RUN_PTD <PTD_CS07_EX1[84]>

159
ACID RETURN PUMP PA-CF-918H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU918H_DLOC <DTP_CS07_EX1[63]> /
ACID RETURN PUMP PA-CF-918H LOCAL/REMOTE SELECTOR SWITCH A08PU918H_LOC <N05:O.Slot[13].Data.0>

160
ACID RETURN PUMP PA-CF-918H LOCAL/REMOTE SELECTOR SWITCH A08PU918H_LOC <N05:O.Slot[13].Data.0>
ACID RETURN PUMP PA-CF-918H LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU918H_LOC_PTD <PTD_CS07_EX1[160]>

161
ACID RETURN PUMP PA-CF-918H READY TO START FB A08PU918H_RDY <N05:I.Slot[8].Data.5>
ACID RETURN PUMP PA-CF-918H TRIP FB A08PU918H_TRP <N05:I.Slot[8].Data.3> /
ACID RETURN PUMP PA-CF-918H RUN FB A08PU918H_RUN <N05:I.Slot[8].Data.4>
ACID RETURN PUMP PA-CF-918H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU918H_DLOC <DTP_CS07_EX1[63]> /
ACID RETURN PUMP PA-CF-918H START PB FROM DCS A08PU918H_DSTR <DTP_CS07_EX1[64]>
ACID RETURN PUMP PA-CF-918H STOP PB FROM DCS A08PU918H_DSTP <DTP_CS07_EX1[65]> /
ACID RETURN PUMP PA-CF-918H START/STOP PB A08PU918H_STR <N05:O.Slot[13].Data.1>
ACID RETURN PUMP PA-CF-918H RUN FB A08PU918H_RUN <N05:I.Slot[8].Data.4>
ACID RETURN PUMP PA-CF-918H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU918H_DLOC <DTP_CS07_EX1[63]>
ACID RETURN PUMP PA-CF-918H START/STOP PB A08PU918H_STR <N05:O.Slot[13].Data.1>

162
ACID RETURN PUMP PA-CF-918H START/STOP PB A08PU918H_STR <N05:O.Slot[13].Data.1>
ACID RETURN PUMP PA-CF-918H START/STOP PB TO DCS A08PU918H_STR_PTD <PTD_CS07_EX1[161]>

PU919H

163
SUMP PUMP PUMP PA-CF-919H READY TO START FB A08PU919H_RDY <N05:I.Slot[8].Data.8>
SUMP PUMP PUMP PA-CF-919H READY TO START FB TO DCS A08PU919H_RDY_PTD <PTD_CS07_EX1[88]>

164
SUMP PUMP PUMP PA-CF-919H TRIP FB A08PU919H_TRP <N05:I.Slot[8].Data.6>
SUMP PUMP PUMP PA-CF-919H TRIP FB TO DCS A08PU919H_TRP_PTD <PTD_CS07_EX1[86]>

165
SUMP PUMP PUMP PA-CF-919H RUN FB A08PU919H_RUN <N05:I.Slot[8].Data.7>
SUMP PUMP PUMP PA-CF-919H RUN FB TO DCS A08PU919H_RUN_PTD <PTD_CS07_EX1[87]>

166
A08PU919H_AM <DTP_CS07_EX1[257]>
SUMP PUMP PUMP PA-CF-919H LOCAL/REMOTE SELECTOR SWITCH A08PU919H_LOC <N05:O.Slot[13].Data.2>
A08PU919H_AM <DTP_CS07_EX1[257]> /
SUMP PUMP PUMP PA-CF-919H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU919H_DLOC <DTP_CS07_EX1[66]> /

167
SUMP PUMP PUMP PA-CF-919H LOCAL/REMOTE SELECTOR SWITCH A08PU919H_LOC <N05:O.Slot[13].Data.2>
SUMP PUMP PUMP PA-CF-919H LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PU919H_LOC_PTD <PTD_CS07_EX1[162]>

168
LEVEL HIGH SWITCH ON TANK AFRM AREA SUMP TV-FB-922H A08_LAH_919H <N11:I.Slot[1].Data.0>
LEVEL HIGH SWITCH ON TANK AFRM AREA SUMP TV-FB-922H TO DCS A08_LAH_904H_PTD <PTD_CS07_EX3[288]>

169
LEVEL LOW SWITCH ON TANK AFRM AREA SUMP TV-FB-922H A08_LAL_904H <N11:I.Slot[1].Data.1>
LEVEL LOW SWITCH ON TANK AFRM AREA SUMP TV-FB-922H TO DCS A08_LAL_904H_PTD <PTD_CS07_EX3[289]>

170

SUMP PUMP PUMP PA-CF-919H READY TO START FB A08PU919H_RDY <N05:I.Slot[8].Data.8>

SUMP PUMP PUMP PA-CF-919H TRIP FB A08PU919H_TRP <N05:I.Slot[8].Data.6> /

SUMP PUMP PUMP PA-CF-919H RUN FB A08PU919H_RUN <N05:I.Slot[8].Data.7>

A08PU919H_AM <DTP_CS07_EX1[257]> /

SUMP PUMP PUMP PA-CF-919H START PB FROM DCS A08PU919H_DSTR <DTP_CS07_EX1[67]>

LEVEL LOW SWITCH ON TANK AFRM AREA SUMP TV-FB-922H A08_LAL_904H <N11:I.Slot[1].Data.1> /

SUMP PUMP PUMP PA-CF-919H RUN FB A08PU919H_RUN <N05:I.Slot[8].Data.7>

SUMP PUMP PUMP PA-CF-919H START/STOP PB A08PU919H_STR <N05:O.Slot[13].Data.3>

SUMP PUMP PUMP PA-CF-919H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PU919H_DLOC <DTP_CS07_EX1[66]>

A08PU919H_AM <DTP_CS07_EX1[257]>

LEVEL HIGH SWITCH ON TANK AFRM AREA SUMP TV-FB-922H A08_LAH_919H <N11:I.Slot[1].Data.0>

SUMP PUMP PUMP PA-CF-919H RUN FB A08PU919H_RUN <N05:I.Slot[8].Data.7>

SUMP PUMP PUMP PA-CF-919H STOP PB FROM DCS A08PU919H_DSTP <DTP_CS07_EX1[68]> /

TIMER_PU919H.DN /

SUMP PUMP PUMP PA-CF-919H START/STOP PB A08PU919H_STR <N05:O.Slot[13].Data.3>

171

SUMP PUMP PUMP PA-CF-919H START/STOP PB A08PU919H_STR <N05:O.Slot[13].Data.3>

LEVEL HIGH SWITCH ON TANK AFRM AREA SUMP TV-FB-922H A08_LAH_919H <N11:I.Slot[1].Data.0> /

TON
Timer On Delay
Timer TIMER_PU919H
Preset 240000
Accum 0
EN
DN

172
SUMP PUMP PUMP PA-CF-919H START/STOP PB A08PU919H_STR <N05:O.Slot[13].Data.3>
SUMP PUMP PUMP PA-CF-919H START/STOP PB TO DCS A08PU919H_STR_PTD <PTD_CS07_EX1[163]>

MV901H

173
08-MV-901H OPEN PB A08MV901H_OP <N05:O.Slot[13].Data.6>
08-MV-901H OPEN PB TO DCS A08MV901H_OP_PTD <PTD_CS07_EX1[166]>

174
08-MV-901H CLOSE PB A08MV901H_CL <N05:O.Slot[13].Data.7>
08-MV-901H CLOSE PB TO DCS A08MV901H_CL_PTD <PTD_CS07_EX1[167]>

175
08-MV-901H LOCAL / REMOTE SELECTOR SWITCH FROM DCS A08MV901H_DLOC <DTP_CS07_EX1[74]>
08-MV-901H LOCAL / REMOTE SELECTOR SWITCH A08MV901H_LOC <N05:O.Slot[13].Data.8>

176
08-MV-901H LOCAL / REMOTE SELECTOR SWITCH A08MV901H_LOC <N05:O.Slot[13].Data.8>
08-MV-901H LOCAL / REMOTE SELECTOR SWITCH TO DCS A08MV901H_LOC_PTD <PTD_CS07_EX1[168]>

177
08TAHH930H A08_TAHH_930H <N11:I.Slot[1].Data.8>
08TAHH930H TO DCS A08_TAHH_930H_PTD <PTD_CS07_EX3[296]>

178
08-MV-901H LOCAL / REMOTE SELECTOR SWITCH FROM DCS A08MV901H_DLOC <DTP_CS07_EX1[74]>
08-MV-901H OPEN PB FROM DCS A08MV901H_DOPN <DTP_CS07_EX1[72]>
08-MV-901H CLOSE PB FROM DCS A08MV901H_DCLS <DTP_CS07_EX1[73]>
08-MV-901H OPEN PB A08MV901H_OP <N05:O.Slot[13].Data.6>
08-MV-901H OPEN PB A08MV901H_OP <N05:O.Slot[13].Data.6>
08-MV-901H OPEN PB TO DCS A08MV901H_OP_PTD <PTD_CS07_EX1[166]>
08-MV-901H LOCAL / REMOTE SELECTOR SWITCH FROM DCS A08MV901H_DLOC <DTP_CS07_EX1[74]>

179

08-MV-901H LOCAL / REMOTE SELECTOR SWITCH FROM DCS A08MV901H_DLOC <DTP_CS07_EX1[74]>

08-MV-901H CLOSE PB FROM DCS A08MV901H_DCLS <DTP_CS07_EX1[73]>

08-MV-901H OPEN PB FROM DCS A08MV901H_DOPN <DTP_CS07_EX1[72]>

08TAHH930H A08_TAHH_930H <N11:I.Slot[1].Data.8>

08-MV-901H CLOSE PB A08MV901H_CL <N05:O.Slot[13].Data.7>

08-MV-901H CLOSE PB TO DCS A08MV901H_CL_PTD <PTD_CS07_EX1[167]>

08-MV-901H LOCAL / REMOTE SELECTOR SWITCH FROM DCS A08MV901H_DLOC <DTP_CS07_EX1[74]>

08-MV-901H CLOSE PB A08MV901H_CL <N05:O.Slot[13].Data.7>

PUG909H

180

A08PUG901H_RDY <N05:I.Slot[8].Data.11>

A08PUG901H_RDY_PTD <PTD_CS07_EX1[91]>

181

SUMP AGITATOR PUMP TM-00-901H TRIP FB A08PUG901H_TRP <N05:I.Slot[8].Data.9>

SUMP AGITATOR PUMP TM-00-901H TRIP FB TO DCS A08PUG901H_TRP_PTD <PTD_CS07_EX1[89]>

182

SUMP AGITATOR PUMP TM-00-901H RUN FB A08PUG901H_RUN <N05:I.Slot[8].Data.10>

SUMP AGITATOR PUMP TM-00-901H RUN FB TO DCS A08PUG901H_RUN_PTD <PTD_CS07_EX1[90]>

183

SUMP AGITATOR PUMP TM-00-901H LOCAL/REMOTE SELECTOR SWITCH FROM DCS A08PUG901H_DLOC <DTP_CS07_EX1[69]>

SUMP AGITATOR PUMP TM-00-901H LOCAL/REMOTE SELECTOR SWITCH A08PUG901H_LOC <N05:O.Slot[13].Data.4>

184

SUMP AGITATOR PUMP TM-00-901H LOCAL/REMOTE SELECTOR SWITCH A08PUG901H_LOC <N05:O.Slot[13].Data.4>

SUMP AGITATOR PUMP TM-00-901H LOCAL/REMOTE SELECTOR SWITCH TO DCS A08PUG901H_LOC_PTD <PTD_CS07_EX1[164]>

185

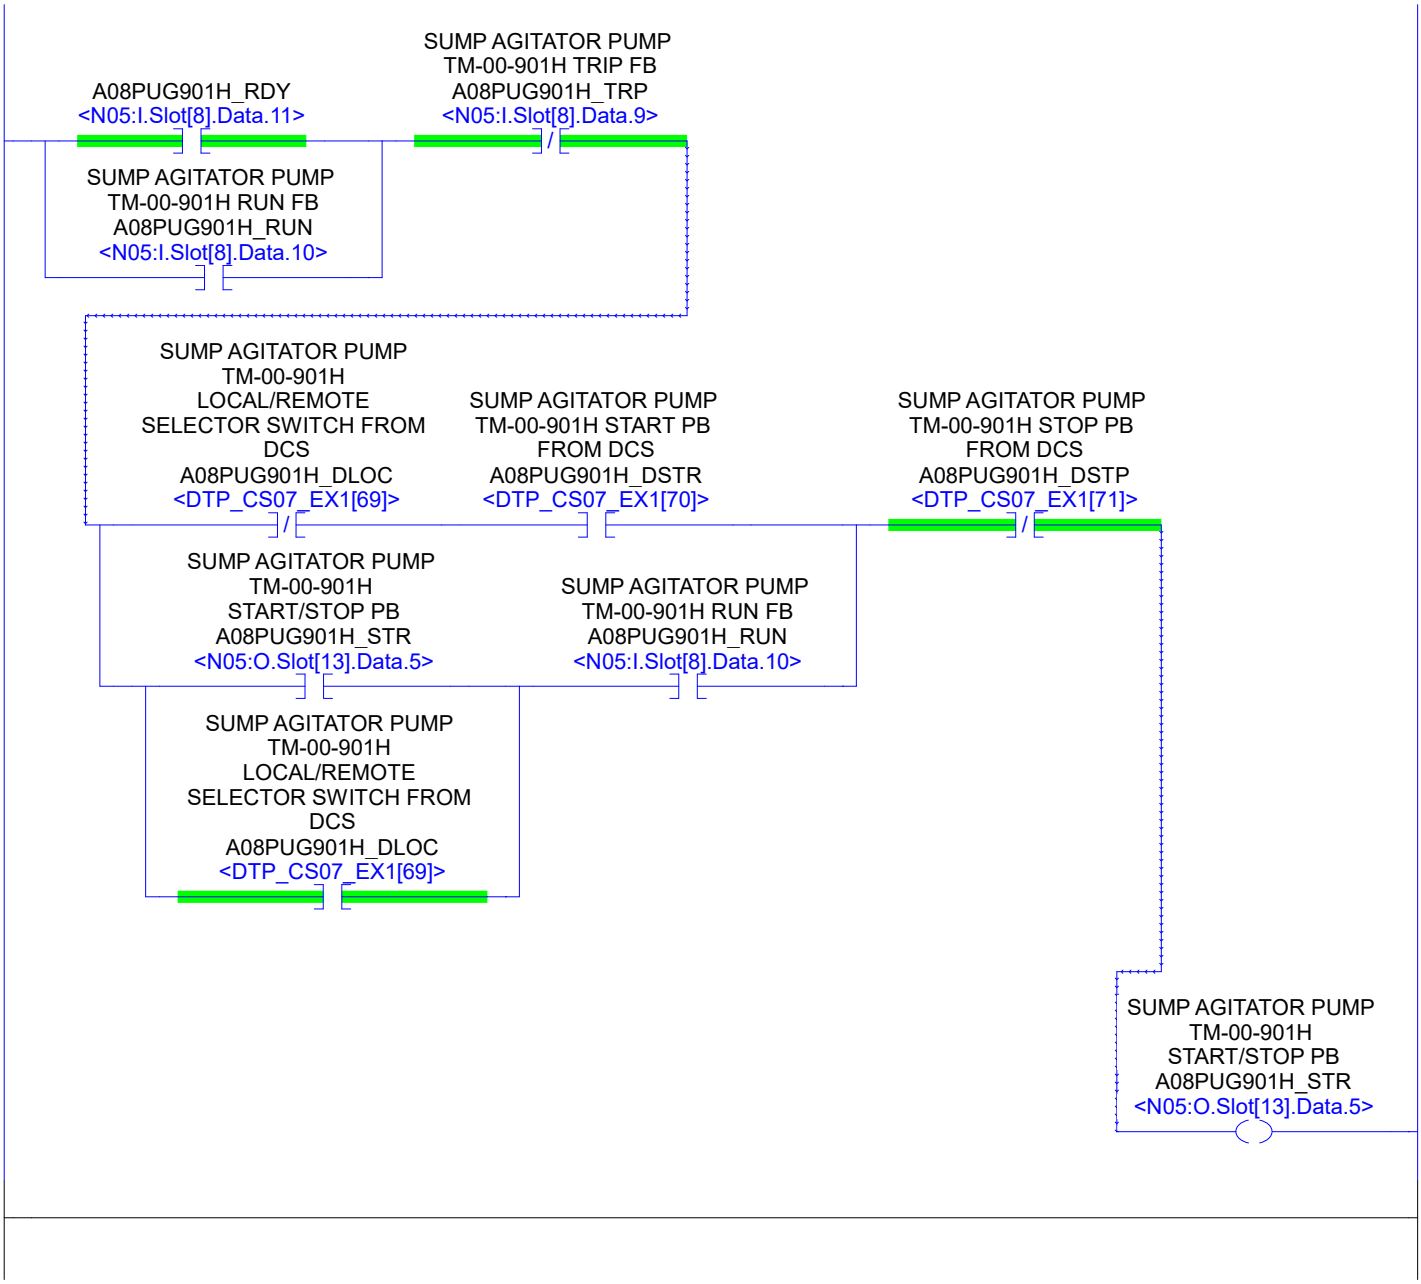
A08PUG901H_RDY
<N05:I.Slot[8].Data.11>
SUMP AGITATOR PUMP
TM-00-901H TRIP FB
A08PUG901H_TRP
<N05:I.Slot[8].Data.9>
SUMP AGITATOR PUMP
TM-00-901H RUN FB
A08PUG901H_RUN
<N05:I.Slot[8].Data.10>
SUMP AGITATOR PUMP
TM-00-901H
LOCAL/REMOTE
SELECTOR SWITCH FROM
DCS
A08PUG901H_DLOC
<DTP_CS07_EX1[69]>
SUMP AGITATOR PUMP
TM-00-901H START PB
FROM DCS
A08PUG901H_DSTR
<DTP_CS07_EX1[70]>
SUMP AGITATOR PUMP
TM-00-901H STOP PB
FROM DCS
A08PUG901H_DSTP
<DTP_CS07_EX1[71]>
SUMP AGITATOR PUMP
TM-00-901H
START/STOP PB
A08PUG901H_STR
<N05:O.Slot[13].Data.5>
SUMP AGITATOR PUMP
TM-00-901H RUN FB
A08PUG901H_RUN
<N05:I.Slot[8].Data.10>
SUMP AGITATOR PUMP
TM-00-901H
LOCAL/REMOTE
SELECTOR SWITCH FROM
DCS
A08PUG901H_DLOC
<DTP_CS07_EX1[69]>
SUMP AGITATOR PUMP
TM-00-901H
START/STOP PB
A08PUG901H_STR
<N05:O.Slot[13].Data.5>

(End)