


AOV.01 & AOV.02 - UNIT ELEVATION, VIEWED FROM OUTSIDE (2NO IDENTICAL)

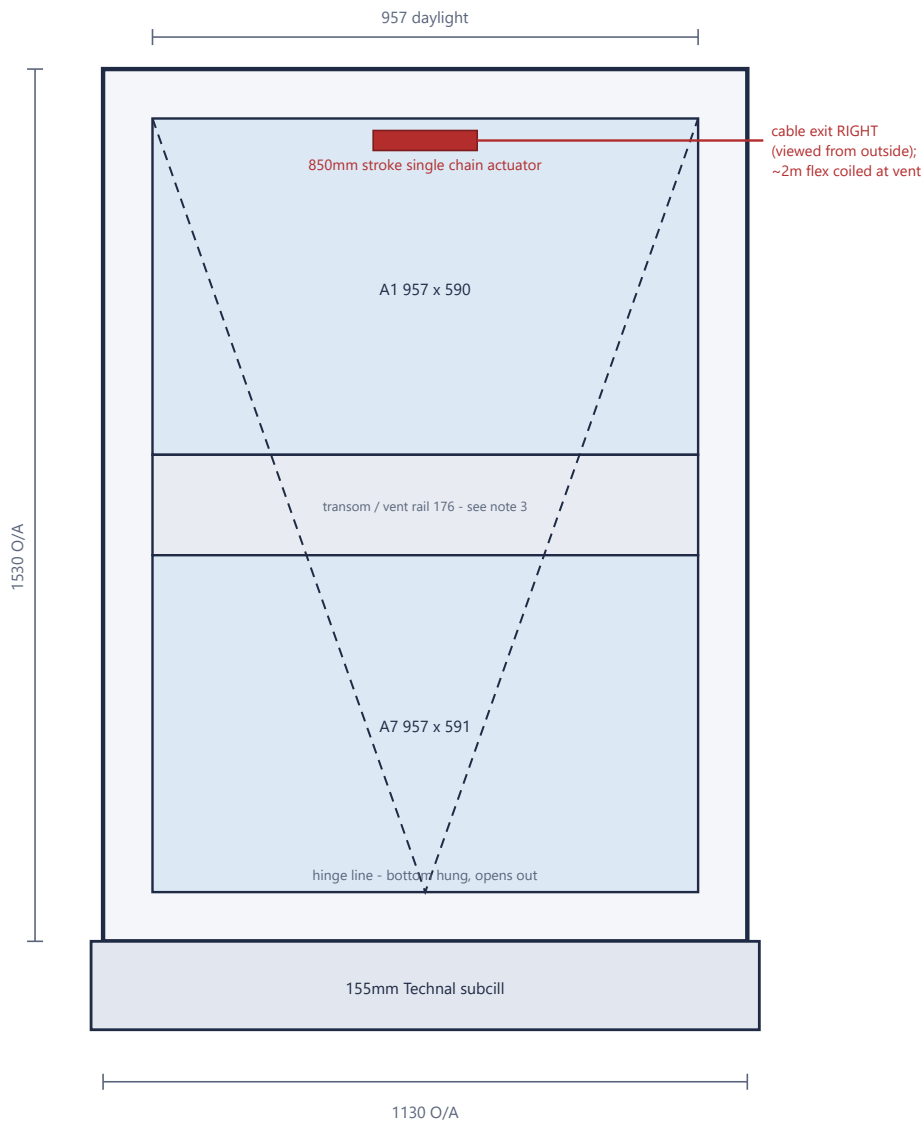


SPECIFICATION - AS QUOTED, A PLUS QT51518

System	Sapa DualFrame 75Si casement, style FF, open out, glazed in
Quantity	2no - one per stairwell (see sheet 2)
O/A size	1130mm x 1530mm
Colour	White frame / white sash / white cill (single colour both faces)
Cill	155mm subcill (Technal) - Adam's enquiry asked 150mm
Glass	4-20-4 Clr Tough S Coat 1.2 / 20mm black warm edge
AOV	850mm stroke, single chain, 24v DC, actuator colour 9006 satin
Cable	Exit right viewed from outside; NOT run through mullions
Ironmongery	No handle, no restrictor, no casement locking, no PAS 24
Free area	Geometric 1.30 m² per vent, based on a 50mm reveal. Aerodynamic free area not stated - see RFI-1
Supply basis	Supply only, delivered, glazed. Installation by Fenster.

NOTES

- Sizes and configuration are taken from A Plus QT51518. The tender pack contains **no window schedule and no dimensioned opening** - the 1130 x 1530 originates from Fenster's enquiry of 24/07/2026, not from the architect's drawings.
- Apertures A1 (957 x 590) and A7 (957 x 591) are the glazed apertures stated on the quote, confirming a transom-divided frame.
- The vent leaf is not identified on the quote.** A single 850mm stroke chain actuator is quoted against a frame whose individual apertures are ~590mm high, so the opening leaf cannot be a single aperture. Vent leaf, rail position and actuator position shown indicatively - to be confirmed on A Plus shop drawings before order (RFI-2).
- Actuators are **not** restrictors. A Plus disclaim liability for damage where a separate restrictor is not fitted, set 50mm beyond the actuator stroke. Not in the quoted price.
- Vents below 2.5m from FFL carry a trap-hazard risk under BS EN 60335-2; below 1100mm from FFL, Part K anti-fall protection is required and is excluded by A Plus.
- Actuators warranted 15,000 cycles or 12 months, whichever is sooner, and must be powered by an SE Controls-approved control system.
- Free area values allow nothing for obstructions, side walls or reveals.

THE CLIENT'S REQUIREMENT, AS DRAWN

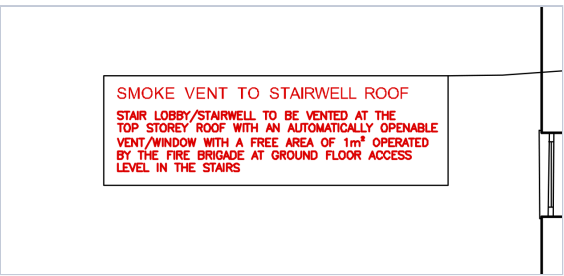


Extract, drawings K1653-11 (first floor) and K1653-12 (second floor), Campbell Ark, CONSTRUCTION ISSUE. The identical note appears on both sheets.

FREE AREA - REQUIREMENT AGAINST QUOTE


Required (drawings)	1.00 m² free area
Basis	Per stairwell. The note appears once per stairwell, at that stairwell's top storey.
Quoted (A Plus)	1.30 m² geometric
Position	Complies on a geometric reading, with 0.30 m² to spare.
If aerodynamic	A Plus's aerodynamic figures run 60-62% of geometric on the same product (QT51516, Towcester Vale: 0.49/0.81 and 0.54/0.87). On that ratio 1.30 m² geometric is roughly 0.78-0.81 m² aerodynamic - about 20% short of 1.00 m². Indicative only: different sizes, and a 900mm stroke against 850mm here.

The one question that decides this. "Free area of 1m²" is not qualified on the drawing. On a geometric reading the vents as quoted comply comfortably. On an aerodynamic reading they do not, and nor would A Plus's own proposed 1235 x 1583. A Plus must state the aerodynamic figure for the actual Riverside sizes, and the fire strategy must confirm which basis applies.

LOCATIONS - ONE VENT PER STAIRWELL, AT THAT STAIRWELL'S TOP STOREY

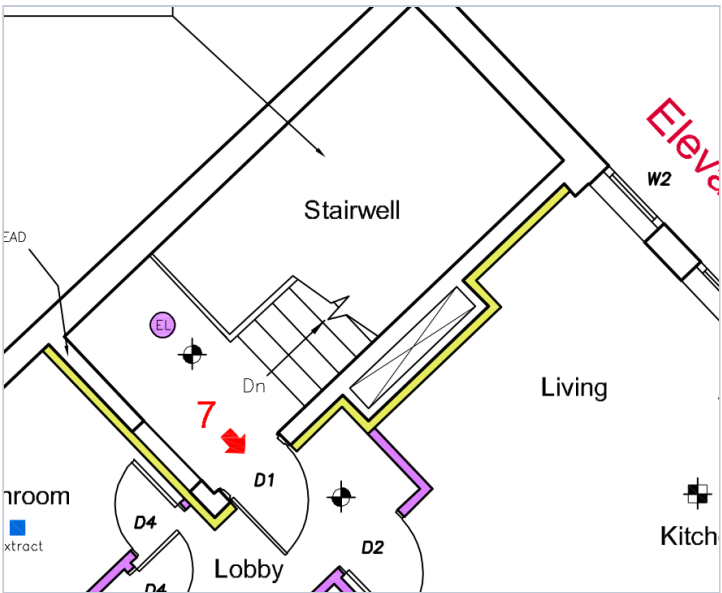

AOV.01 - Stairwell 1, SECOND FLOOR (top storey of the corner block). Drawing K1653-12, note leader 7.

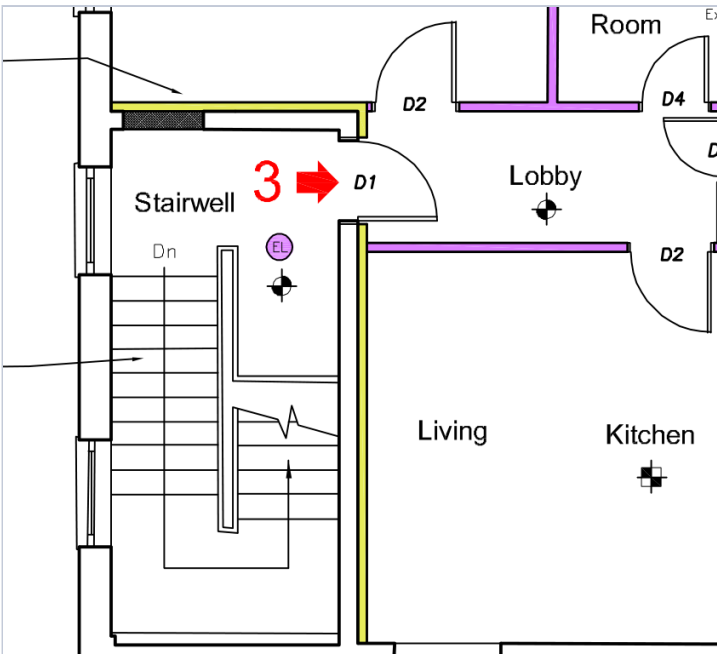

AOV.02 - Stairwell 2, FIRST FLOOR (top storey of this wing). Drawing K1653-11, note leader 3.

EXCLUDED FROM THIS DRAWING AND FROM THE PRICE

- The AOV control system in its entirety** - smoke control panel, mains and battery-backed supply, cabling and containment from panel to vent, the fire brigade override at ground floor access level required by the note above, interfacing, commissioning and the O&M / EN 12101 documentation. A Plus fix the actuator, test it on local batteries and leave ~2m of flex coiled at the vent.
The drawing's requirement cannot be met by the window alone.
- Window restrictors (note 4).
- Builder's work - forming, adapting or making good openings, lintels, internal finishes. Understood to sit with PHDB under the building works package.
- Access equipment / scaffold to top-storey level.
- Ongoing maintenance of the life-safety system, which is a legal duty of the occupier or agent under the Regulatory Reform (Fire Safety) Order 2005.

- RFI-1** - A Plus to state the **aerodynamic** free area for 1130 x 1530 at 850mm stroke. QT51518 gives geometric only; their QT51516 states both on every line.
- RFI-2** - A Plus to confirm the vent leaf, rail position and actuator position on shop drawings.
- RFI-3** - Client / fire strategy to confirm whether the 1m² on K1653-11 and K1653-12 is geometric or aerodynamic free area, and to confirm the source of the 1.5m² figure in Fenster's enquiry of 24/07/2026, which does not appear anywhere in the pack.
- RFI-4** - Who is carrying the AOV control system, cabling and fire brigade override?
- RFI-5** - Confirm cill height above FFL at each vent (BS EN 60335-2 trap hazard below 2.5m, Part K anti-fall below 1100mm), and confirm 155mm subcill is acceptable against the 150mm enquired.