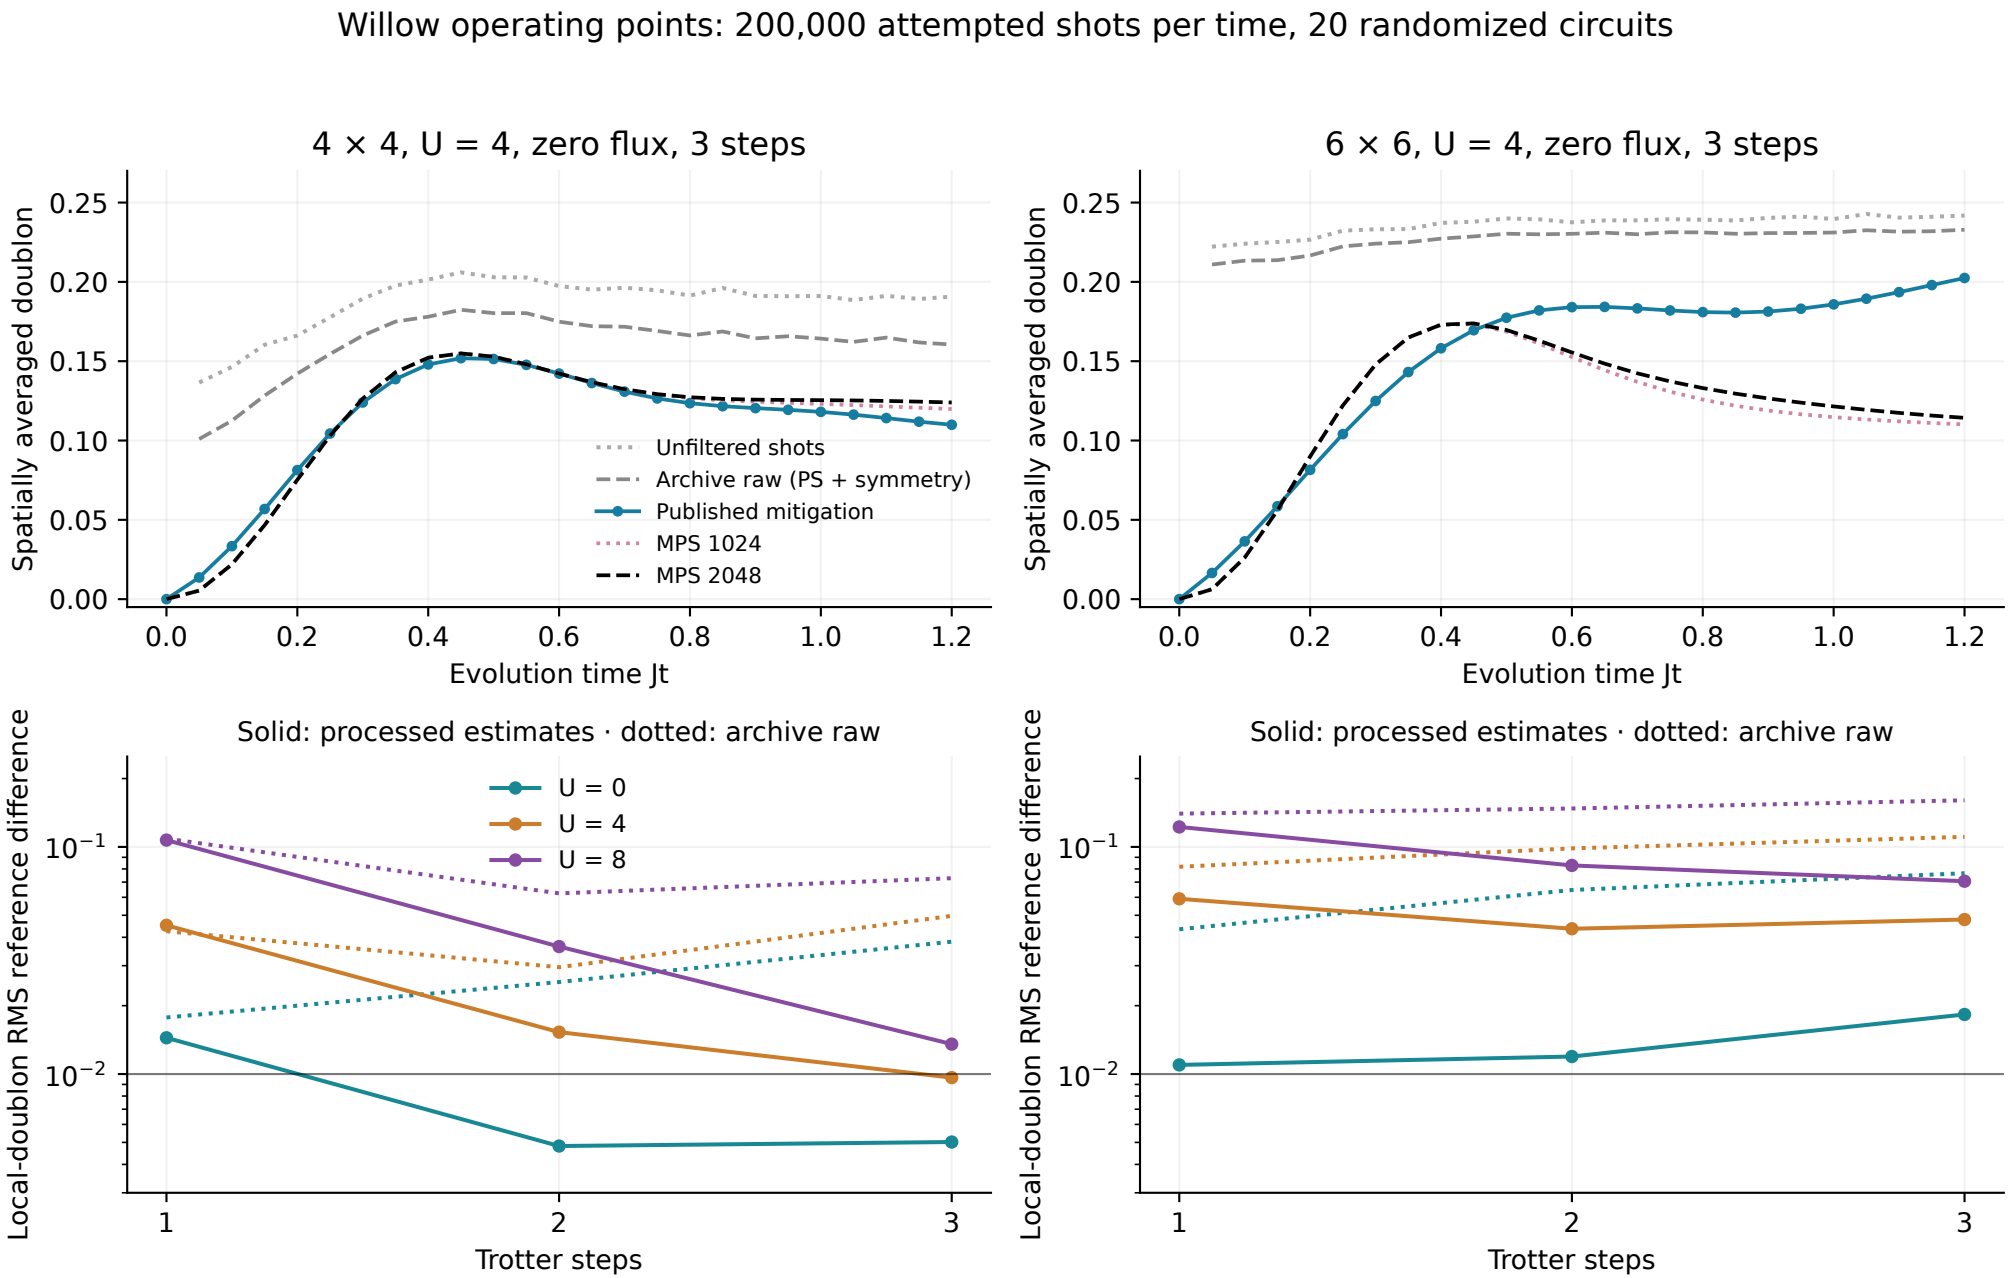


Lower panels use all 24 times and every site. U=0: exact continuous FLO, but mitigation used training data.
U>0: finite-bond MPS reference agreement, not certified accuracy. Derived-observable error covariances are not supplied.