
Finnrick Analytics
Finnrick.com


COC# 145615
Lab # 211288
Date Rec'd 8/11/2026
Report Issued 9/30/2026

Certificate of Analysis

Compound CJC No DAC/Ipamorelin
Label Claim 5+5 mg

Vendor
Batch/Lot cv2kncp

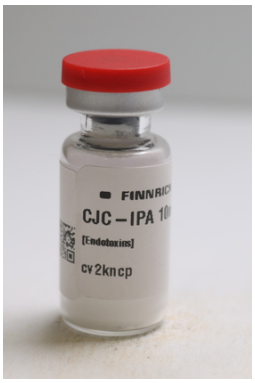

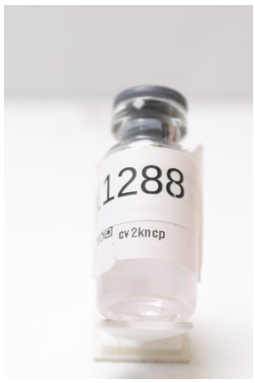

Analyte	Result	Units	LOQ	% of Label	Method	Date	CAS
Peptides & Bioactives							
Chromatographic purity	98.5	%	1		HPLC-UV/MS	8/19/2026	
CJC-1295	4.46	mg	.1	89.2	HPLC-UV-MS	8/19/2026	446036-97-1
Mass Spectral Match	ID Confirmed				HPLC-UV-MS	8/19/2026	
Ipamorelin	4.47	mg	.1	89.3	HPLC-UV-MS	8/19/2026	170851-70-4
Mass Spectral Match	ID Confirmed				HPLC-UV-MS	8/19/2026	
Microbiology							
Endotoxins rRC	ND	EU	1		USP 86	8/21/2026	

The data presented are from the analysis of the sample shown and meet Krause Analytical internal quality assurance criteria unless otherwise flagged.
Data is not for regulatory compliance nor diagnostic use.
Methods shown reference current Krause Analytical SOPs
ND - Not detected LOQ - limit of quantification
OCH - above calibrated range OCL - below calibrated range
All values reported on a per vial basis unless otherwise noted
Copyright © 2026 Krause Analytical LLC. All rights reserved.


Respectfully submitted,


Mark C. Krause
Laboratory Director

****

CHROMATOGRAM

****

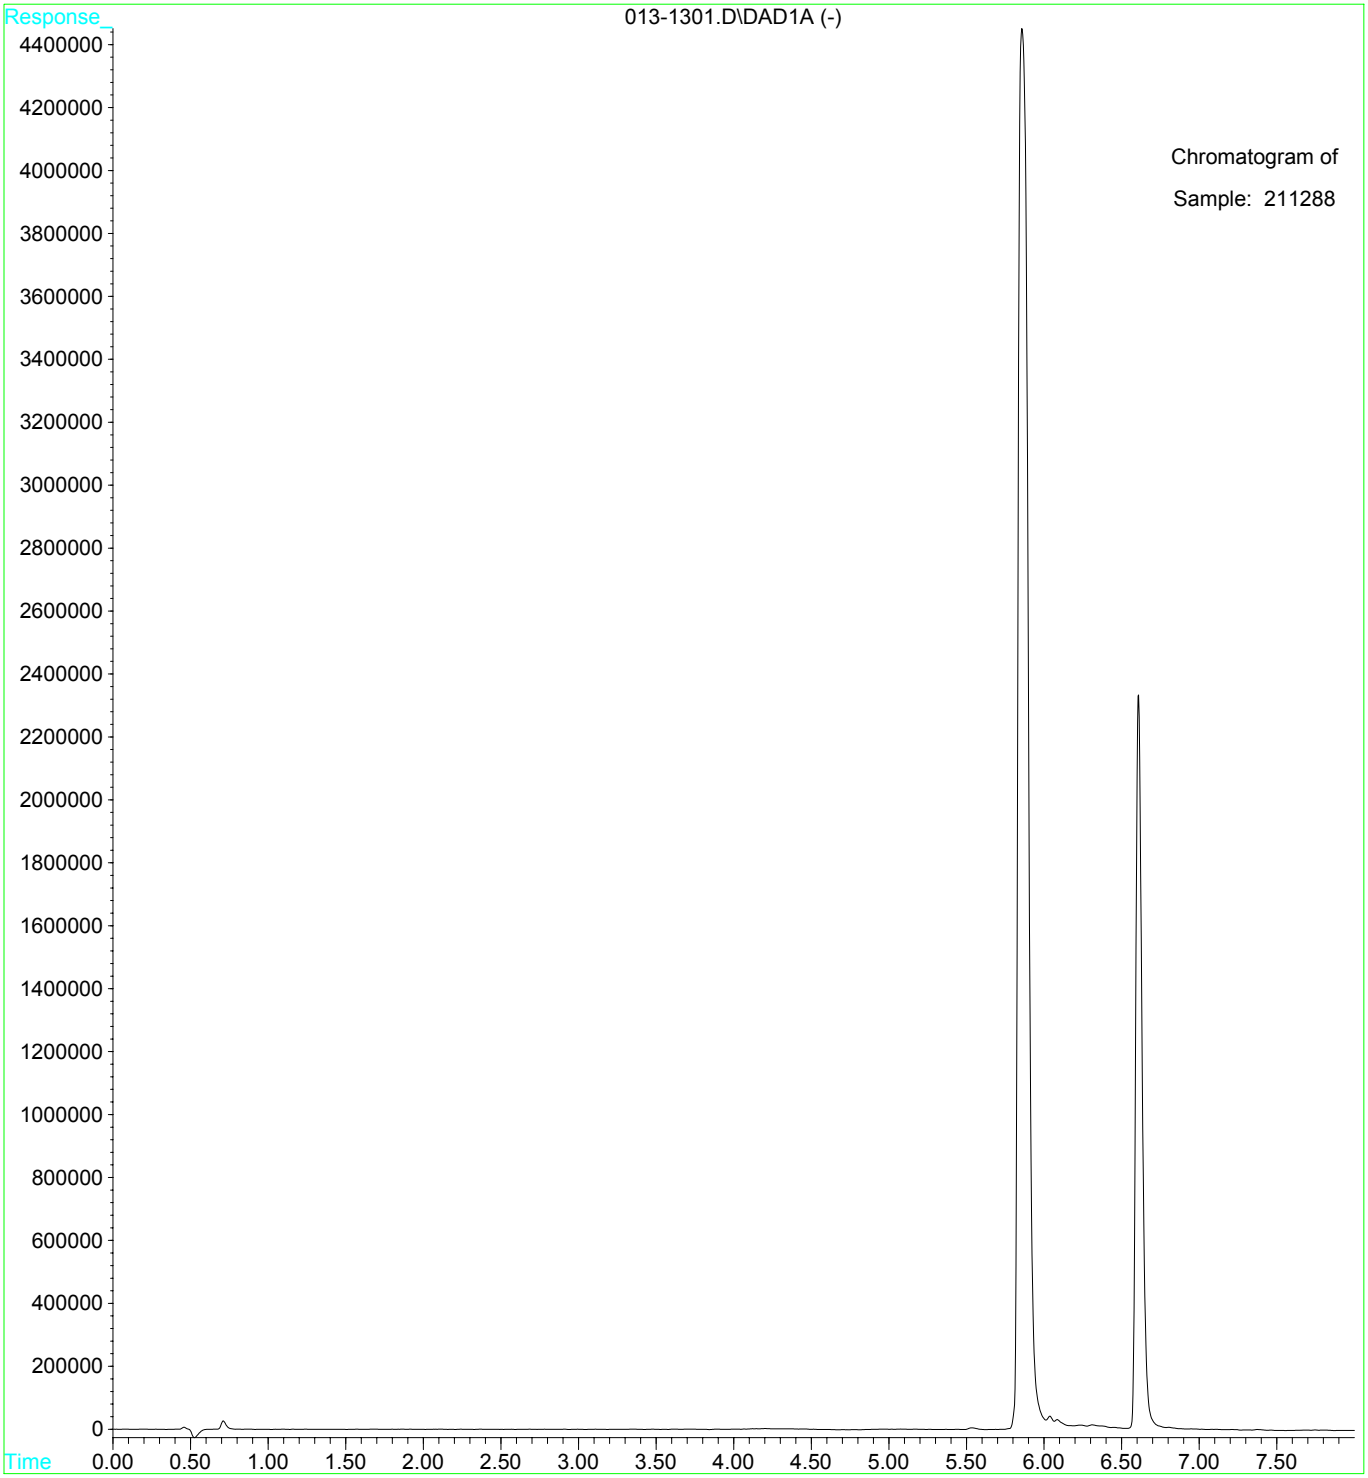

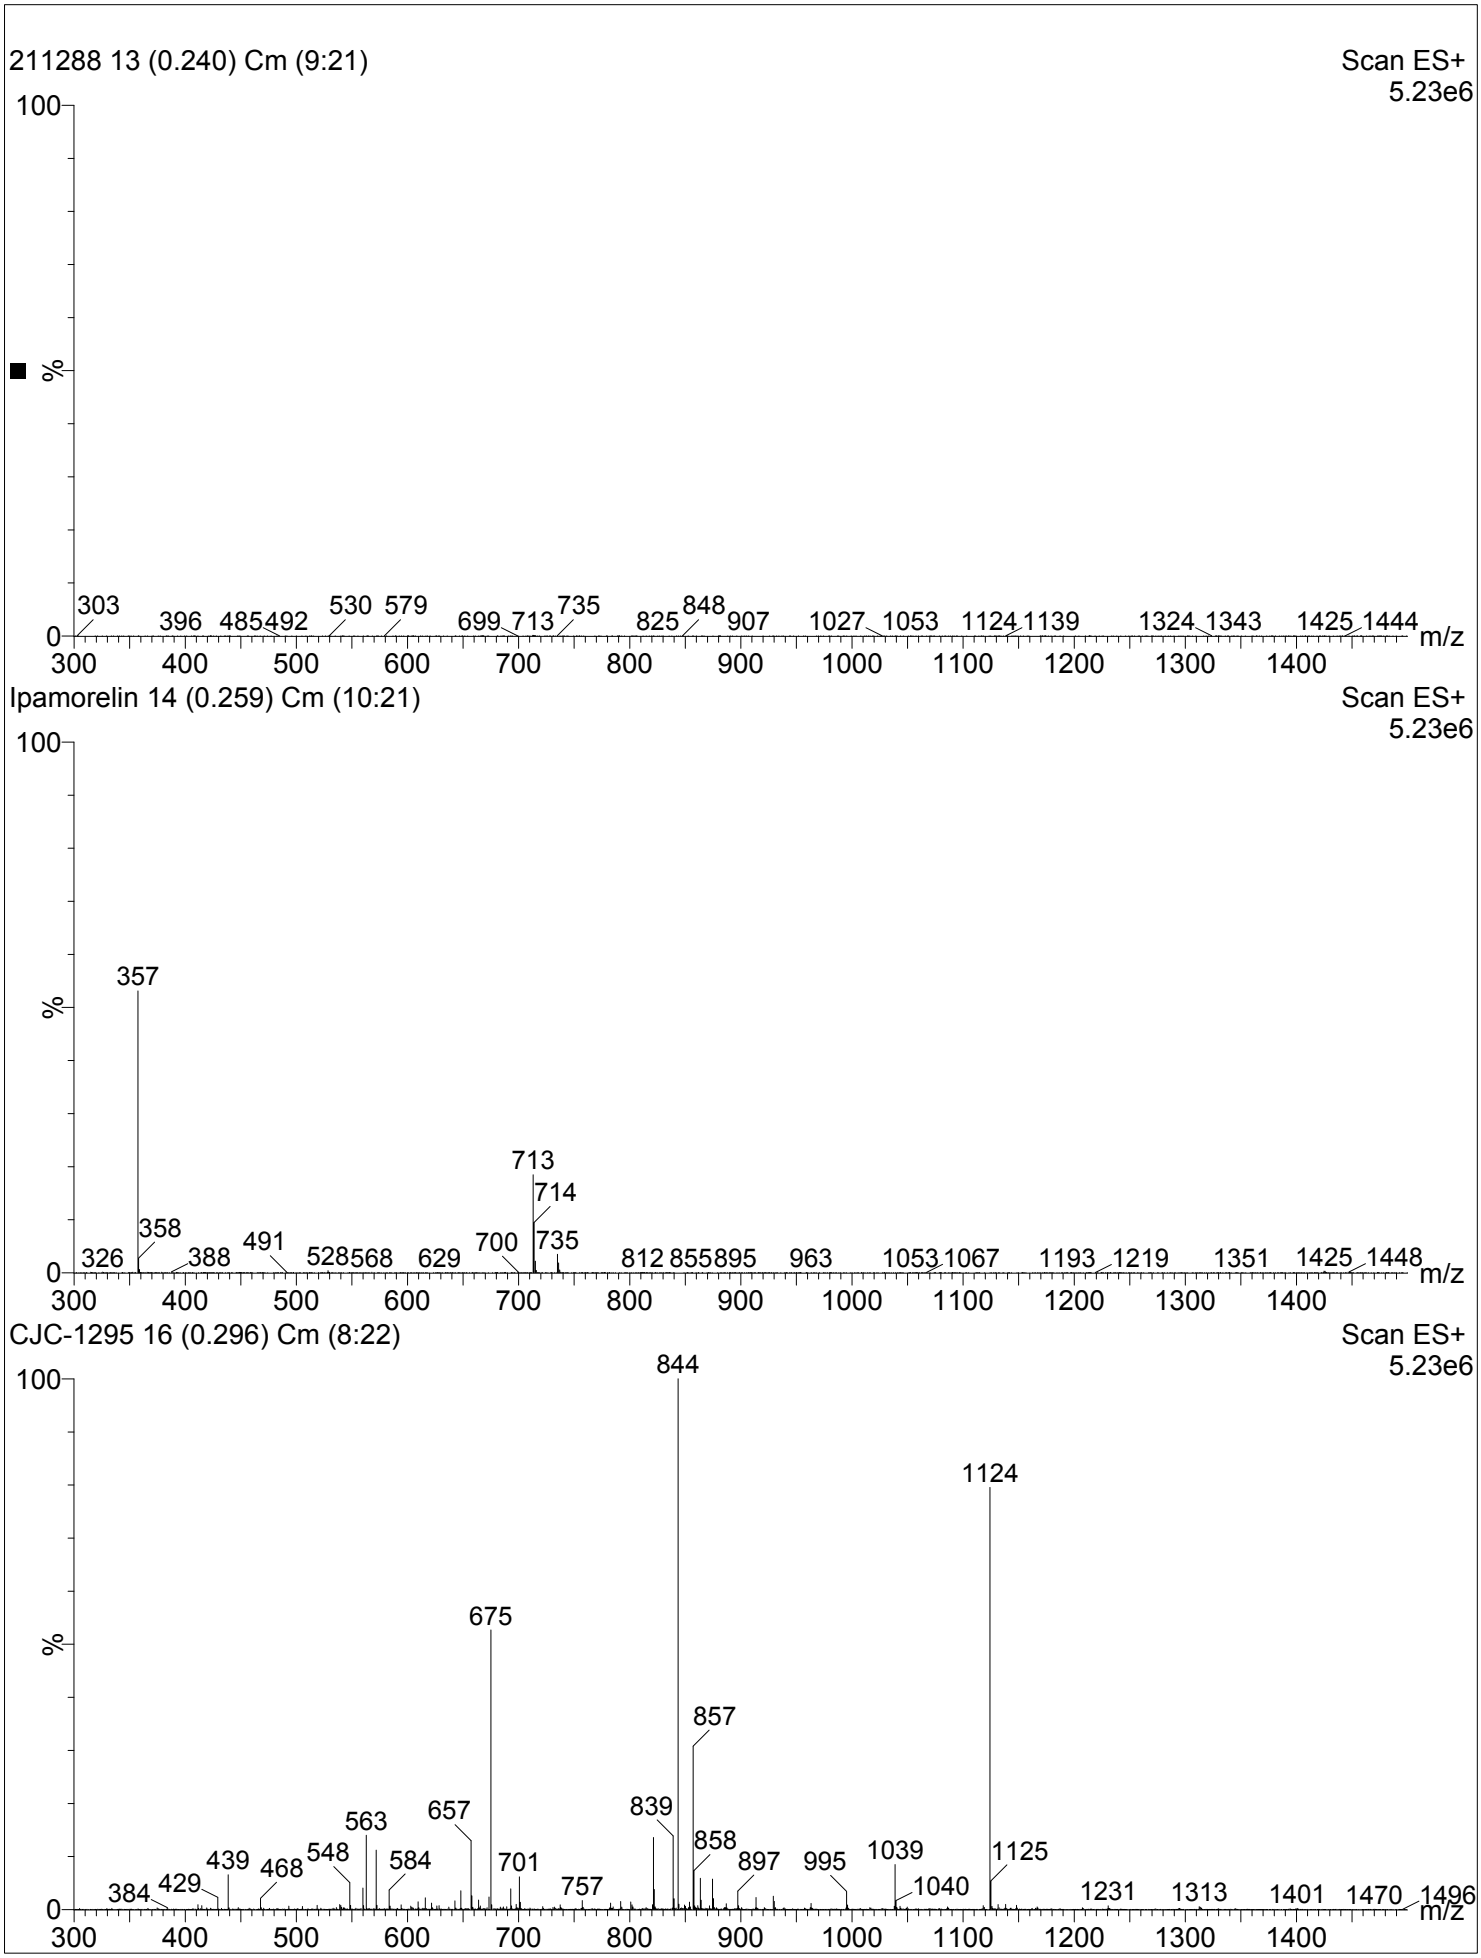
211288 13 (0.240) Cm (9:21)
Scan ES+
5.23e6
100
%
0
303
396
485
492
530
579
699
713
735
825
848
907
1027
1053
1124
1139
1324
1343
1425
1444
m/z
300
400
500
600
700
800
900
1000
1100
1200
1300
1400
Ipamorelin 14 (0.259) Cm (10:21)
Scan ES+
5.23e6
100
%
0
357
358
326
388
491
528
568
629
700
713
714
735
812
855
895
963
1053
1067
1193
1219
1351
1425
1448
m/z
300
400
500
600
700
800
900
1000
1100
1200
1300
1400
CJC-1295 16 (0.296) Cm (8:22)
Scan ES+
5.23e6
100
%
0
844
1124
675
857
563
657
839
858
439
468
548
584
701
757
897
995
1039
1125
384
429
1040
1231
1313
1401
1470
1496
m/z
300
400
500
600
700
800
900
1000
1100
1200
1300
1400

krause analytical

Methods Summary

Purity/Potency/Identification **USP/NF 621**

- 2 mL of purified water is added to the lyophilized powder in the vial, and the contents mixed to dissolve the lyophilized powder.
- An aliquot is taken from the vial and diluted to contain approximately 500 mg/L of the peptide.
- The diluted sample is analyzed by HPLC-UV-MS.
- The mass spectrum obtained is compared to an authentic standard of the peptide for identification.
- The total area of all of the peaks in the chromatogram is calculated, and the area of the peak of the peptide is divided by the total area to obtain the chromatographic purity value, reported in percent.
- The area of the peptide is compared to the area of the peptide peak in the known standard to obtain a concentration in the solution. This concentration is used to calculate the total mass of peptide in the vial, which is compared to the stated mass (label claim) and reported as both total mass in the vial and as a percent of the label claim.

Endotoxins **USP/NF 86**

- 2 mL of purified water is added to the lyophilized powder in the vial, and the contents mixed to dissolve the lyophilized powder.
- An aliquot is taken from the vial and diluted in endotoxin-free water.
- The diluted sample is analyzed for endotoxins using the LAL method.

Metals **USP/NF 233**

- 2 mL of purified water is added to the lyophilized powder in the vial, and the contents mixed to dissolve the lyophilized powder.
- An aliquot is taken from the vial and diluted in deionized water.
- The diluted aliquot is analyzed against known standards by ICP-MS