




10 ENLARGED PLAN - NORTH ELEVATOR CONTROL ROOM - ELECTRICAL  
1/4" = 1'-0"

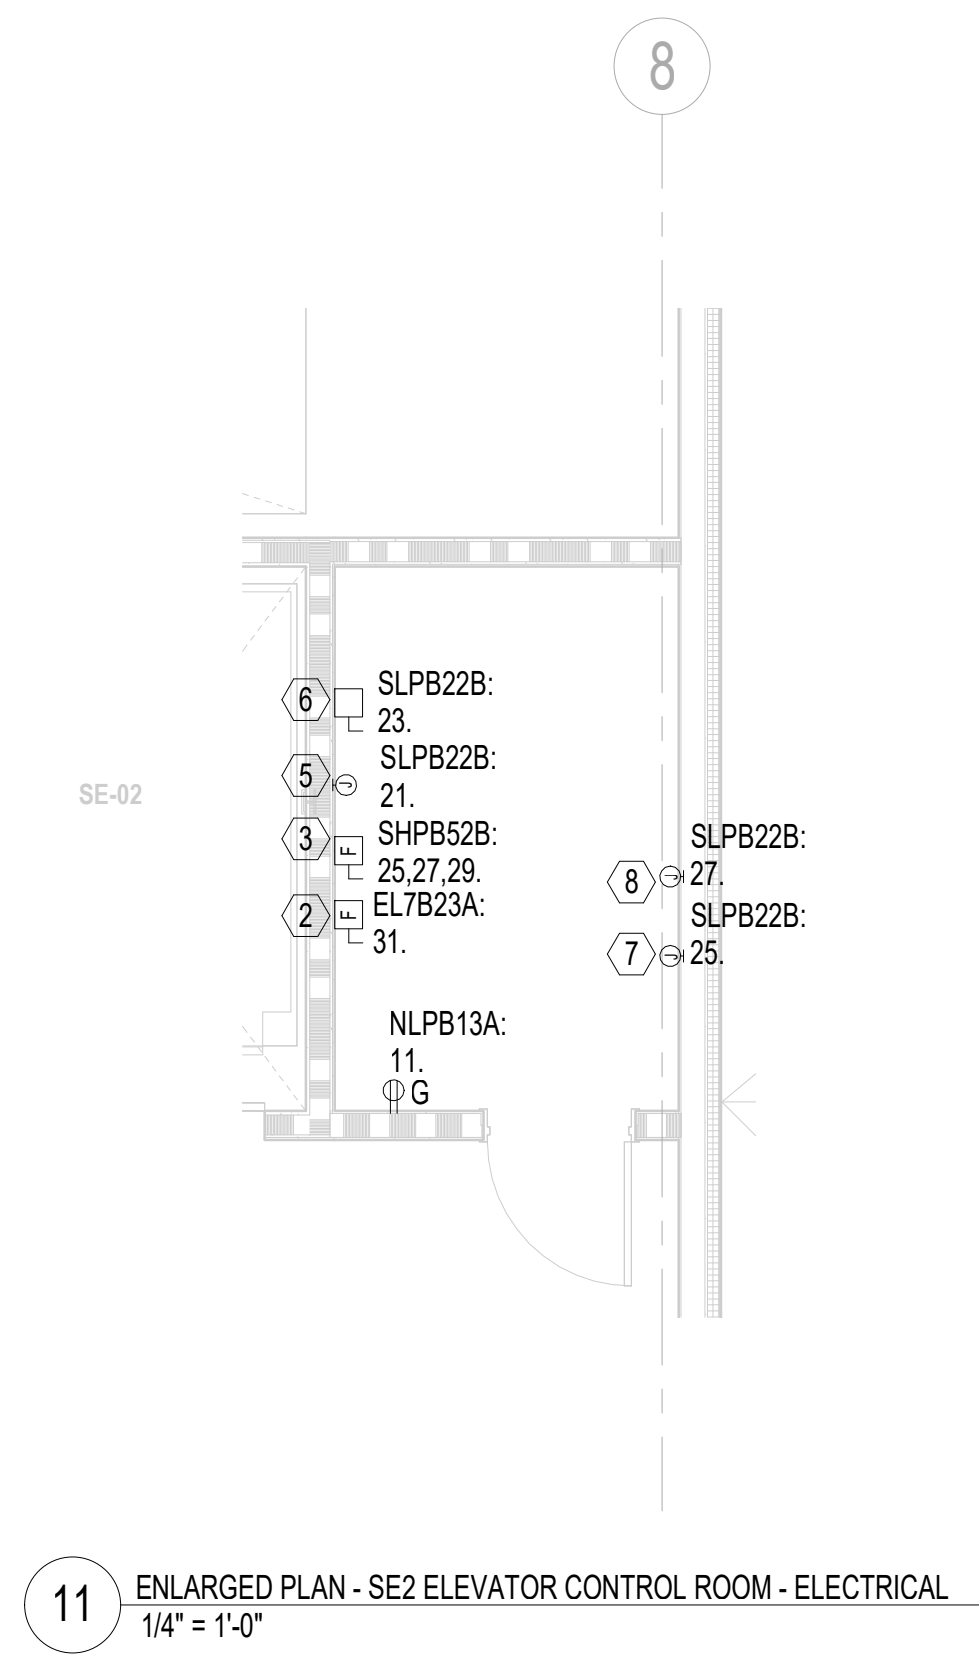


11 ENLARGED PLAN - SE2 ELEVATOR CONTROL ROOM - ELECTRICAL  
1/4" = 1'-0"

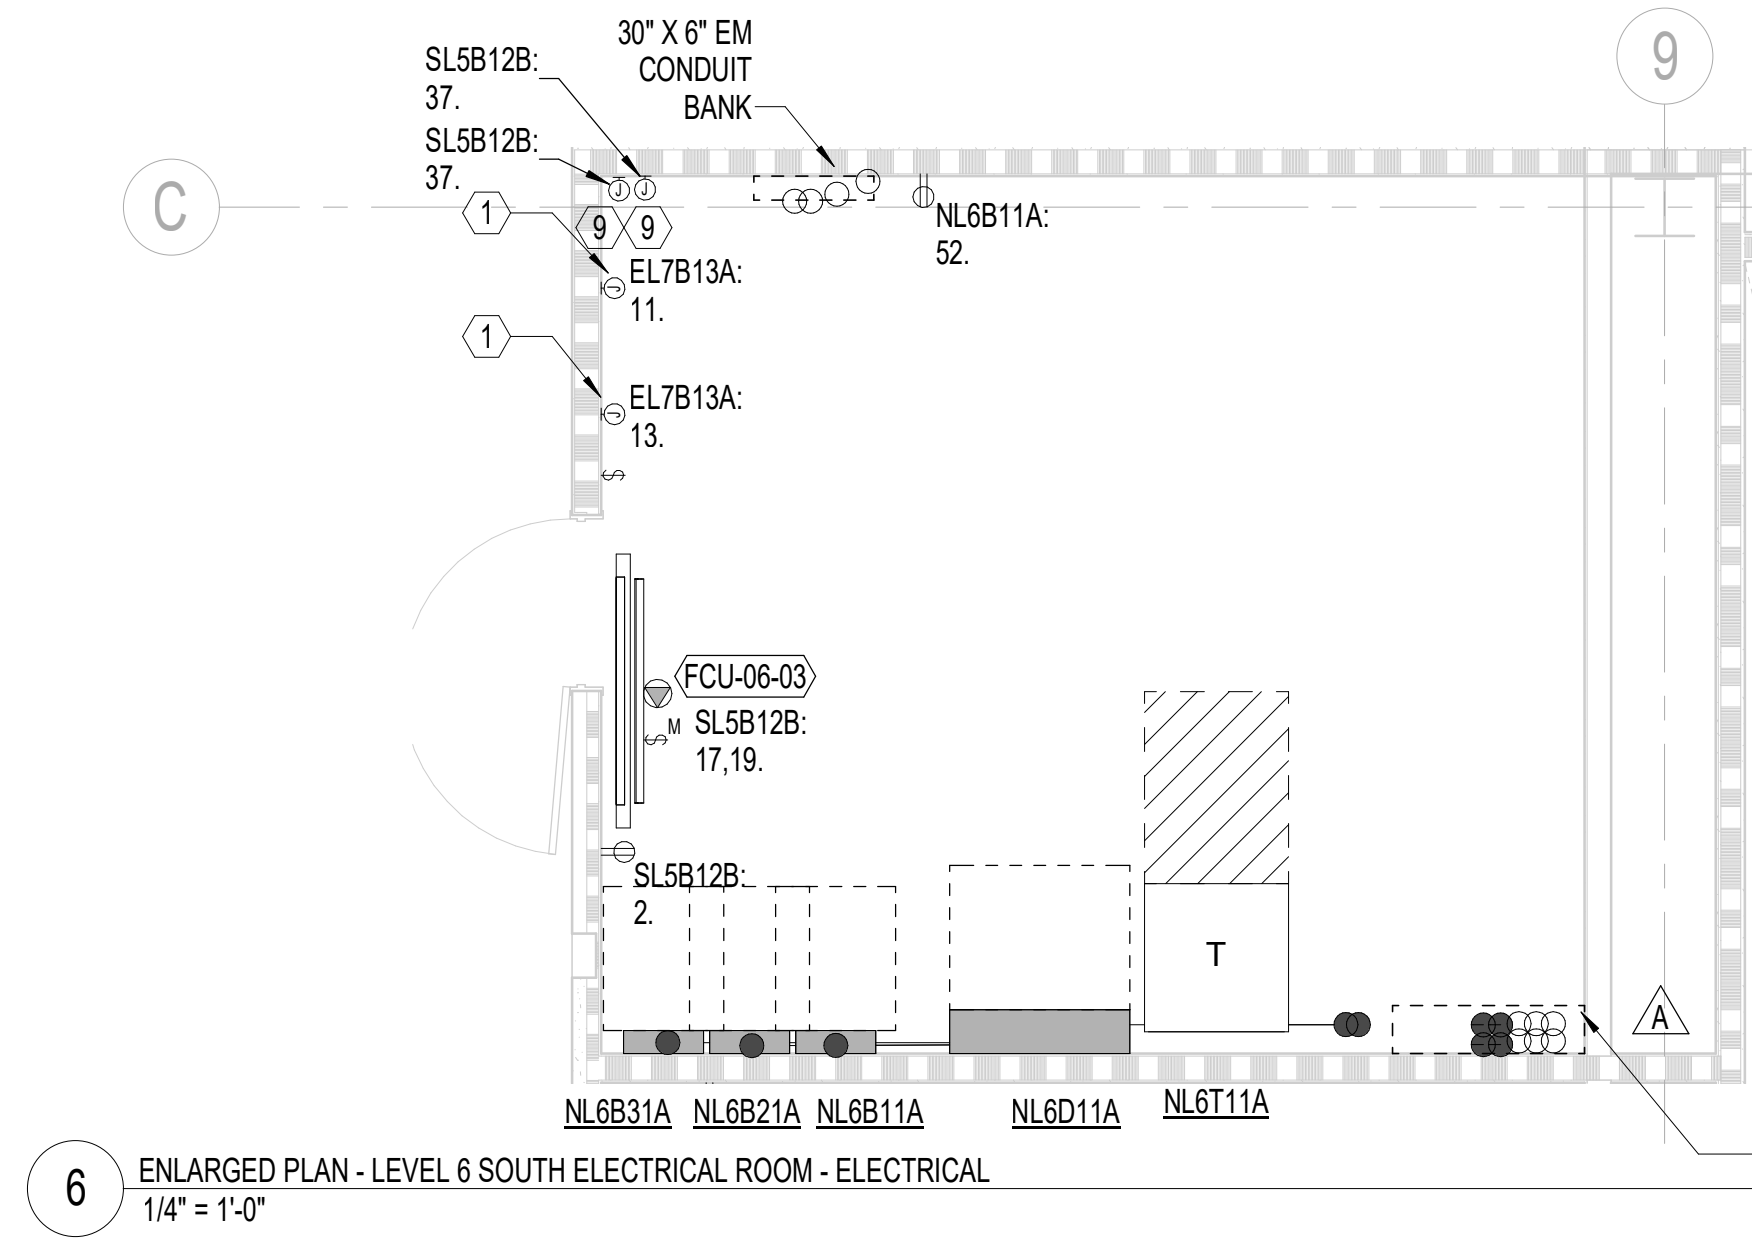


6 ENLARGED PLAN - LEVEL 6 SOUTH ELECTRICAL ROOM - ELECTRICAL  
1/4" = 1'-0"

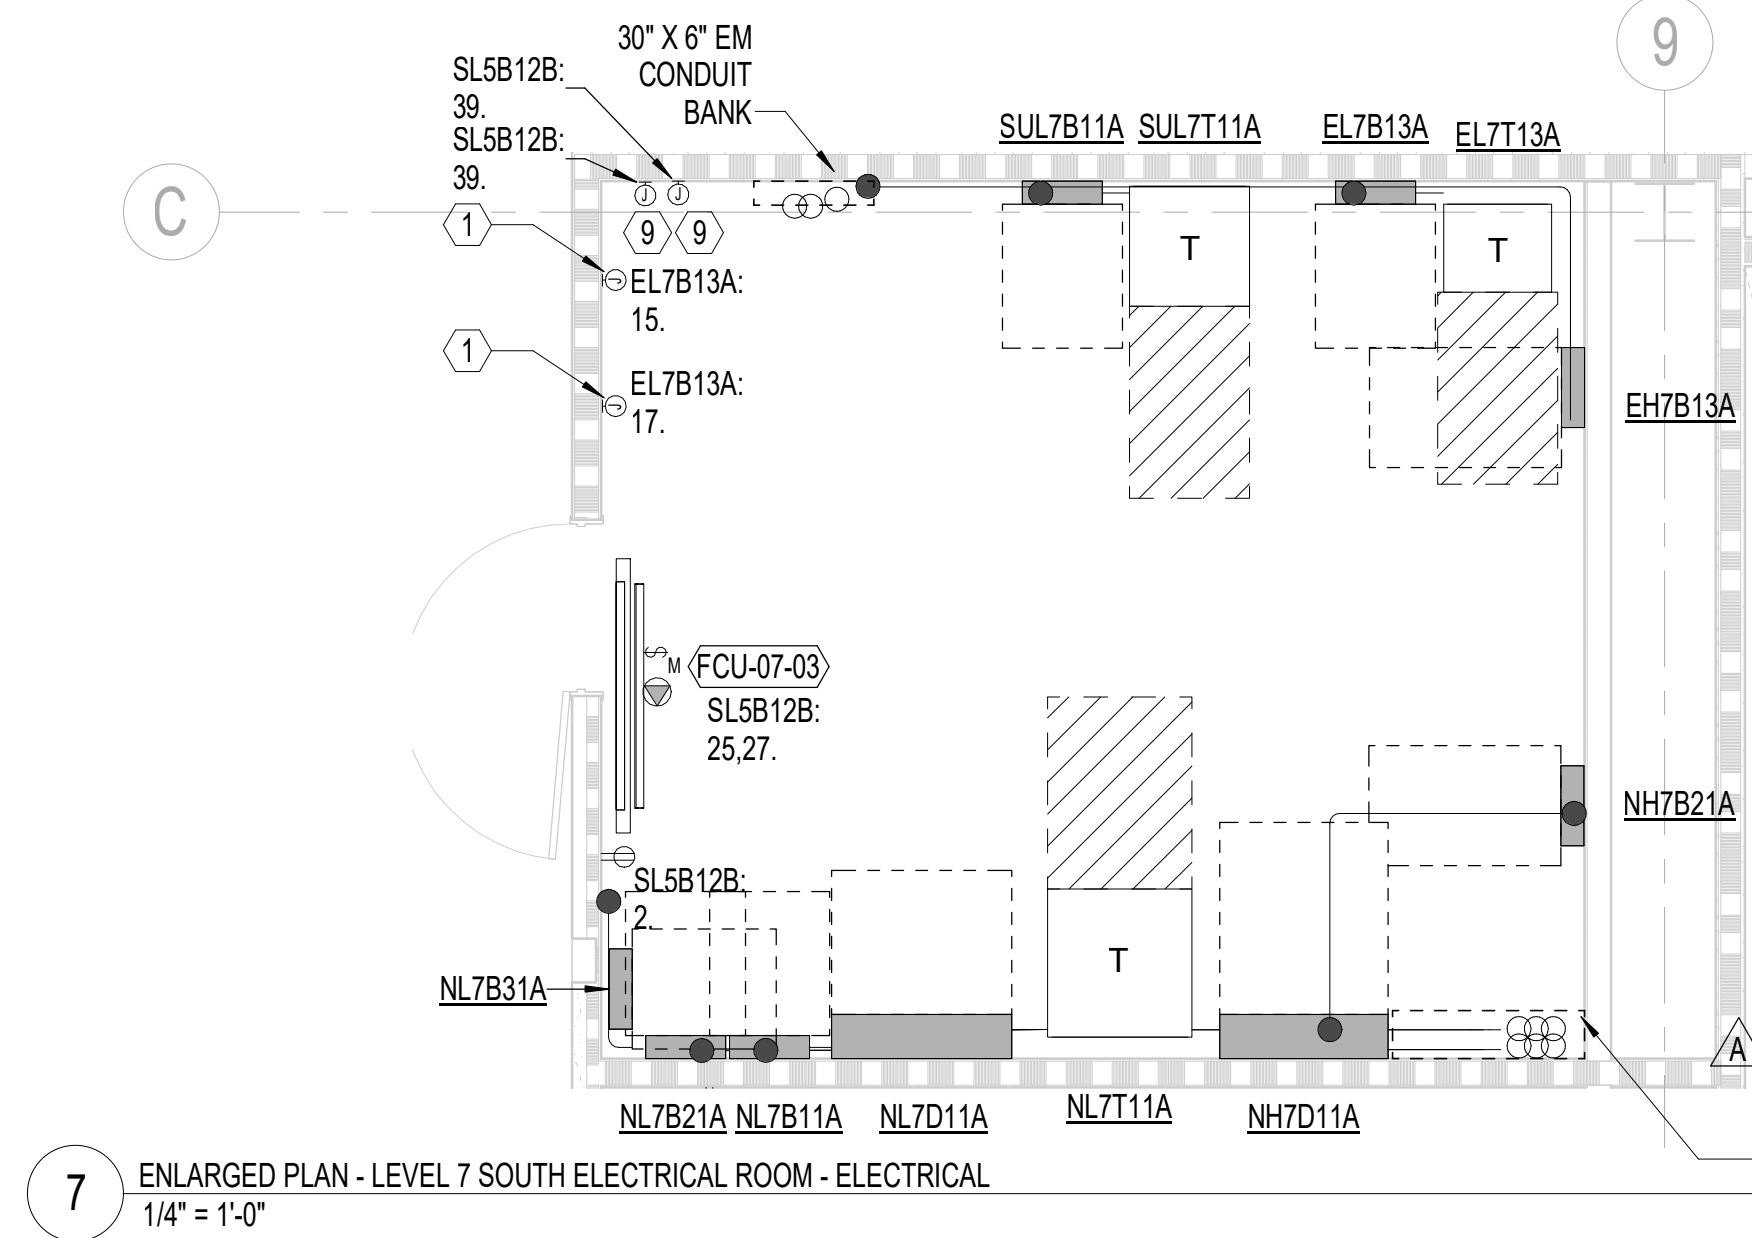


7 ENLARGED PLAN - LEVEL 7 SOUTH ELECTRICAL ROOM - ELECTRICAL  
1/4" = 1'-0"

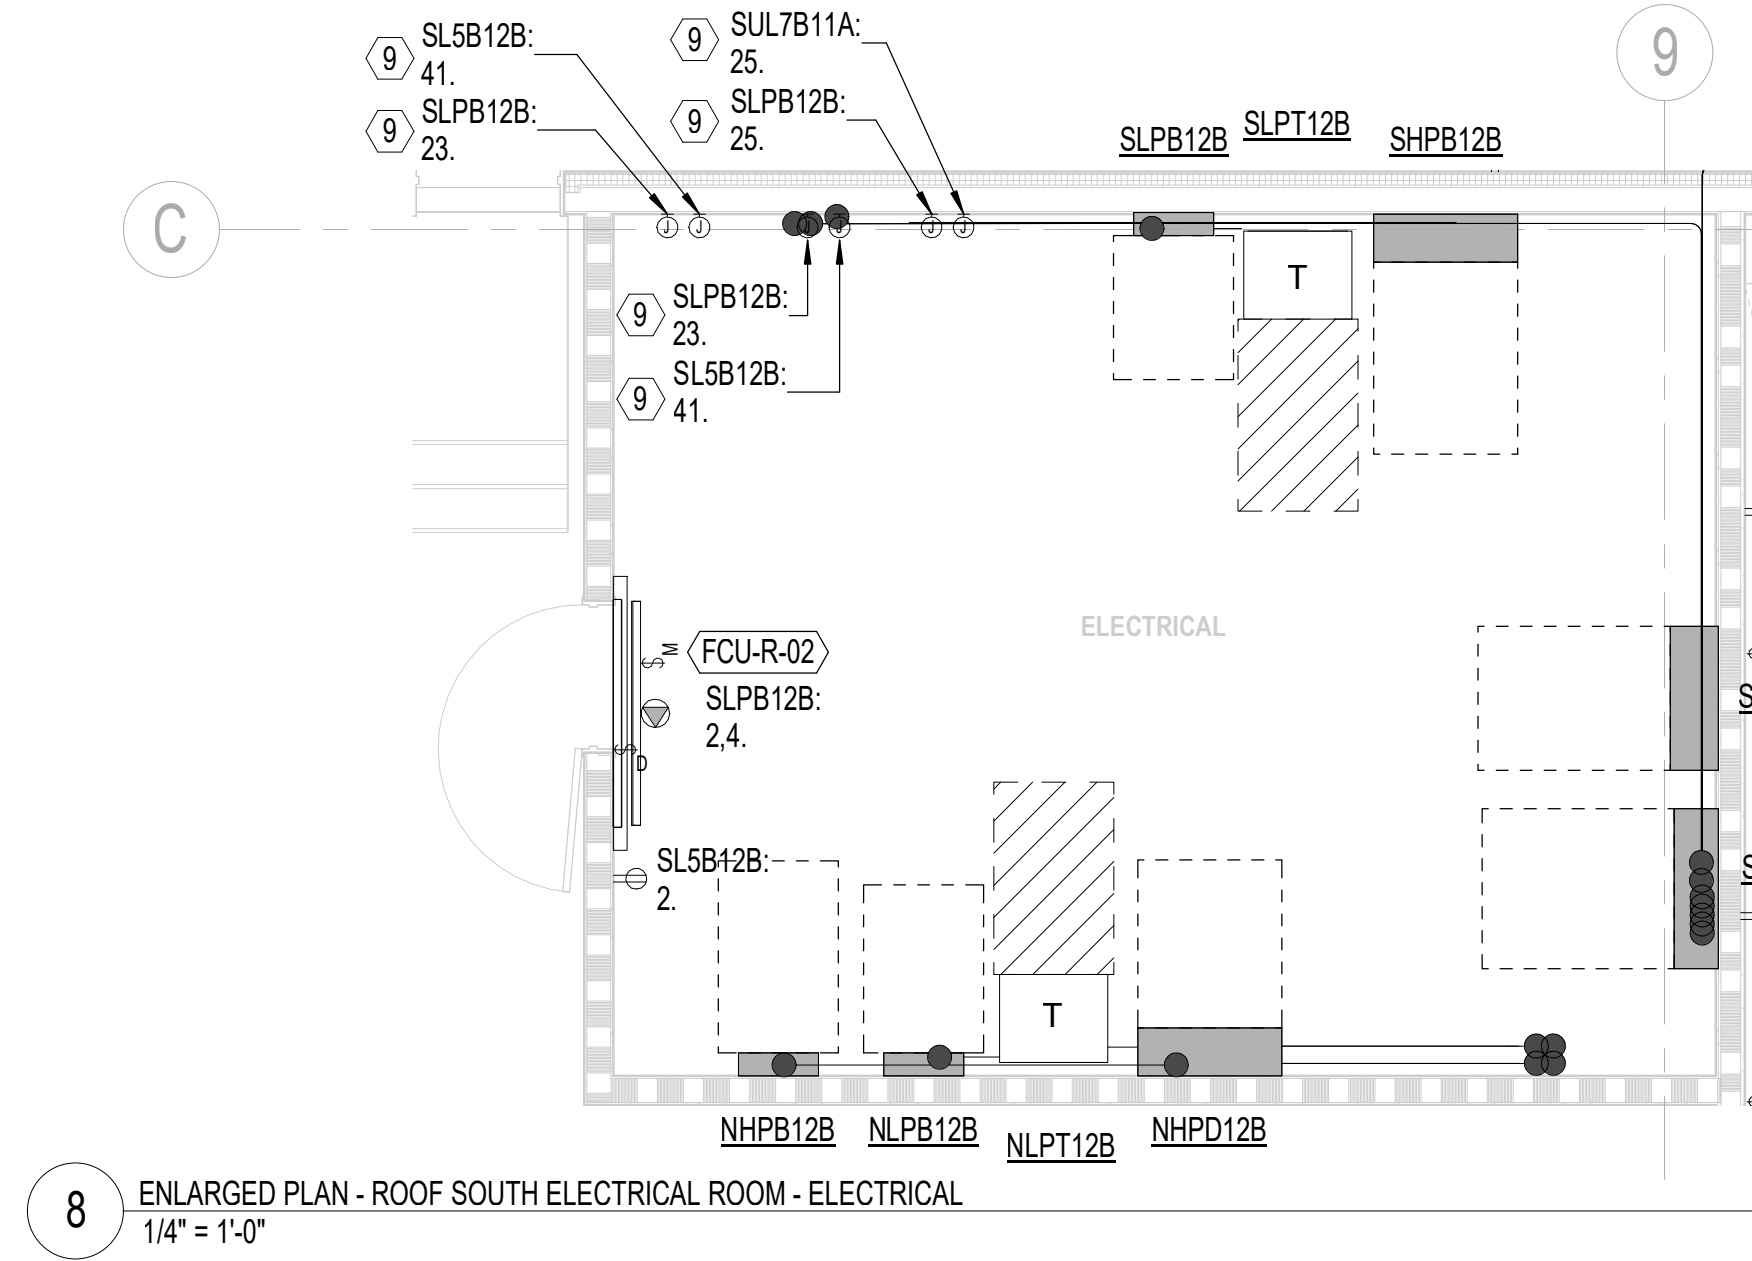


8 ENLARGED PLAN - ROOF SOUTH ELECTRICAL ROOM - ELECTRICAL  
1/4" = 1'-0"

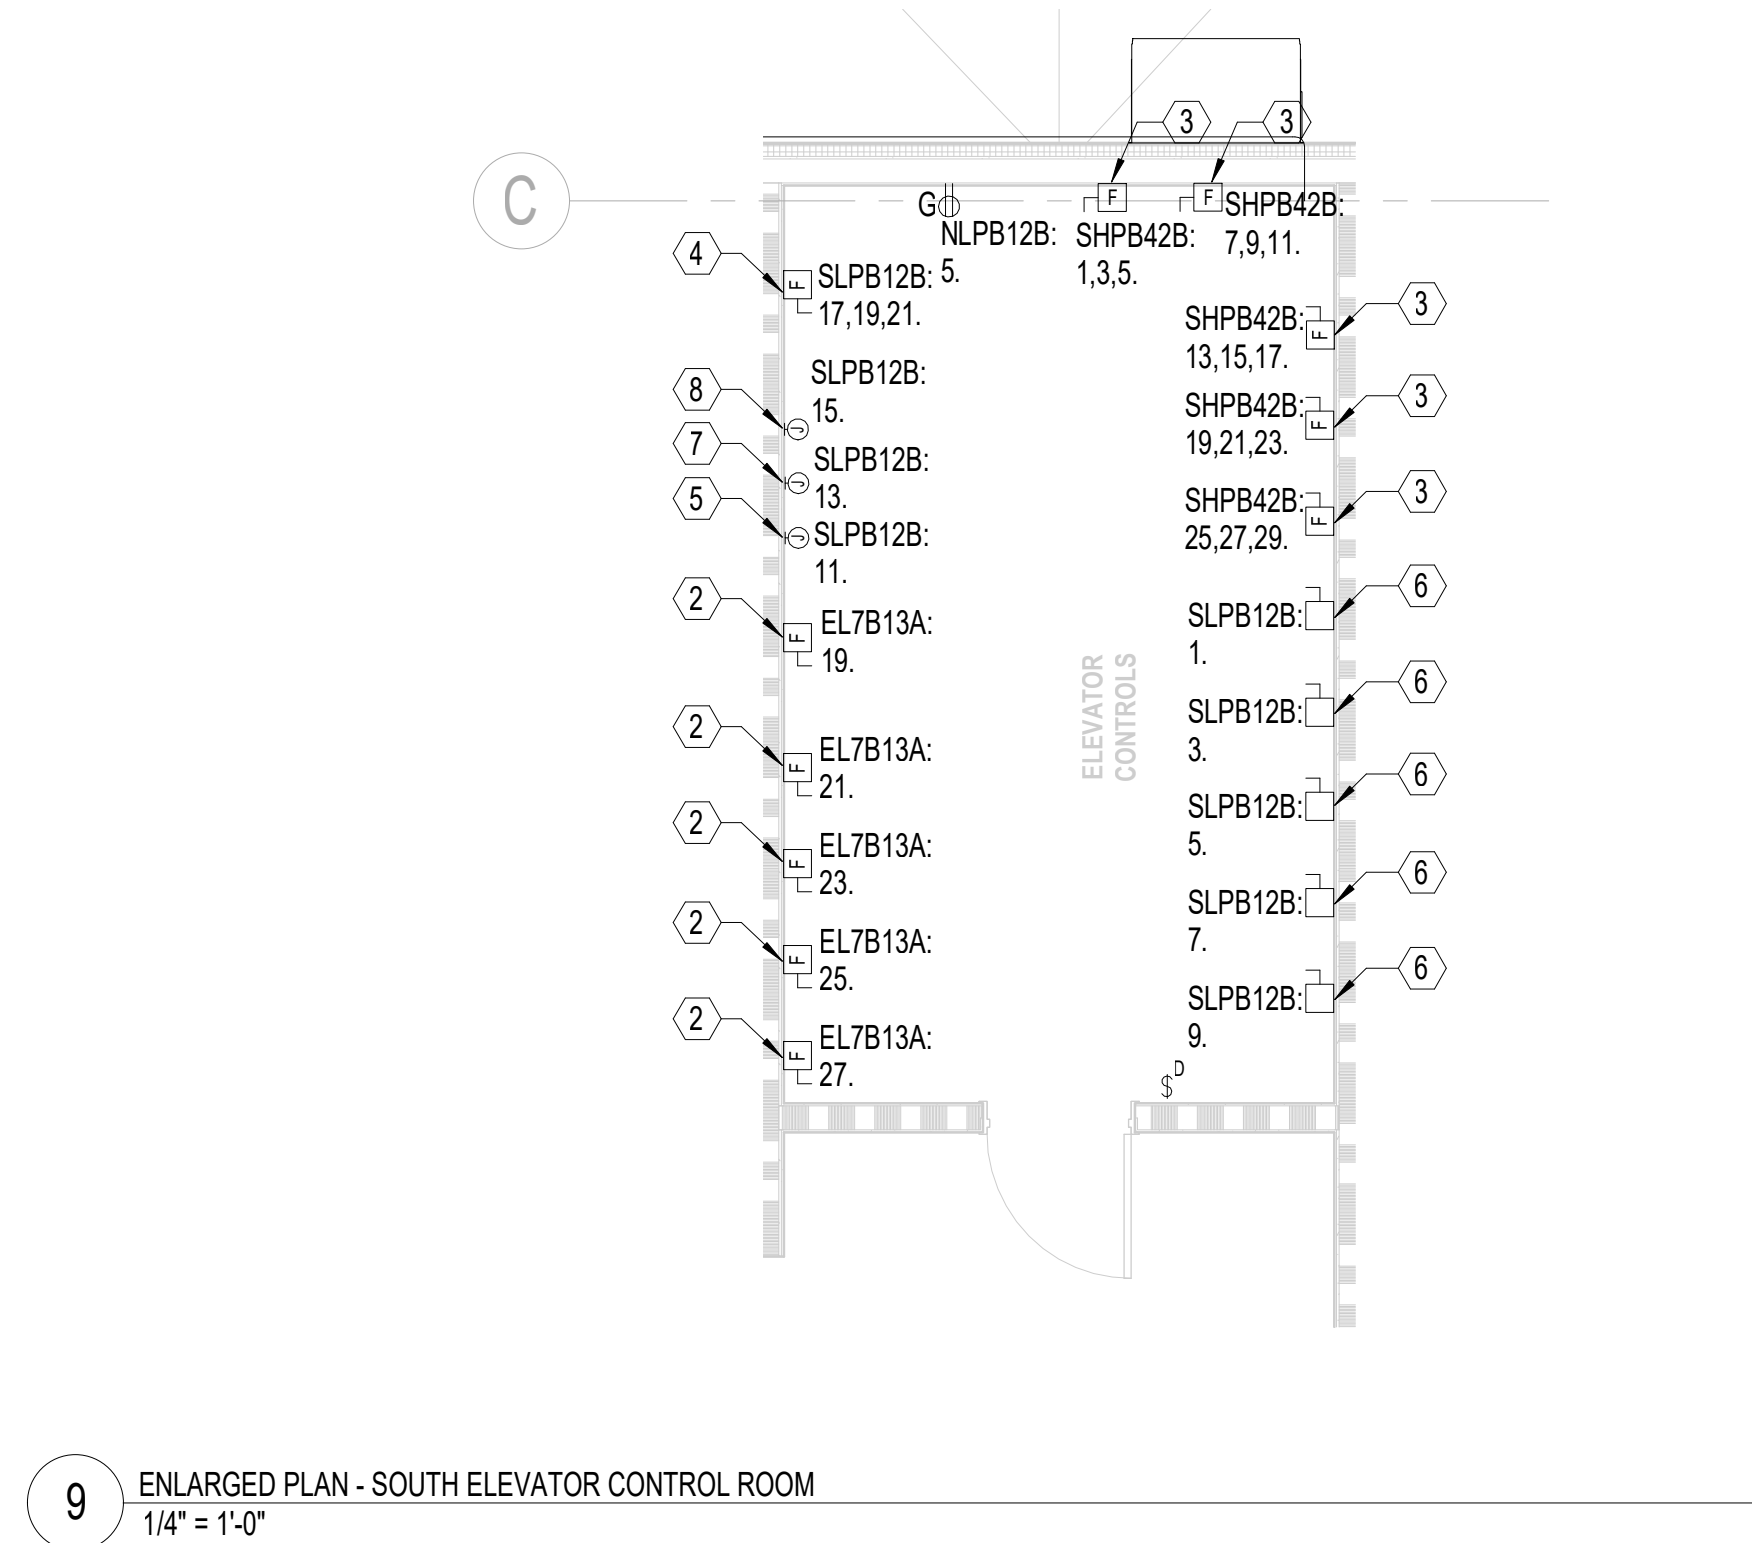


9 ENLARGED PLAN - SOUTH ELEVATOR CONTROL ROOM  
1/4" = 1'-0"

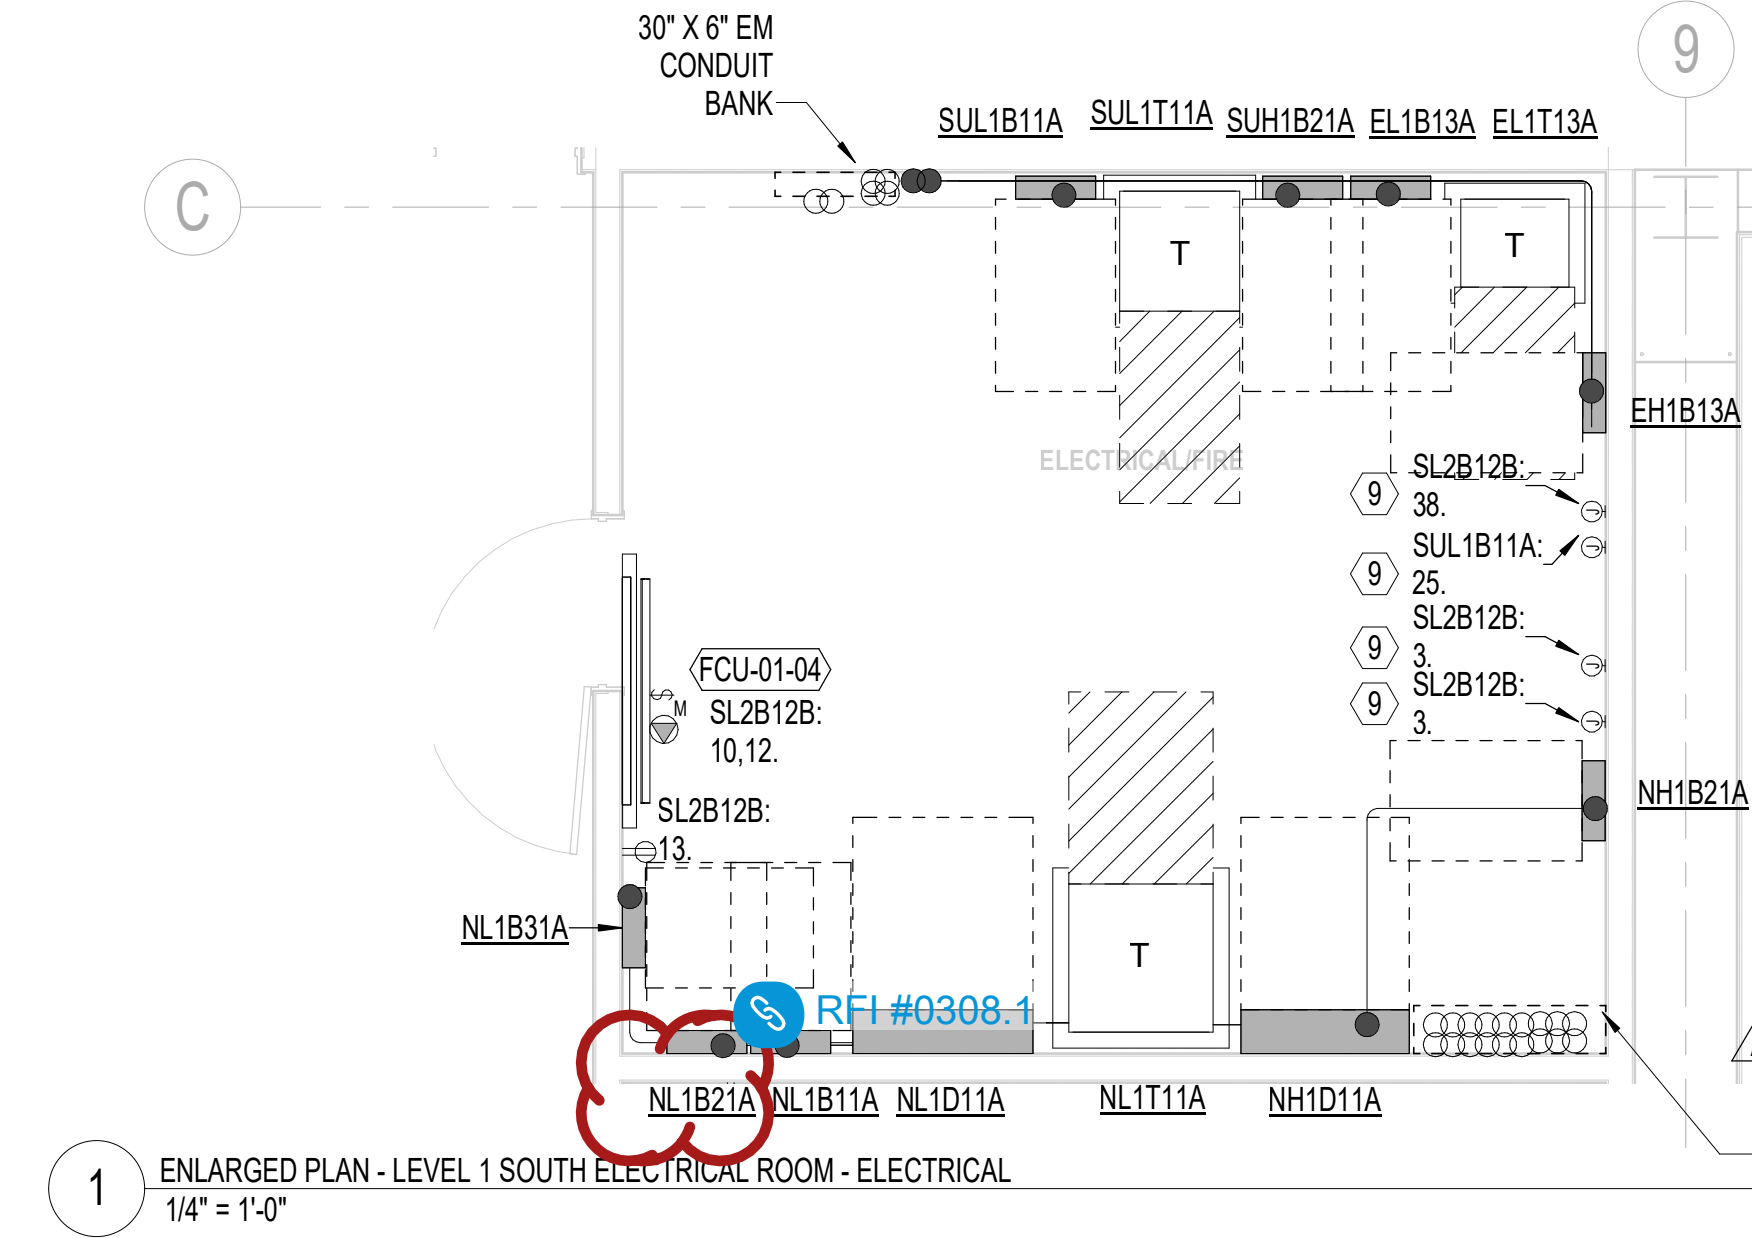


1 ENLARGED PLAN - LEVEL 1 SOUTH ELECTRICAL ROOM - ELECTRICAL  
1/4" = 1'-0"

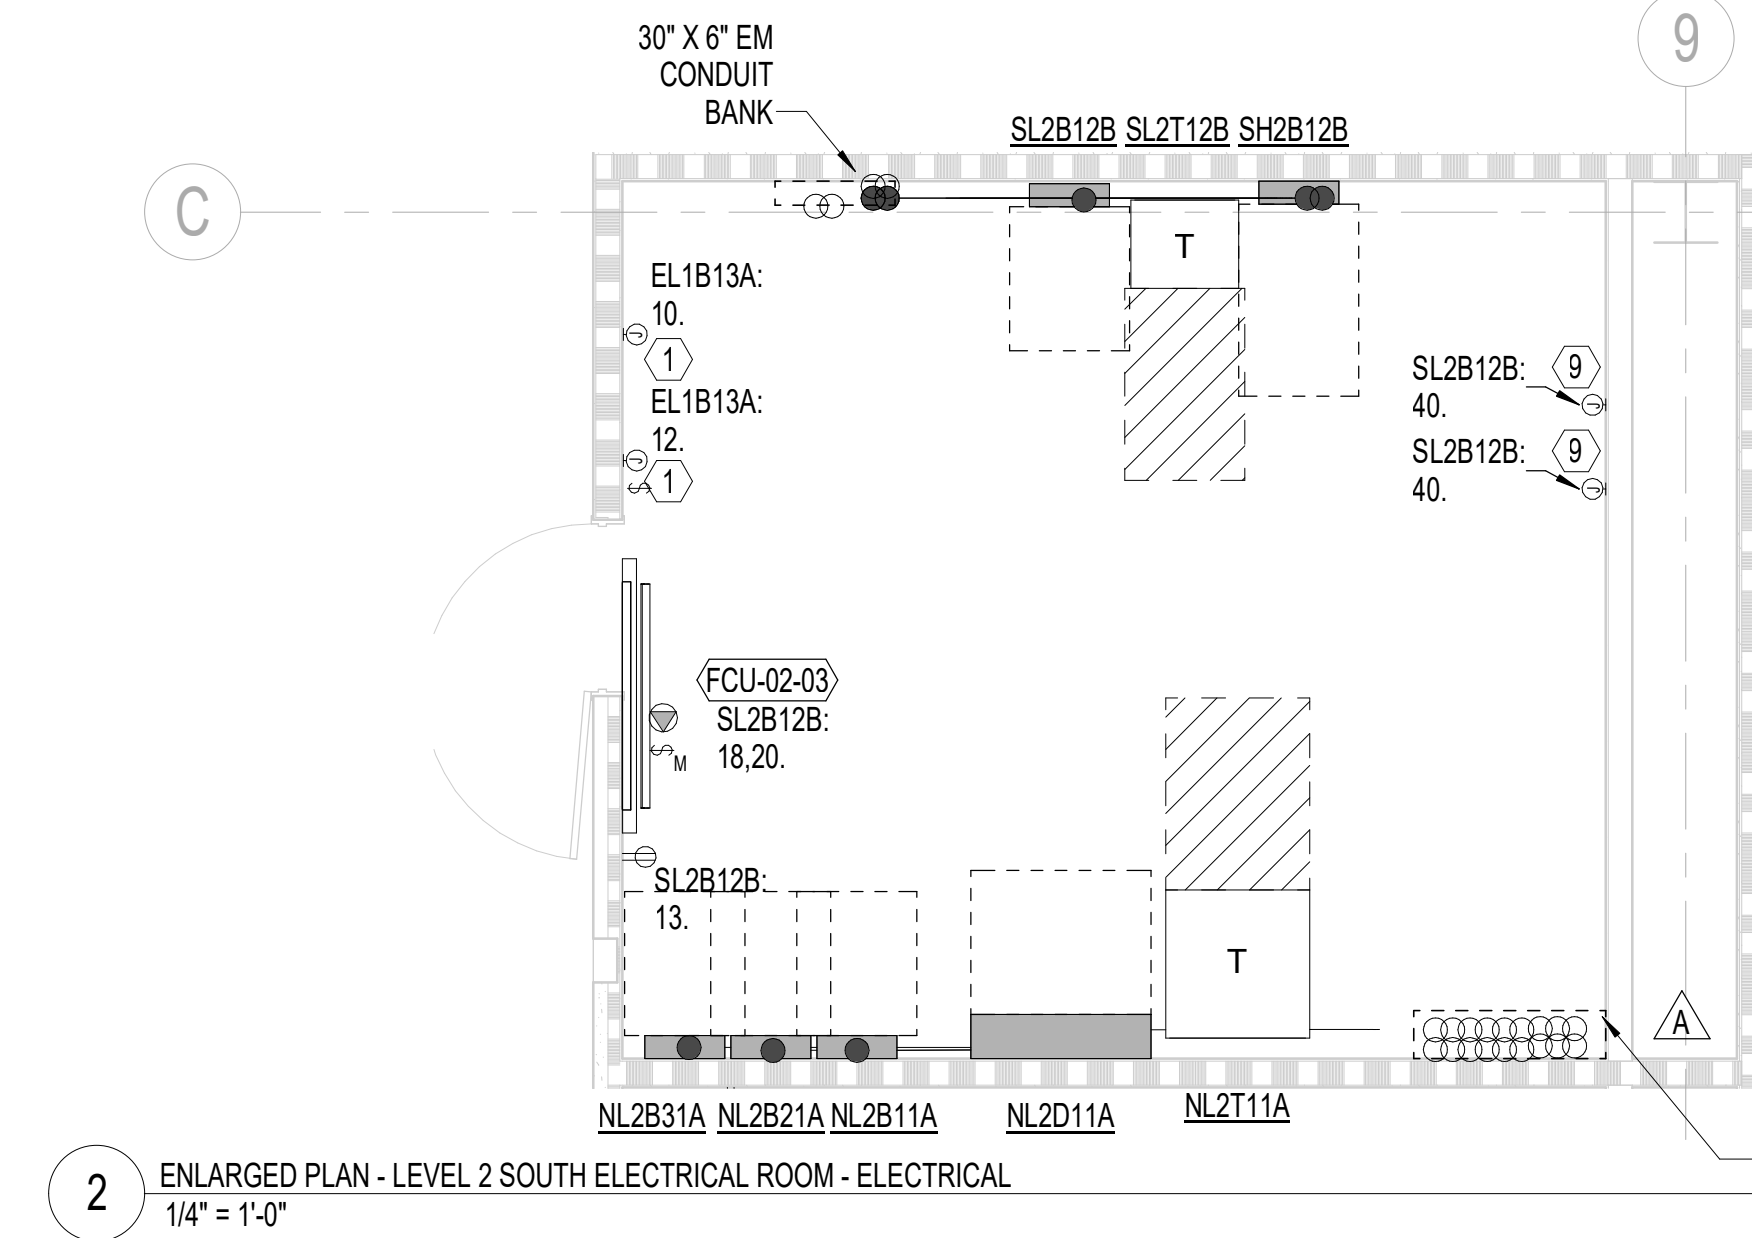


2 ENLARGED PLAN - LEVEL 2 SOUTH ELECTRICAL ROOM - ELECTRICAL  
1/4" = 1'-0"

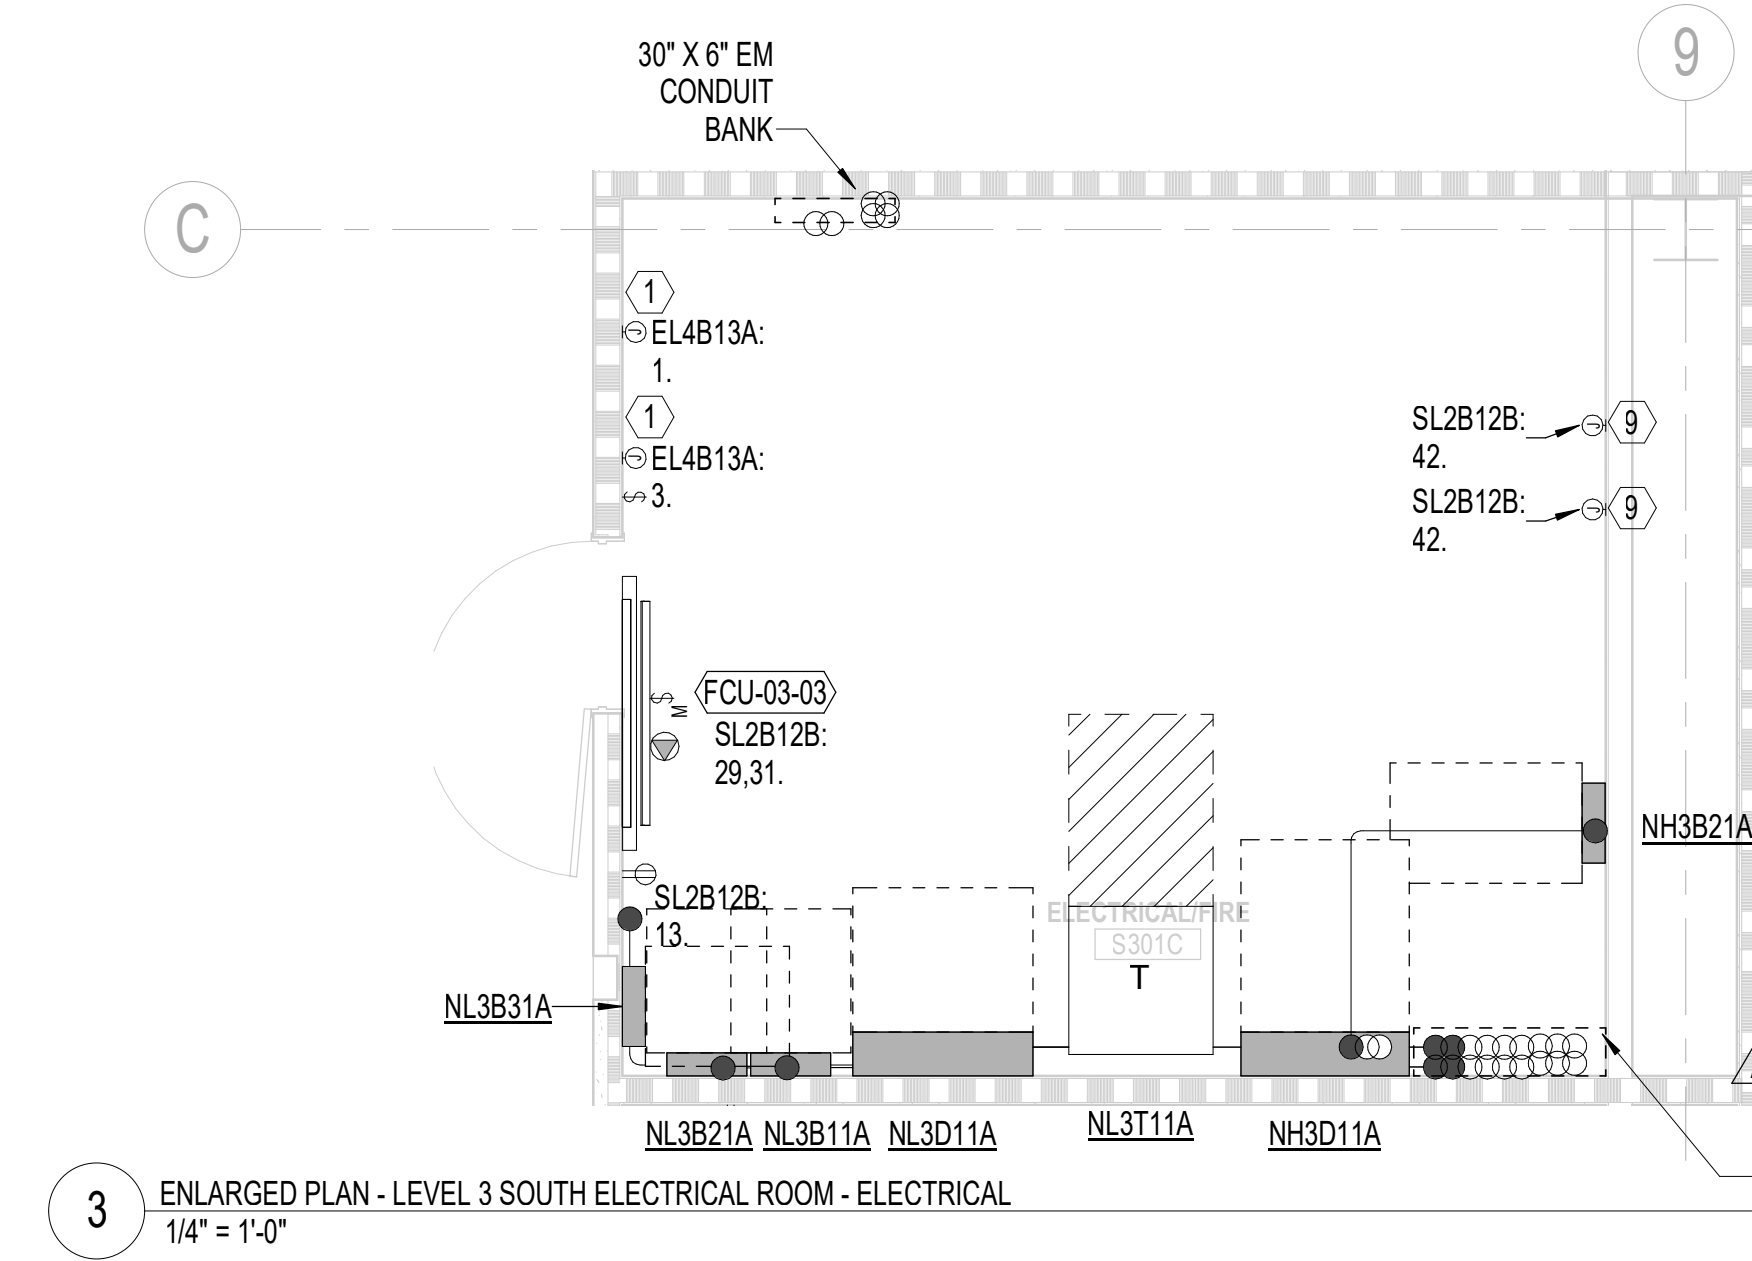

3 ENLARGED PLAN - LEVEL 3 SOUTH ELECTRICAL ROOM - ELECTRICAL  
1/4" = 1'-0"

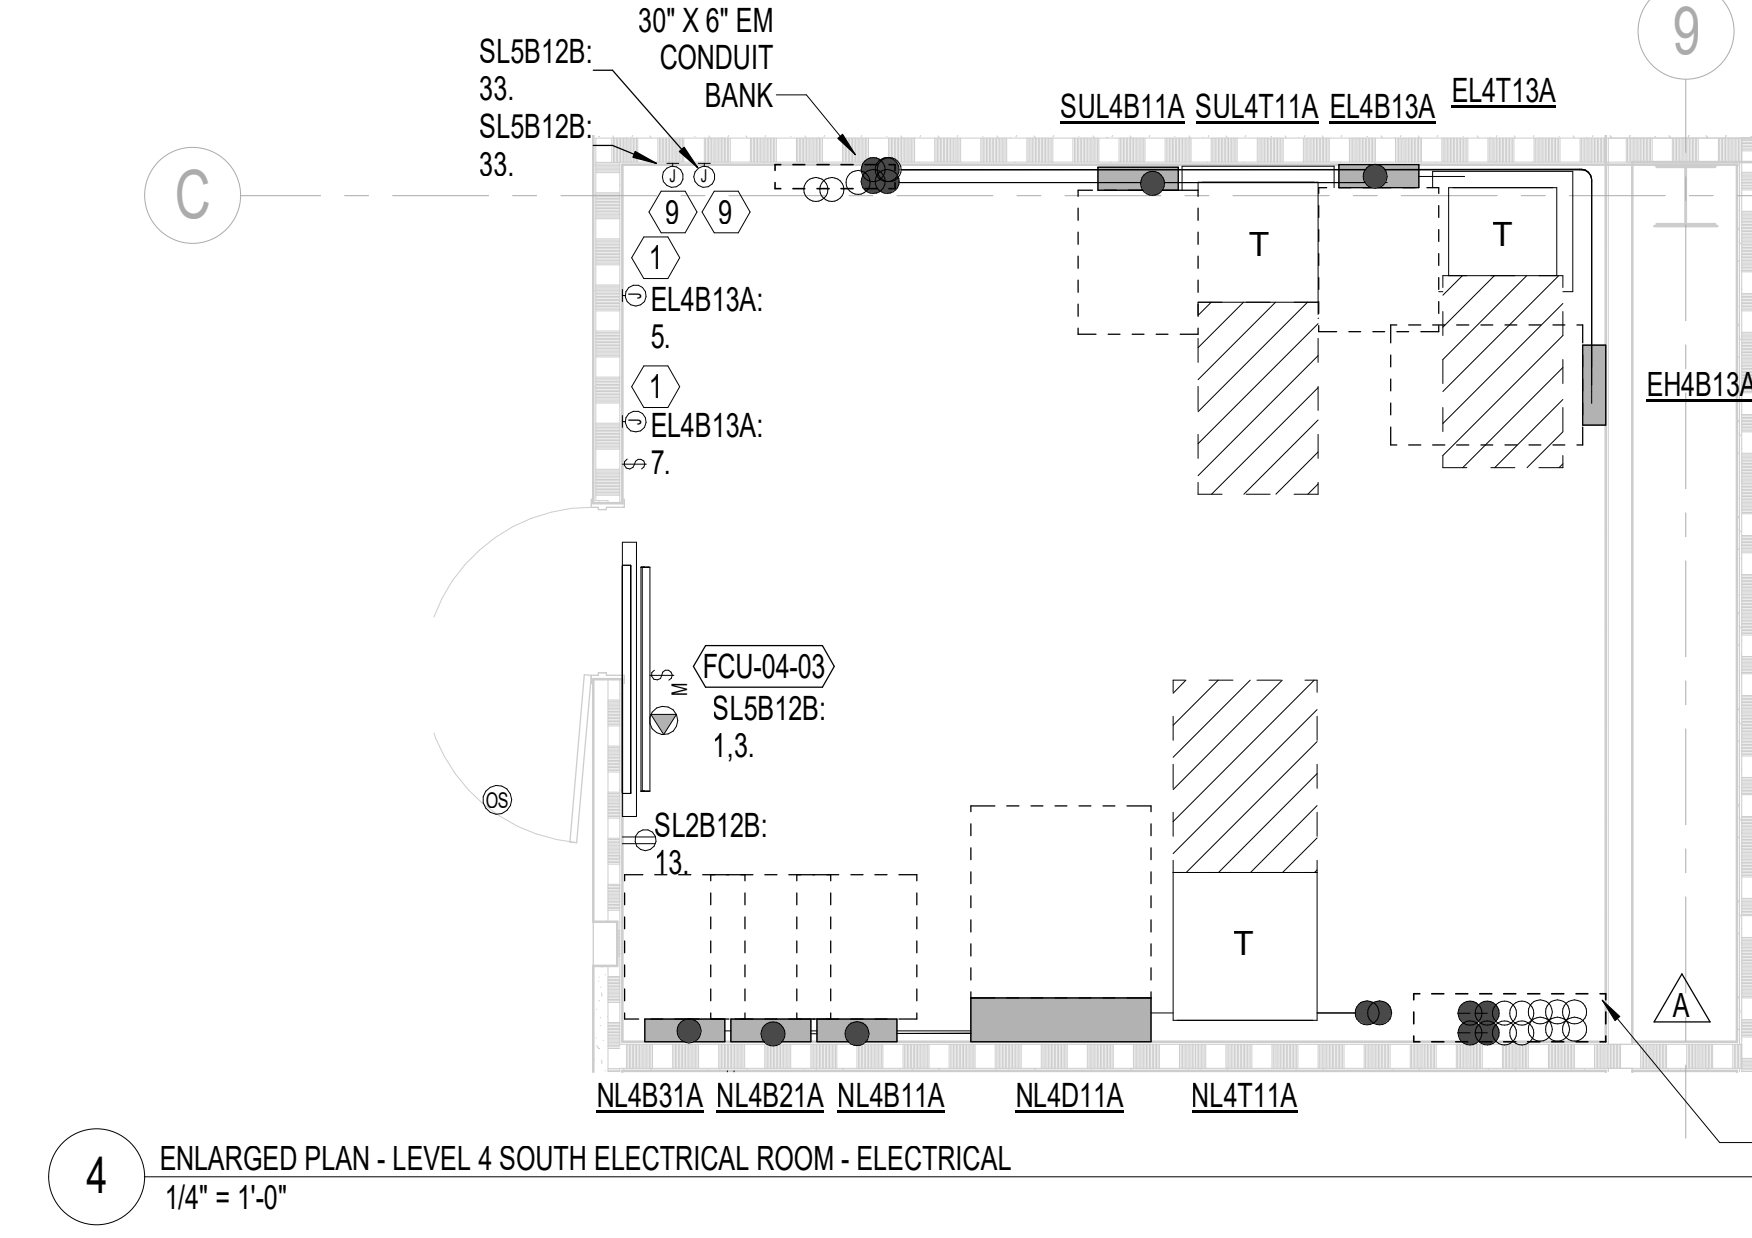

4 ENLARGED PLAN - LEVEL 4 SOUTH ELECTRICAL ROOM - ELECTRICAL  
1/4" = 1'-0"

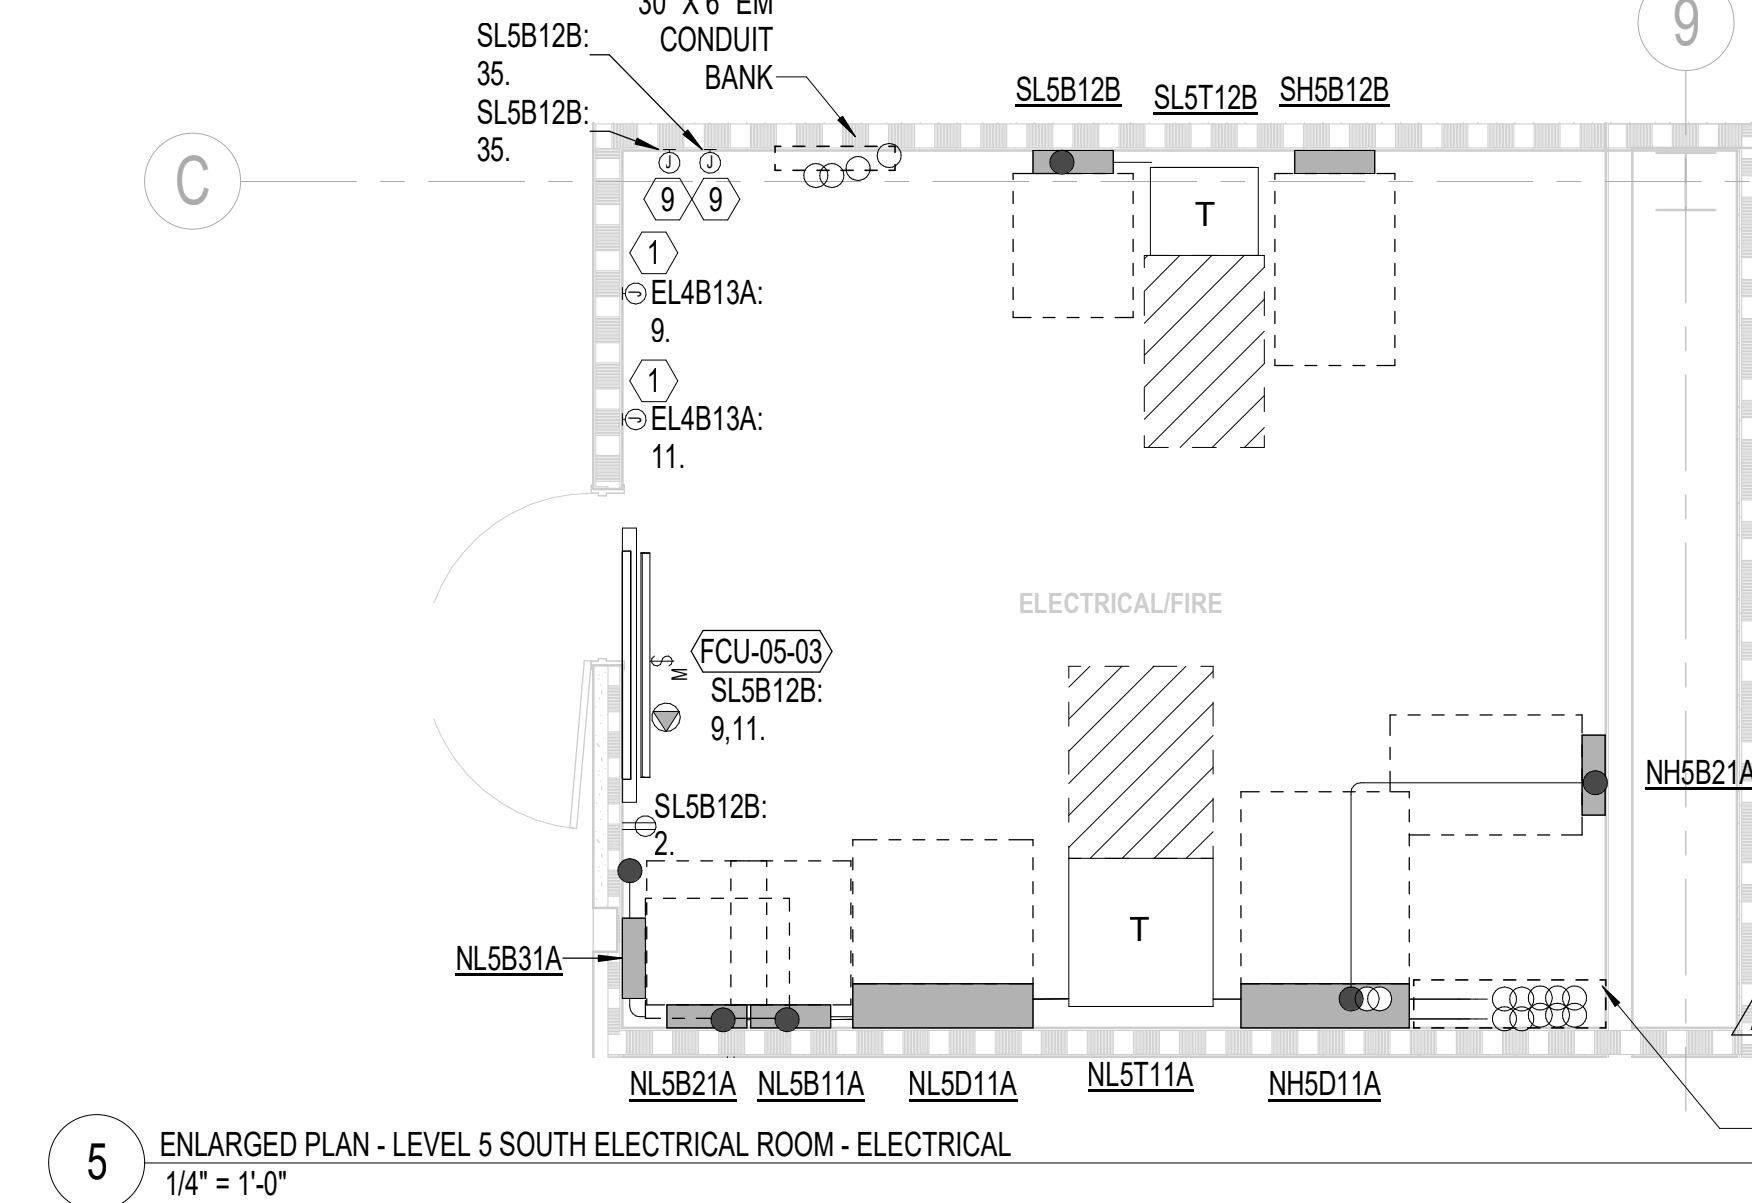

5 ENLARGED PLAN - LEVEL 5 SOUTH ELECTRICAL ROOM - ELECTRICAL  
1/4" = 1'-0"

## SHEET NOTES

1. PROVIDE DEDICATED 120V EMERGENCY POWER CONNECTION TO FIRE ALARM EQUIPMENT.
2. PROVIDE 120V CONNECTION TO EACH ELEVATOR'S CAB FAN AND LIGHT.
3. PROVIDE LOCKABLE DISCONNECT SWITCH. PROVIDE A FUSED DISCONNECT SWITCH FOR EACH ELEVATOR.
4. PROVIDE 208V, 3 PHASE CONNECTION TO ELEVATOR GROUP CONTROLLER.
5. PROVIDE 120V CONNECTION TO SECURITY SYSTEM AND/OR INTERCOM.
6. PROVIDE 120V, 20A DEDICATED CIRCUIT TO EACH ELEVATOR'S HEATING/COOLING CONTROLLER.
7. PROVIDE 120V, 20A DEDICATED CIRCUIT TO ELEVATOR CONTRACTORS' ELEVATOR MANAGEMENT SYSTEM.
8. PROVIDE 120V, 20A DEDICATED CIRCUIT TO REMOTE ELEVATOR MONITORING SYSTEM.
9. PROVIDE 120V CONNECTION FOR DDC CONTROLS.

## GENERAL NOTES

- A. PROVIDE AND MAINT REQUIRED SPACE, ADEQUATE ILLUMINATION, ACCESS TO WORK SPACE AND HEAD ROOM ABOUT ELECTRICAL EQUIPMENT IN ACCORDANCE WITH IDAHO ELECTRICAL CODE 110.26
- B. FOR ELECTRICAL EQUIPMENT RATED 800 AMPERES OR MORE THAT CONTAINS OVERCURRENT DEVICES, THE DOOR(S) WITHIN 25' OF THE NEAREST EDGE OF WORK SPACE SHALL OPEN IN THE DIRECTION OF EGRESS AND BE PROVIDED WITH LISTED PANIC HARDWARE IN ACCORDANCE WITH IDAHO ELECTRICAL CODE 110.26(C)(3).
- C. PROVIDE ARC-FLASH HAZARD MARKINGS PER IDAHO ELECTRICAL CODE 110.16. MARKINGS SHALL MEET THE REQUIREMENTS OF 110.21(B) AND SHALL BE CLEARLY VISIBLE TO QUALIFIED PERSONS BEFORE EXAMINATION, SERVICING, OR MAINTENANCE OF EQUIPMENT.



8000 South Federal Way  
Boise ID 83707

Gensler

811 SW 6TH AVE  
SUITE 300  
PORTLAND, OR 97204

TEL 971.277.2370



pae-engineers.com



Lumald.com

Date	Description
11/18/2022	INTERIORS 50% DESIGN DEVELOPMENT
12/16/2022	INTERIORS 100% DESIGN DEVELOPMENT
02/03/2023	CONSOLIDATED PROGRESS SET
06/02/2023	PROGRESS SET
12/22/2023	CD PROGRESS SET FOR PERMIT AND PRICING
02/22/2024	CD - MEP BID SET
03/29/2024	Issue for Permit
07/11/2024	PLAN CHECK RESPONSE 1
11/01/2024	ISSUE FOR CONSTRUCTION

Seal / Signature

Project Name

MICRON BUILDING B42

Project Number

22-1717

Description

ENLARGED PLANS -  
ELECTRICAL

Scale

NOT TO SCALE

E3.002

City of Boise Stamps