



1 LIGHTING PLAN LEVEL 1 - SECTOR C
1/8" = 1'-0"

SHEET NOTES

1. INTEGRAL LIGHTING IN HOOD. REFER TO KITCHEN CONSULTANT DRAWINGS.
2. SURFACE MOUNTED LENSED EXTRUDED ALUMINUM LIGHT INTEGRATED INTO BOTTOM OF SHELF.
3. SCENE CONTROL STATION FOR GRILL DINING. FINAL LOCATION TO BE COORDINATED WITH ARCHITECT AND/OR OWNER.
4. NOT USED.
5. INTEGRAL LIGHTING IN WALK IN COOLER. REFER TO KITCHEN CONSULTANT DRAWINGS.
6. L44 WITH REMOTE DRIVER INTEGRATED INTO STAIR RAISER.
7. L43 WALL RECESSED STEP LIGHT MOUNTED 18 INCH ABOVE FINISHED FLOOR.


CIRCUITING NOTES

- A. CIRCUIT ALL NORMAL 277V LIGHTING FIXTURES TO PANEL N#1B24B, CIRCUIT NUMBER INDICATED UNLESS NOTED OTHERWISE.
- B. CIRCUIT ALL EMERGENCY 277V LIGHTING FIXTURES TO PANEL E#1B23A, CIRCUIT NUMBER INDICATED UNLESS NOTED OTHERWISE.
- C. CIRCUIT ALL EMERGENCY 120V LIGHTING FIXTURES TO PANEL N#1B44B, CIRCUIT NUMBER INDICATED UNLESS NOTED OTHERWISE.

GENERAL NOTES

- A. SEE THE ARCHITECTURAL DRAWINGS FOR EXACT LOCATION OF ALL DEVICES AND LUMINAIRES. REQUEST CLARIFICATIONS IN WRITING PRIOR TO ROUGH-IN. UNCOORDINATED ELEMENTS SHALL BE RELOCATED PER THE DIRECTION OF THE ARCHITECT WITHOUT ADDITIONAL COST TO THE PROJECT, OWNER OR DESIGN TEAM IF REQUIRED.
- B. EGRESS LIGHTING SHALL BE PER CODE MINIMUM IN ALL SPACES WHERE EMERGENCY EGRESS LIGHTING IS REQUIRED INCLUDING ALL EXTERIOR SPACES. LUMINAIRES USED FOR EGRESS ILLUMINATION WILL BE DESIGNATED IN THE CONSTRUCTION DOCUMENT AND PERMIT PROCESS. IN STAIRS, ELECTRICAL ROOMS, ID/MDF ROOMS, MECHANICAL ROOMS AND ELEVATOR MACHINE ROOMS 50% LIGHTING TO BE ON EMERGENCY POWER. IN STAIRS, CORRIDORS, AND OTHER AREAS REQUIRING PARTIAL-OFF LIGHT REDUCTION, EMERGENCY LIGHTING IS TO BE CONTROLLED WITH OCCUPANCY SENSORS TO ALLOW 60% DIMMING WHEN THE SPACE IS UNOCCUPIED.
- C. PROVIDE UL924 DEVICES IN APPLICABLE AREAS FOR EGRESS LIGHTS TO OPERATE WITH NORMAL POWERED LIGHTS DURING NORMAL POWER CONDITIONS, AND OVERRIDE TO FULL OUTPUT ON DURING EMERGENCY POWER CONDITIONS.
- D. EXIT SIGNS ARE TO BE PROVIDED TO MEET CODE REQUIREMENTS AND TO BE LOCATED PER THE LIFE SAFETY DIAGRAM PROVIDED BY THE ARCHITECT IN QUANTITY TO NOT EXCEED CODE MAXIMUM DISTANCES BETWEEN SIGNS. ALL EXIT SIGNS ARE TO BE ON EMERGENCY POWER.
- E. REFER TO ELECTRICAL LEGEND SHEET FOR DESIGNATION OF LUMINAIRES USED FOR EGRESS. EMERGENCY LIGHTING POWER SHALL BE PROVIDED BY EMERGENCY LIGHTING PANEL CONNECTED TO GENERATOR.
- F. REFER TO DRAWINGS E0201, E0202, E2.03, AND E2.04 FOR LUMINAIRE SCHEDULES.
- G. REFER TO THE LIGHTING CONTROL SCHEDULE ON SHEET E0201 FOR SPECIFIC CONTROL REQUIREMENTS.
- H. COORDINATE LIGHTING IN BACK-OF-HOUSE SPACES AND EQUIPMENT ROOMS WITH EQUIPMENT, PIPING, AND OTHER DISCIPLINES PRIOR TO ROUGH-IN. PROVIDE CHAIN OR PENDANT SUPPORT TO PROVIDE UNOBSTRUCTED ILLUMINATION.
- I. PROVIDE LOW VOLTAGE CABLING AND CONNECTIONS FOR LIGHTING CONTROLS AS REQUIRED BY MANUFACTURER. SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- J. MULTIPLE SWITCHES AT THE SAME LOCATION SHALL BE GANGED TOGETHER. PROVIDE INTERNAL BARRIERS FOR MIXED VOLTAGES AND BRANCHES OF POWER AS NECESSARY.

KEY PLAN

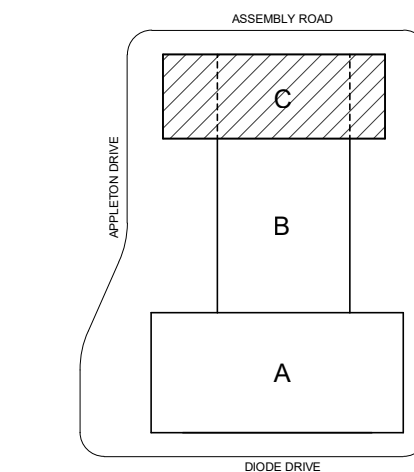

City of Boise Stamps



8000 South Federal Way
Boise ID 83707

Gensler

811 SW 6TH AVE
SUITE 300
PORTLAND, OR 97204

TEL 971.277.2370



pae-engineers.com



Lumald.com

Date	Description
12/16/2022	INTERIORS 100% DESIGN DEVELOPMENT
02/03/2023	CONSOLIDATED PROGRESS SET
05/02/2023	PROGRESS SET
12/22/2023	CD PROGRESS SET FOR PERMIT AND PRICING
02/22/2024	CD - MEP BID SET
03/29/2024	Issue for Permit
11/01/2024	ISSUE FOR CONSTRUCTION

Seal / Signature

Project Name

MICRON BUILDING B42

Project Number

22-1717

Description
LIGHTING PLAN LEVEL 1 - SECTOR C

Scale

As indicated

E1.101C