
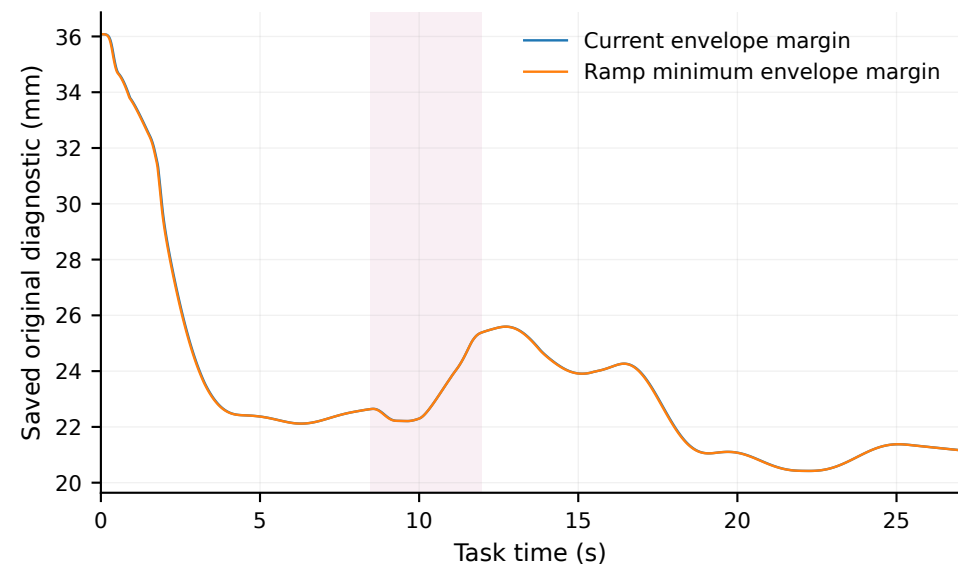
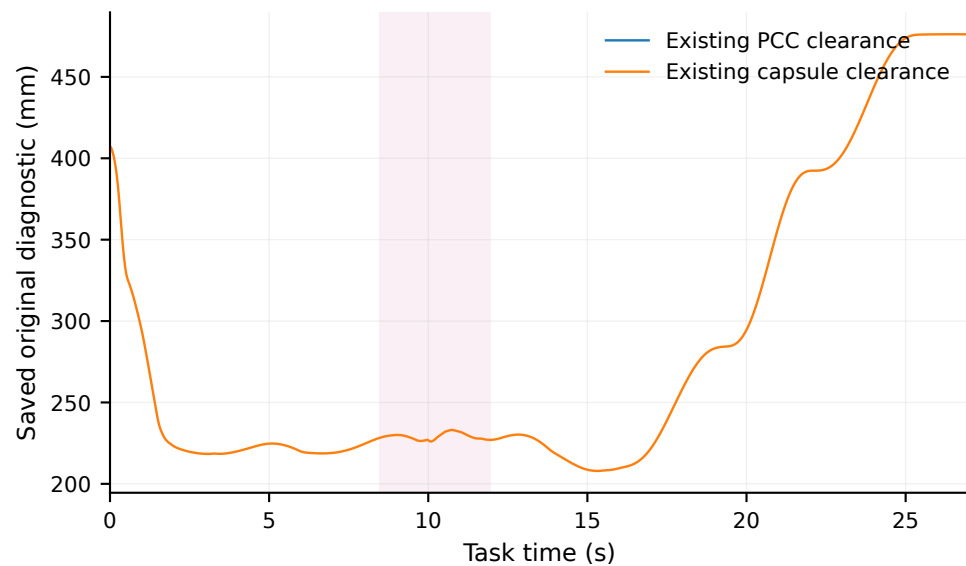
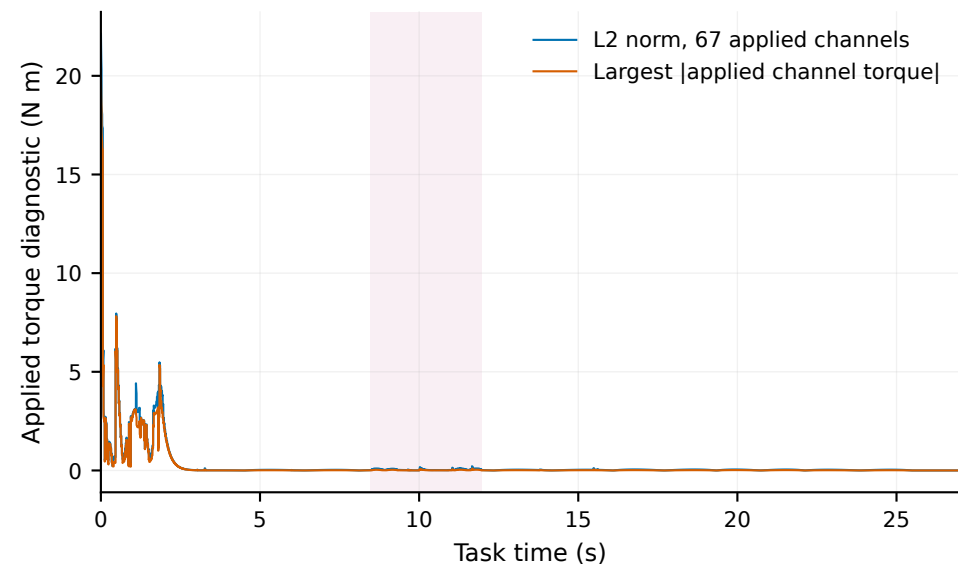


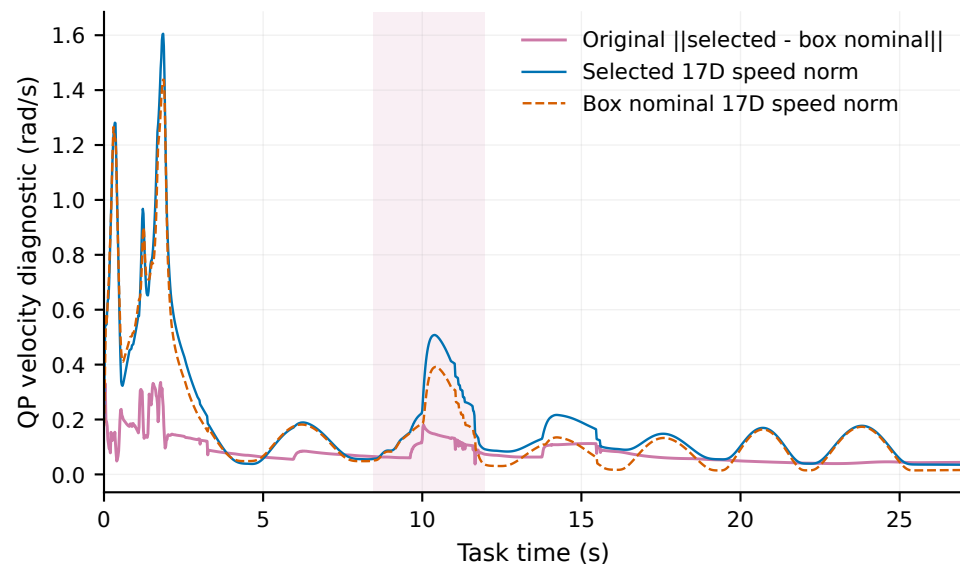

EA\_20 | d=55 mm, c+ | v2\_minus20 | complete actual + original Task/safety passed  
 QP/PCC/interval diagnostics: saved consumed 20 ms ticks. Torque: original applied 2 ms intervals, labeled by interval end.  
 Six reused slots have no new QP vectors; no reconstruction. PCC, capsule and interval margins retain their distinct original scopes.