



# Precision–Recall Curves for Power and Normal Availability

(a) Full Precision–Recall curve

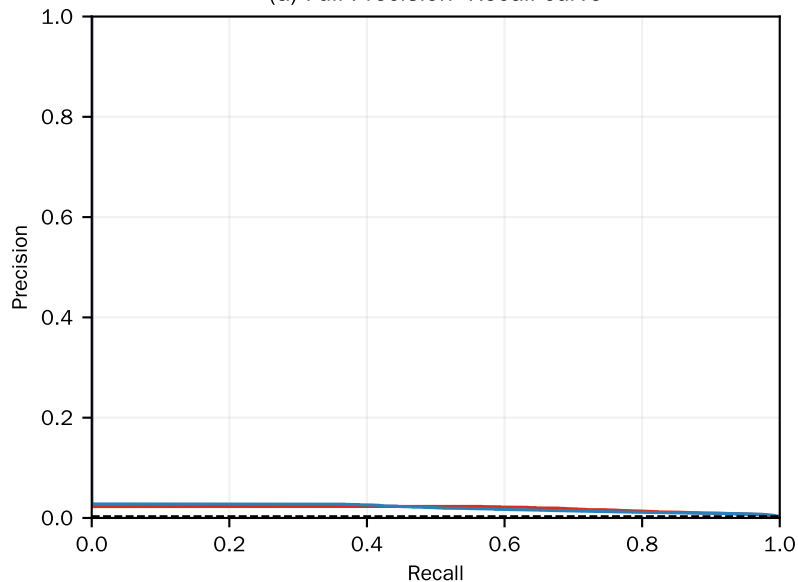

(b) Enlarged Low-Precision Region

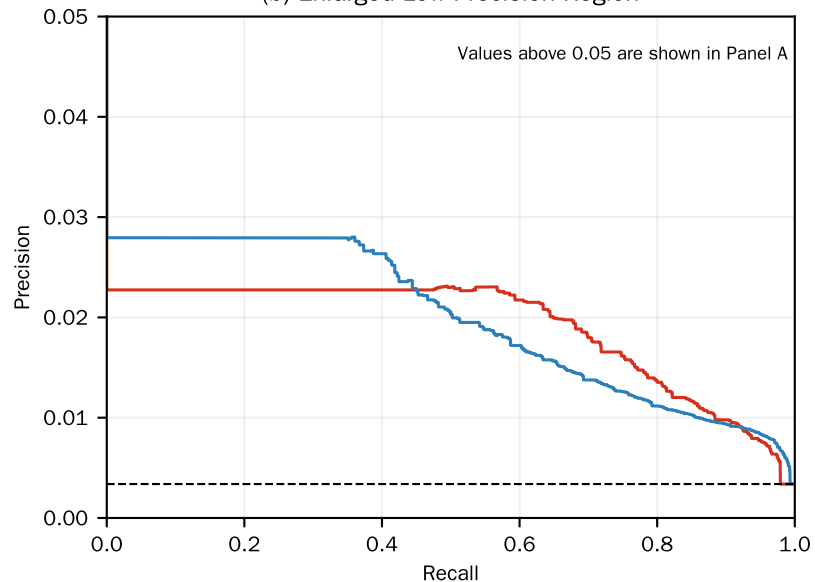

— Power AP=0.019    — Normal AP=0.020    ---- Positive prevalence baseline = 0.338%