


Ablation: ratio trade-off (n\_kv=1, multi-seed). 4:1:1 has 6L vs 0:1:1 has 2L — depth confound noted in paper.

Accuracy vs. KDA:CSA:HCA ratio



Latency vs. KDA:CSA:HCA ratio

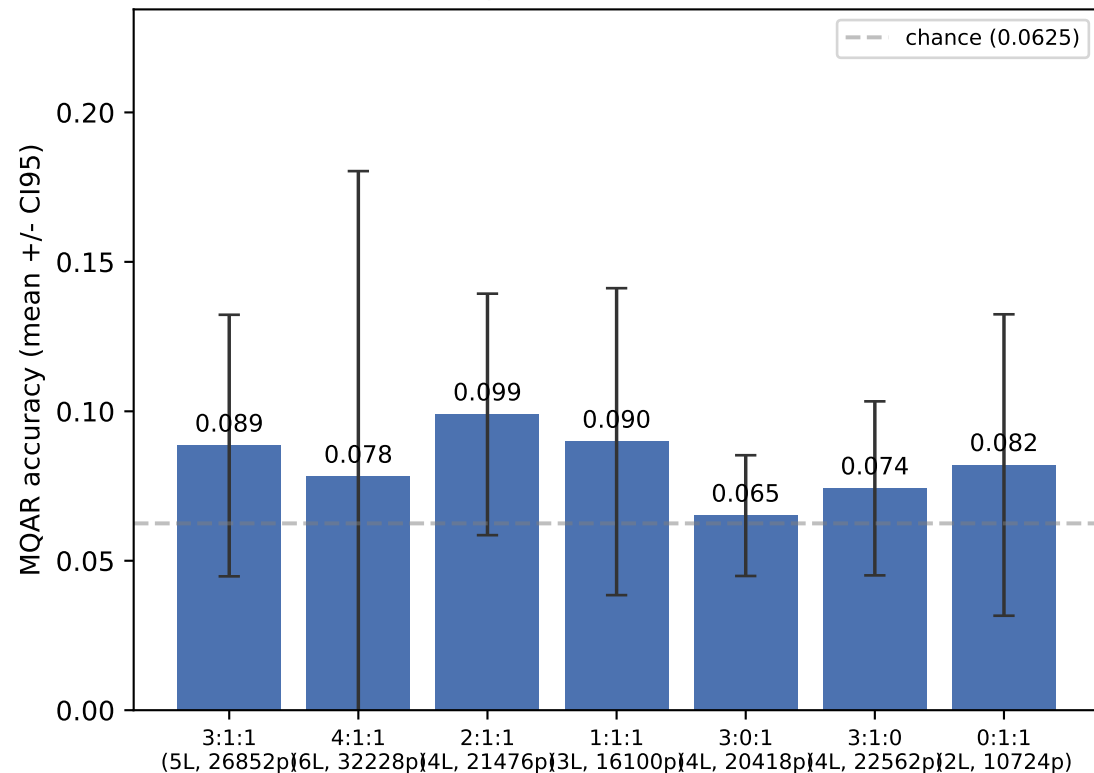