


Fixed outage design: PV 1326 kW | BESS 173 kWh | DG 150 kW | GFM 259 kW
NPC change relative to base case; design is NOT re-optimized

(a) Capital-cost sensitivity of fixed design — base NPC = \$7.556 M



(b) Operating and financial sensitivity of fixed design

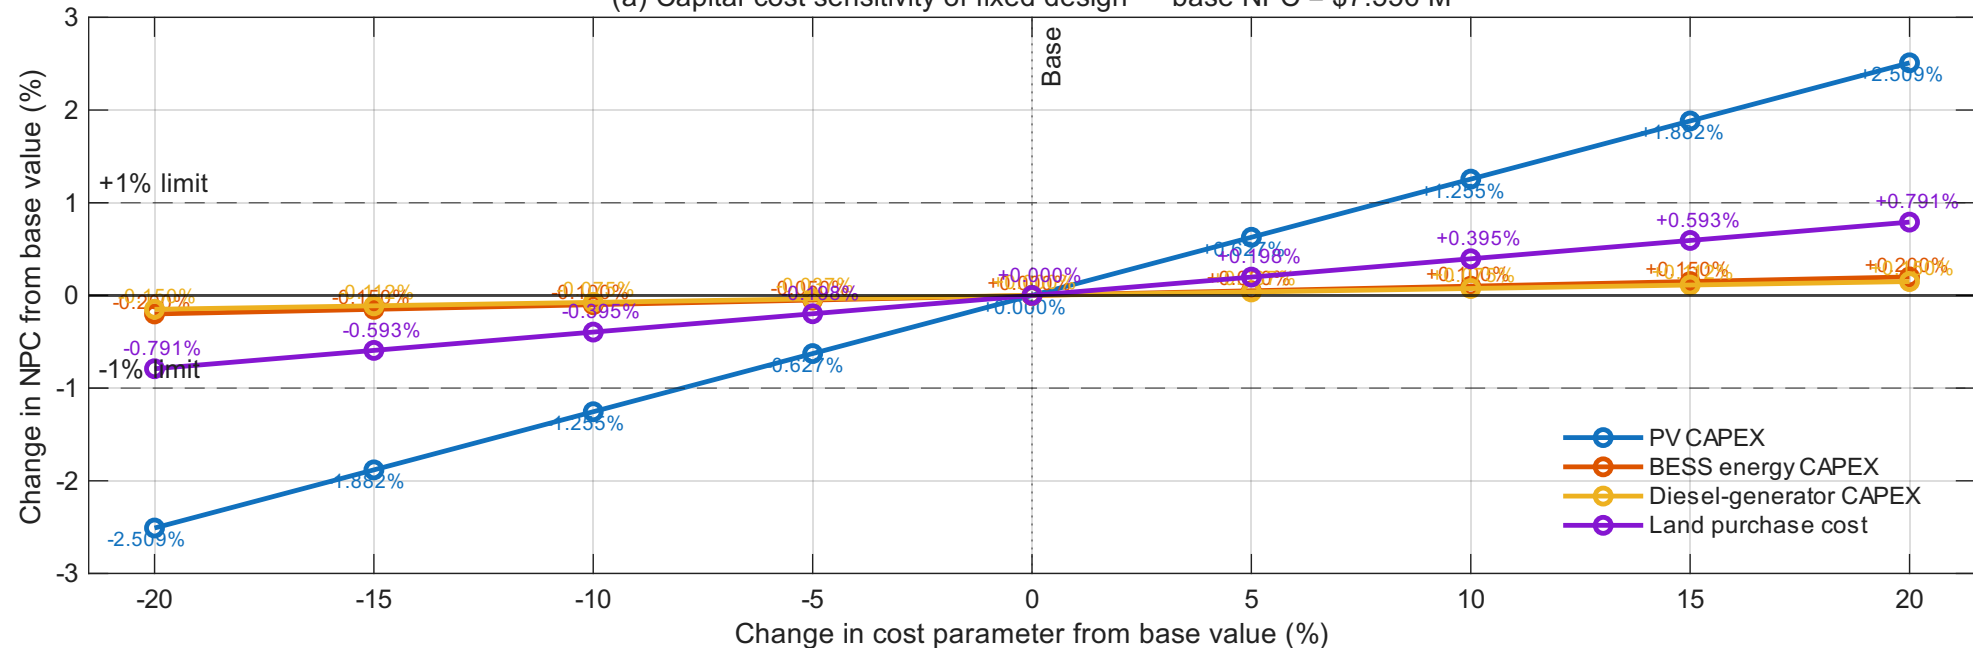