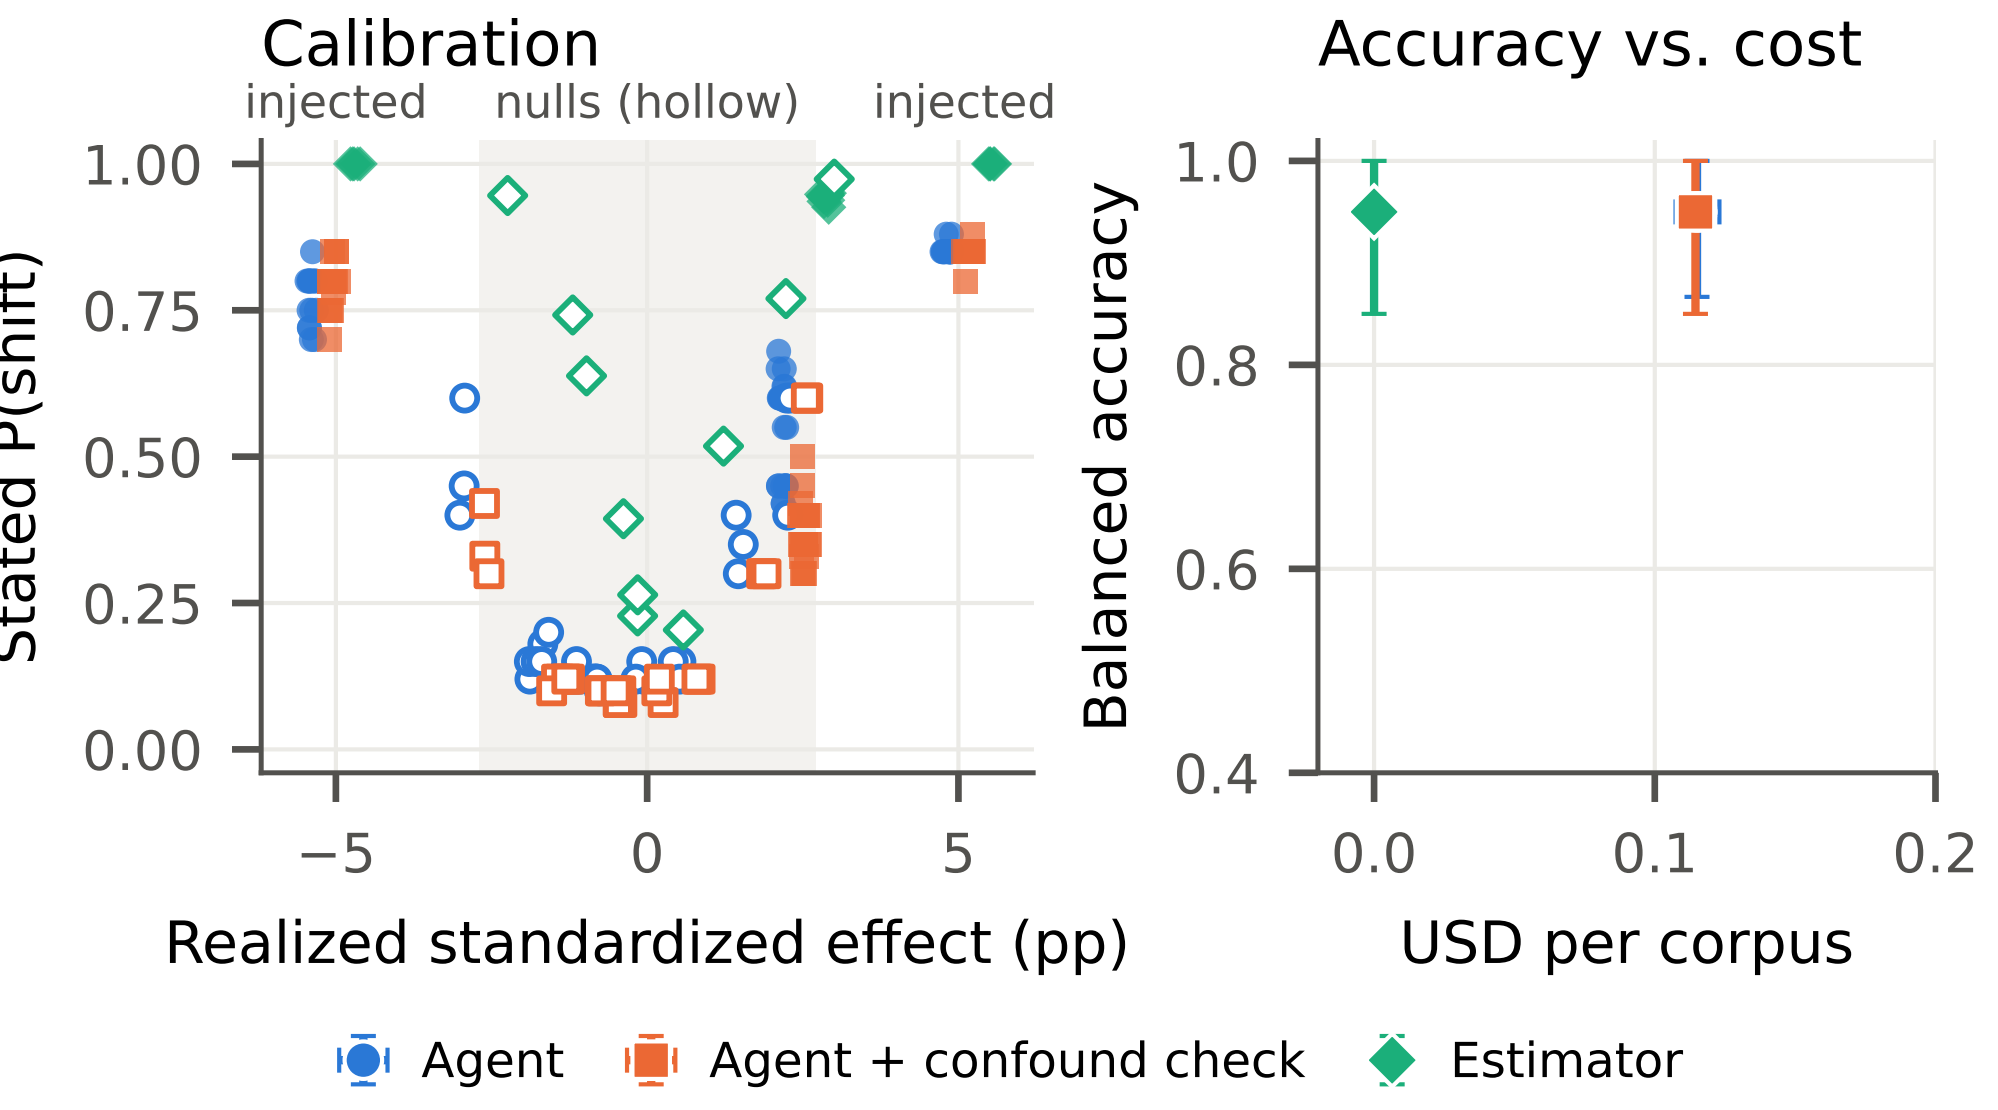
Calibration
injected
nulls (hollow)
injected
1.00
0.75
0.50
0.25
0.00
Stated P(shift)
−5
0
5
Realized standardized effect (pp)
Accuracy vs. cost
1.0
0.8
0.6
0.4
Balanced accuracy
0.0
0.1
0.2
USD per corpus
Agent
Agent + confound check
Estimator