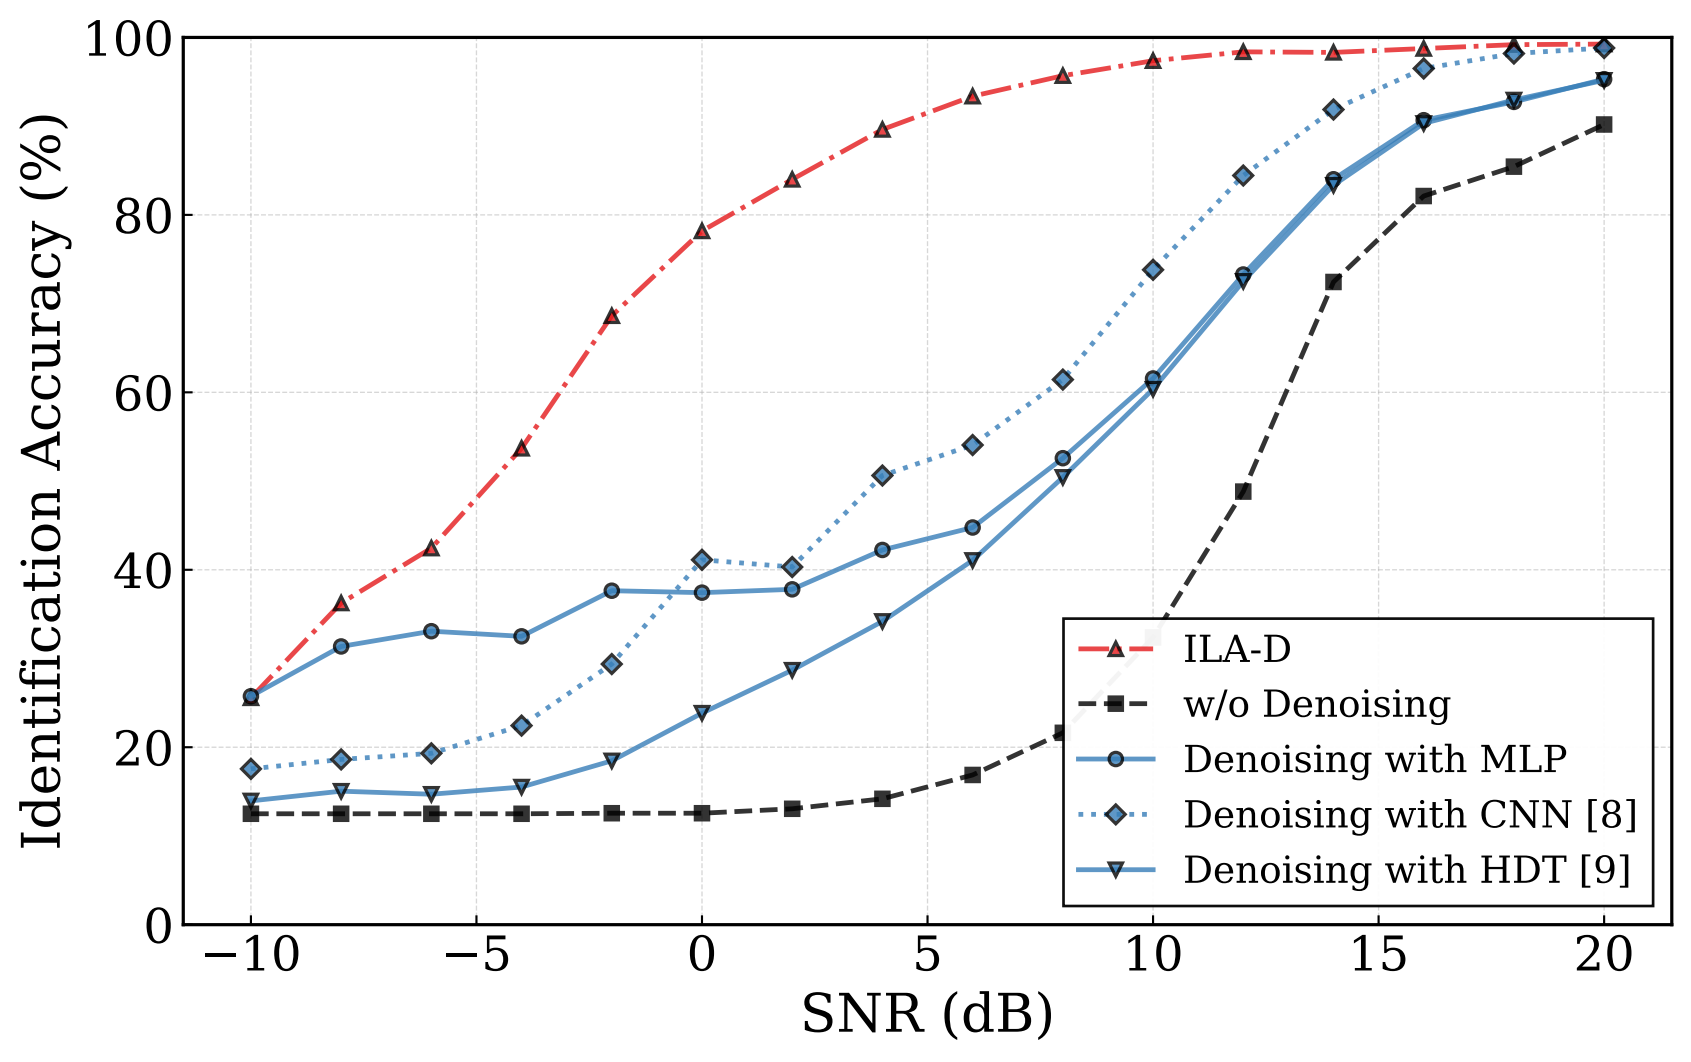
Identification Accuracy (%)
SNR (dB)
100
80
60
40
20
0
−10
−5
0
5
10
15
20
ILA-D
w/o Denoising
Denoising with MLP
Denoising with CNN [8]
Denoising with HDT [9]