


Which basin is charged is set by convention, not measurement

The same physical electricity, attributed six standard ways — ordered by how wide the accounting boundary is drawn

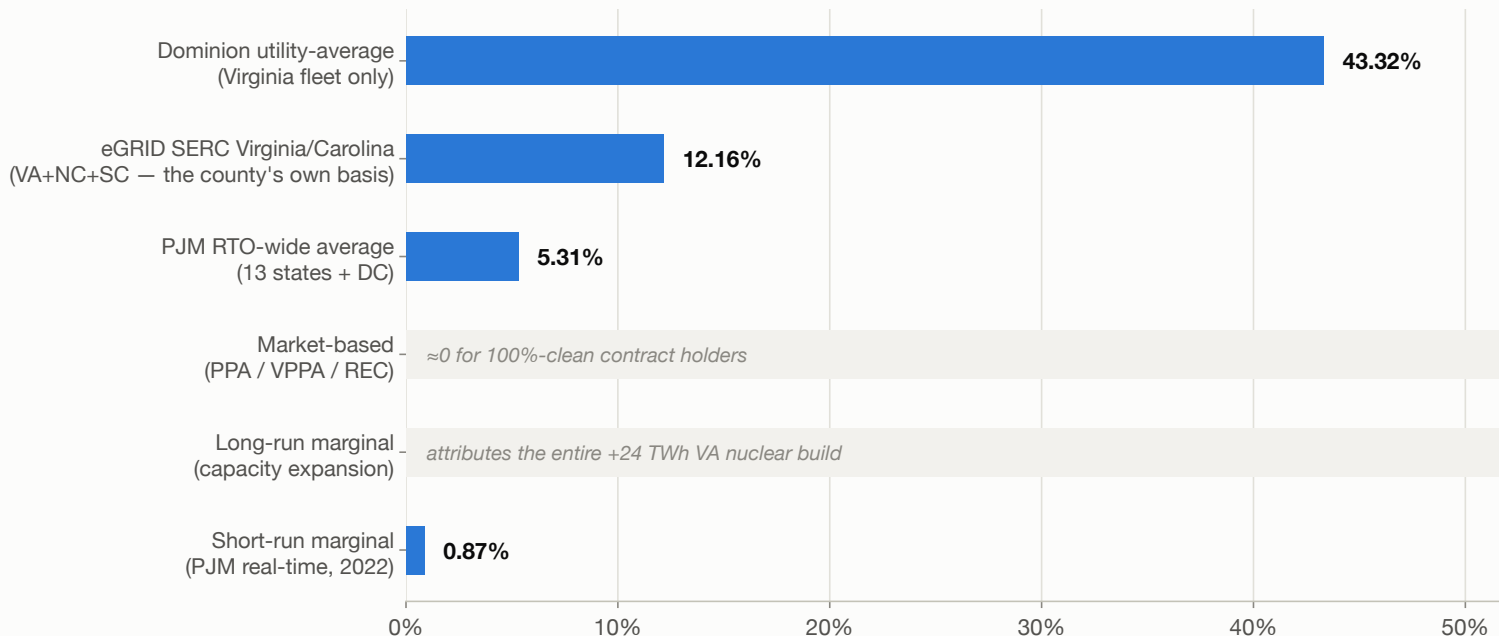

Share of the fleet's electricity-related water attributed to Lake Anna (York basin)

■ computed from the shipped model ■ documented; not computable from this corpus

Computable conventions span 0.87%–43.32% — a factor of 50. Fleet: all 243 buildings, full buildout.

The three averages differ only in where the boundary is drawn, and Lake Anna's share falls as it widens: Virginia holds 23.2% of eGRID SERC nuclear (EPA eGRID2023) and 11.7% of PJM nuclear (JLARC App. H ÷ PJM SOM Table 3-63), so each convention is scaled by that share — unscaled, a Virginia-only plant map returns 52.3% and 45.4% and inverts the result. Short-run marginal is lowest for a different reason: nuclear is baseload and rarely responds to new demand. Long-run marginal is cited from JLARC/E3, not recomputed; its new nuclear is unsited SMRs, not North Anna.