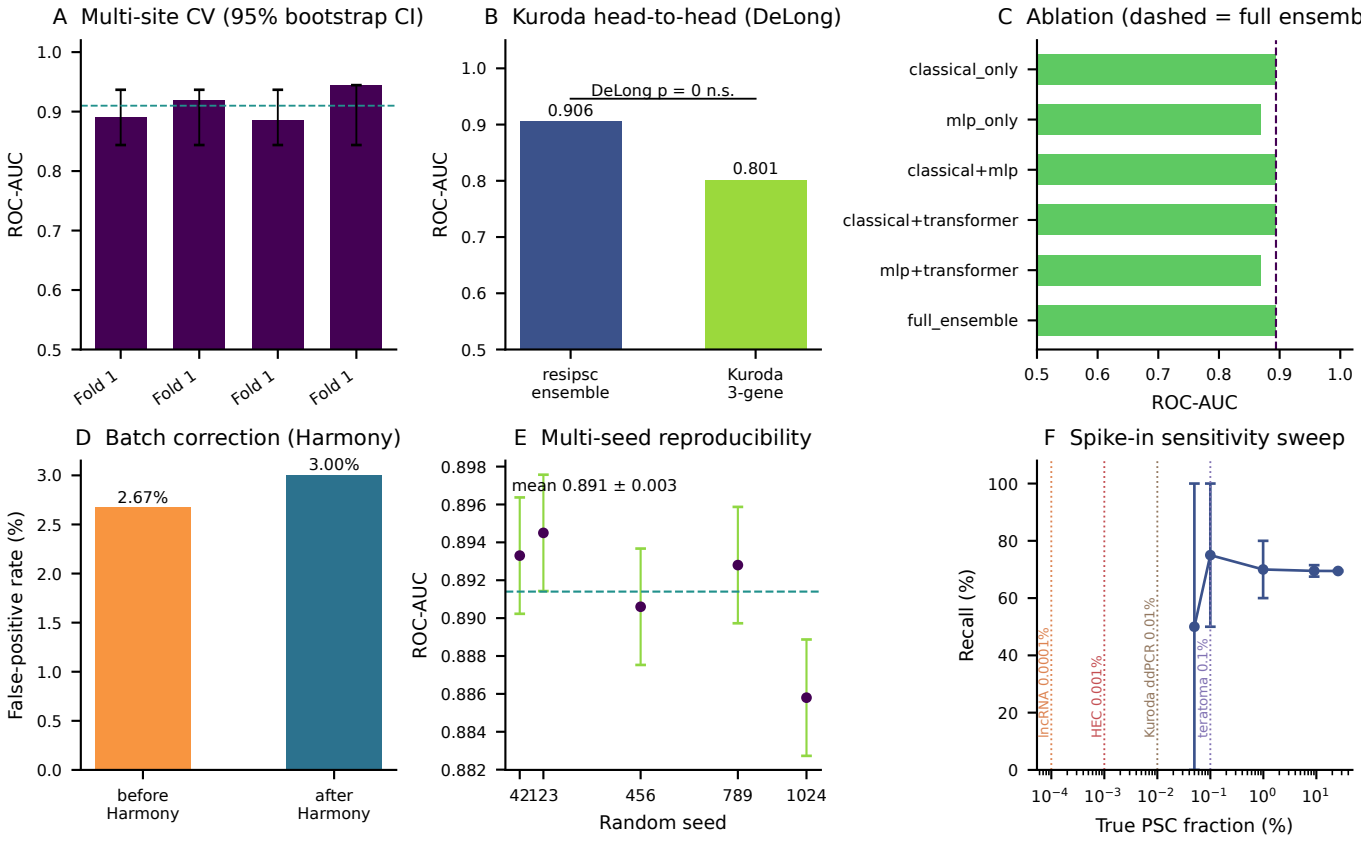
A Multi-site CV (95% bootstrap CI)
ROC-AUC
Fold 1
Fold 1
Fold 1
Fold 1
B Kuroda head-to-head (DeLong)
DeLong p = 0 n.s.
0.906
0.801
resipsc ensemble
Kuroda 3-gene
C Ablation (dashed = full ensemb
classical_only
mlp_only
classical+mlp
classical+transformer
mlp+transformer
full_ensemble
ROC-AUC
D Batch correction (Harmony)
False-positive rate (%)
2.67%
3.00%
before Harmony
after Harmony
E Multi-seed reproducibility
mean 0.891 ± 0.003
ROC-AUC
42123
456
789
1024
Random seed
F Spike-in sensitivity sweep
Recall (%)
lncRNA 0.0001%
HEC 0.001%
Kuroda ddPCR 0.01%
teratoma 0.1%
True PSC fraction (%)