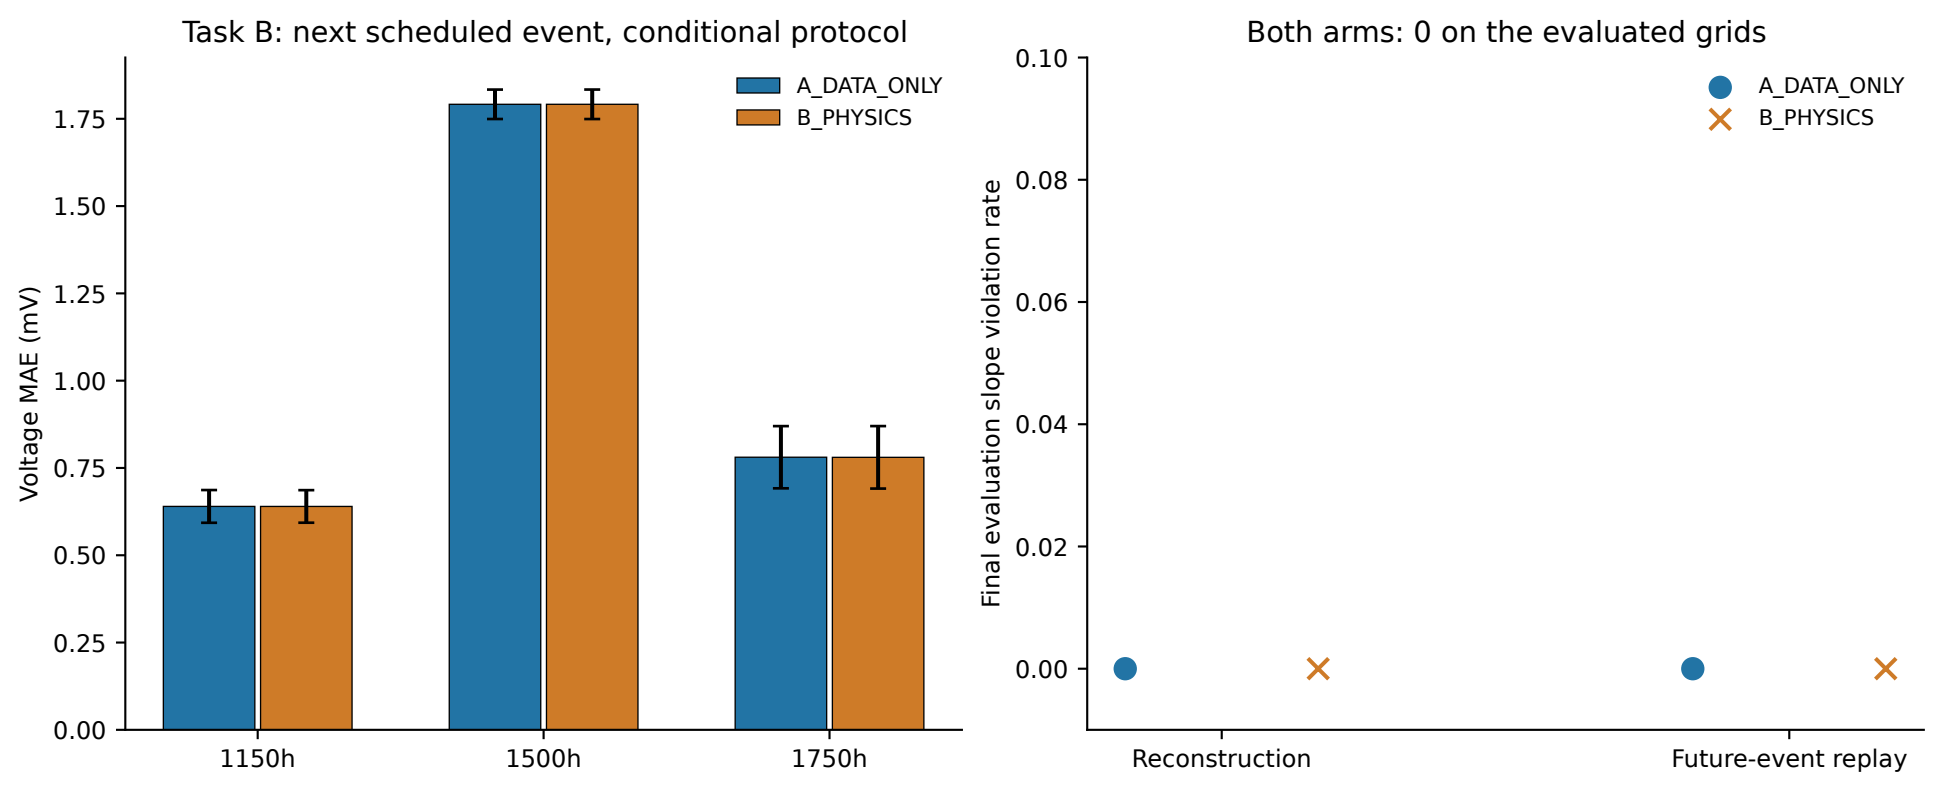
Task B: next scheduled event, conditional protocol
A_DATA_ONLY
B_PHYSICS
Voltage MAE (mV)
0.00
0.25
0.50
0.75
1.00
1.25
1.50
1.75
1150h
1500h
1750h
Both arms: 0 on the evaluated grids
A_DATA_ONLY
B_PHYSICS
Final evaluation slope violation rate
0.00
0.02
0.04
0.06
0.08
0.10
Reconstruction
Future-event replay