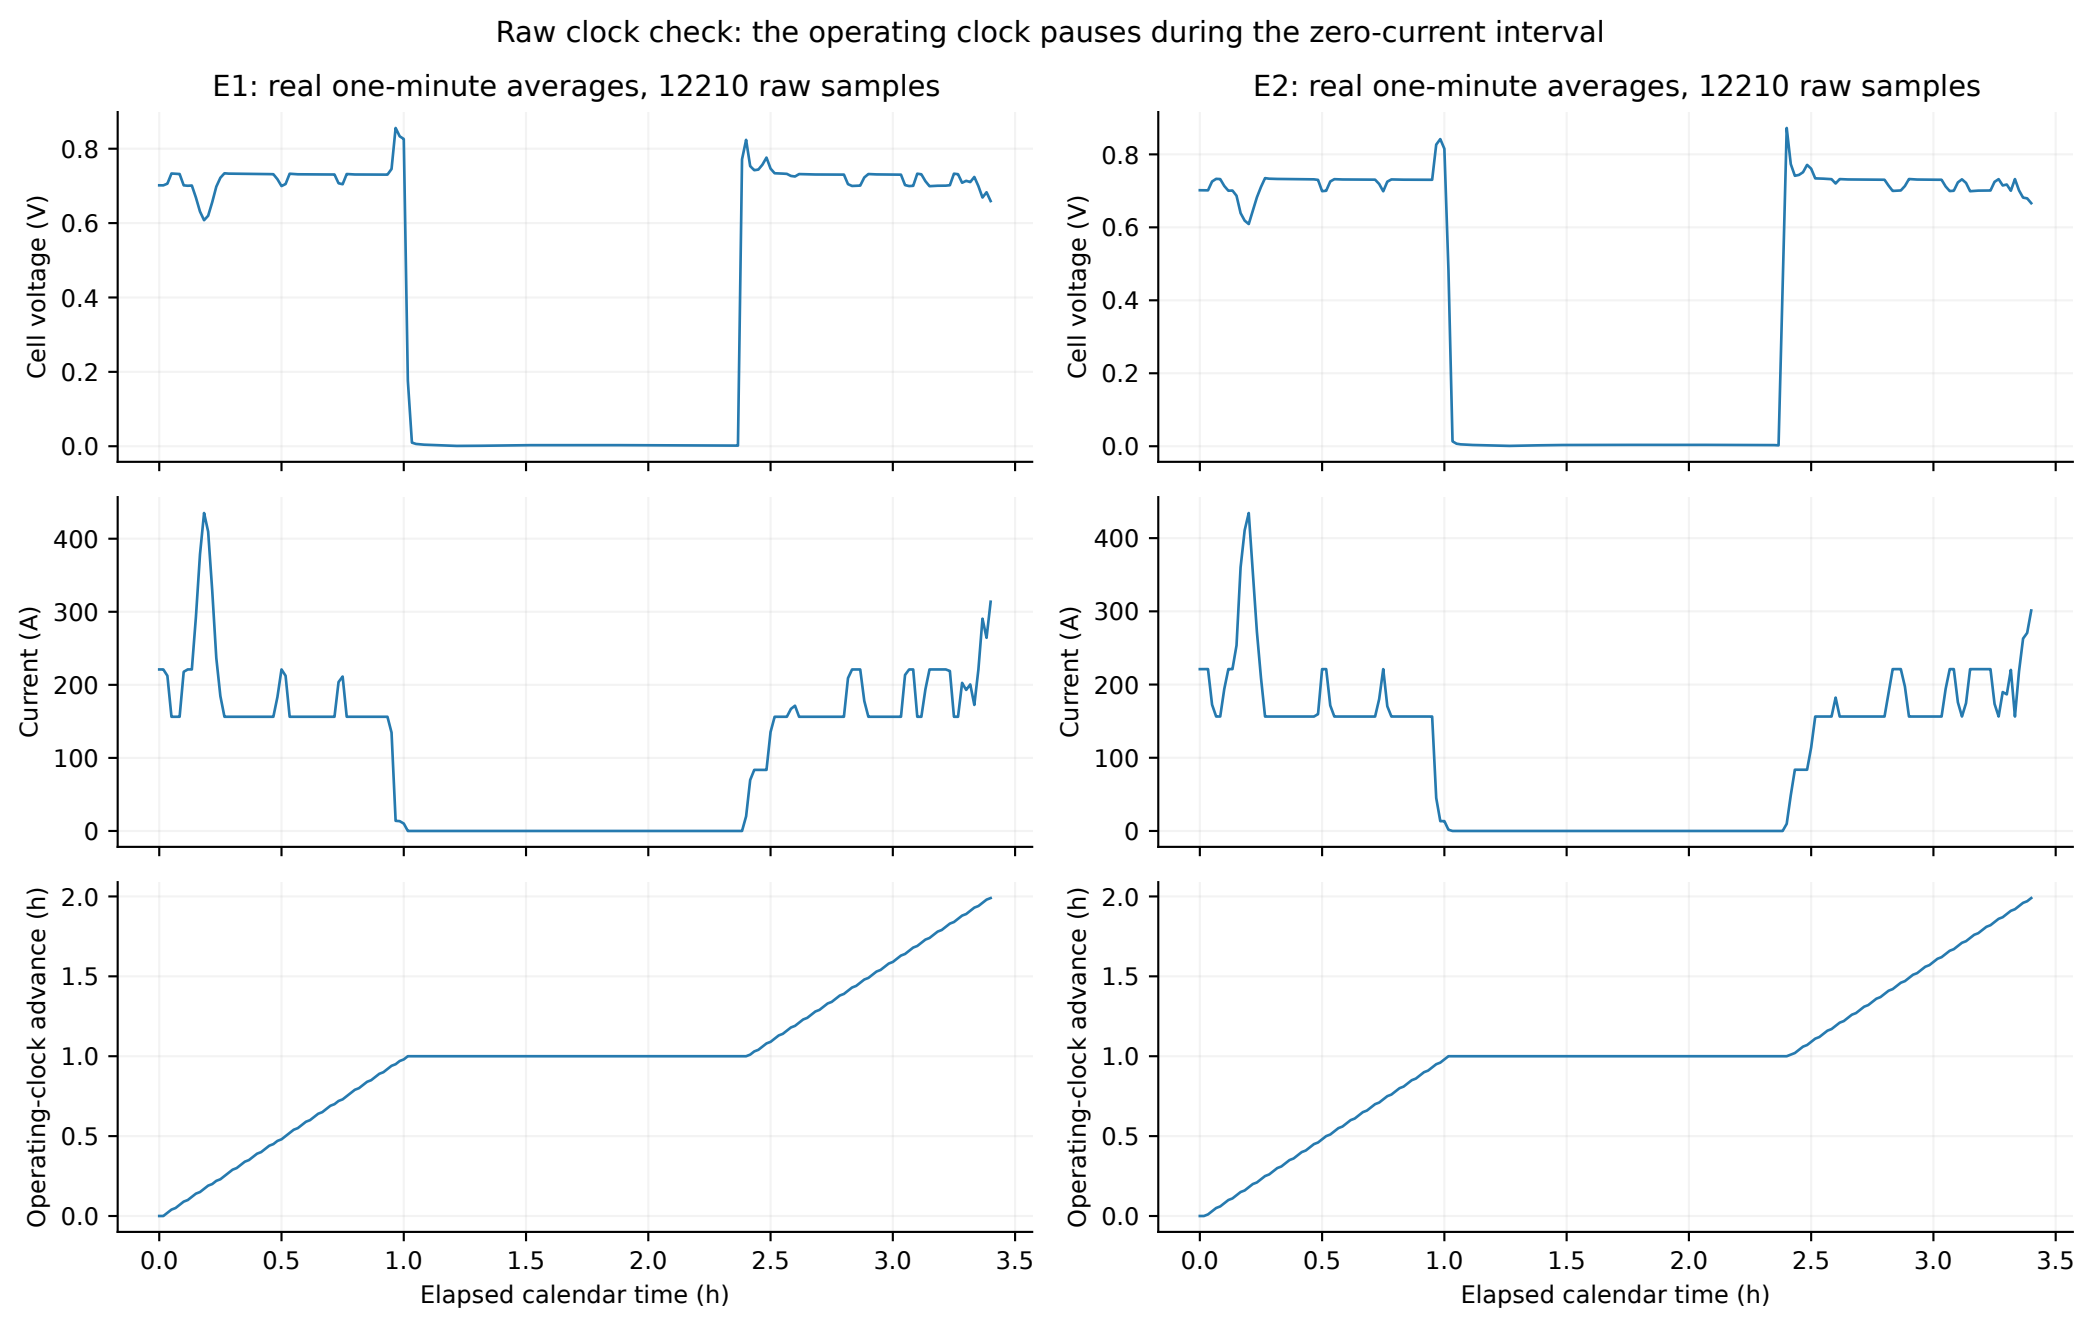
Raw clock check: the operating clock pauses during the zero-current interval
E1: real one-minute averages, 12210 raw samples
E2: real one-minute averages, 12210 raw samples
Cell voltage (V)
Current (A)
Operating-clock advance (h)
Elapsed calendar time (h)
0.0
0.2
0.4
0.6
0.8
0
100
200
300
400
0.5
1.0
1.5
2.0
2.5
3.0
3.5