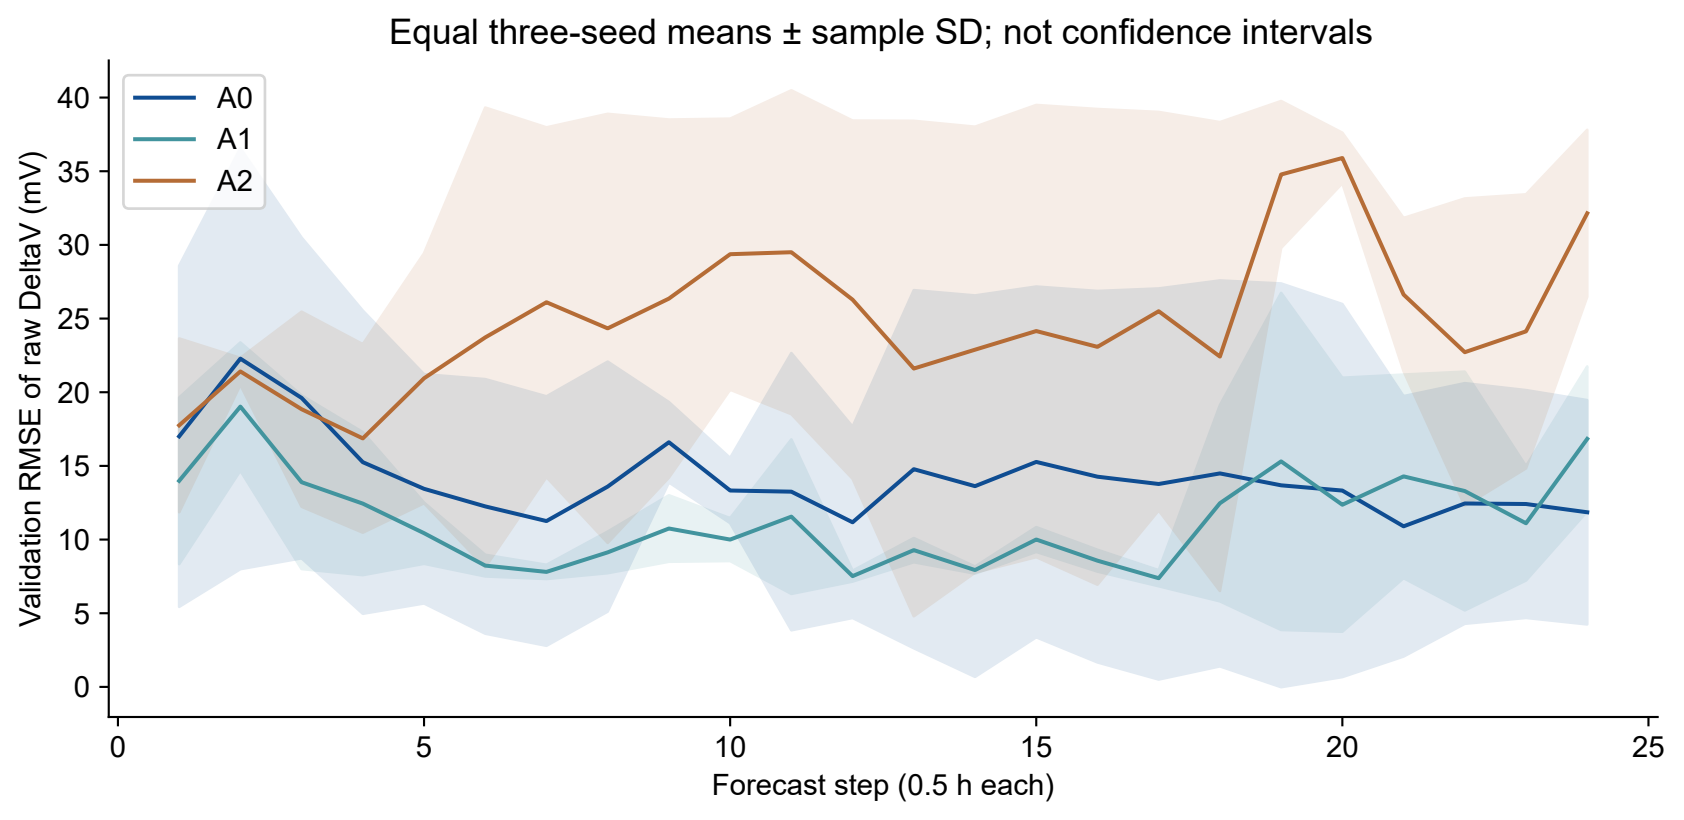
Equal three-seed means ± sample SD; not confidence intervals
A0
A1
A2
Validation RMSE of raw DeltaV (mV)
0
5
10
15
20
25
30
35
40
0
5
10
15
20
25
Forecast step (0.5 h each)