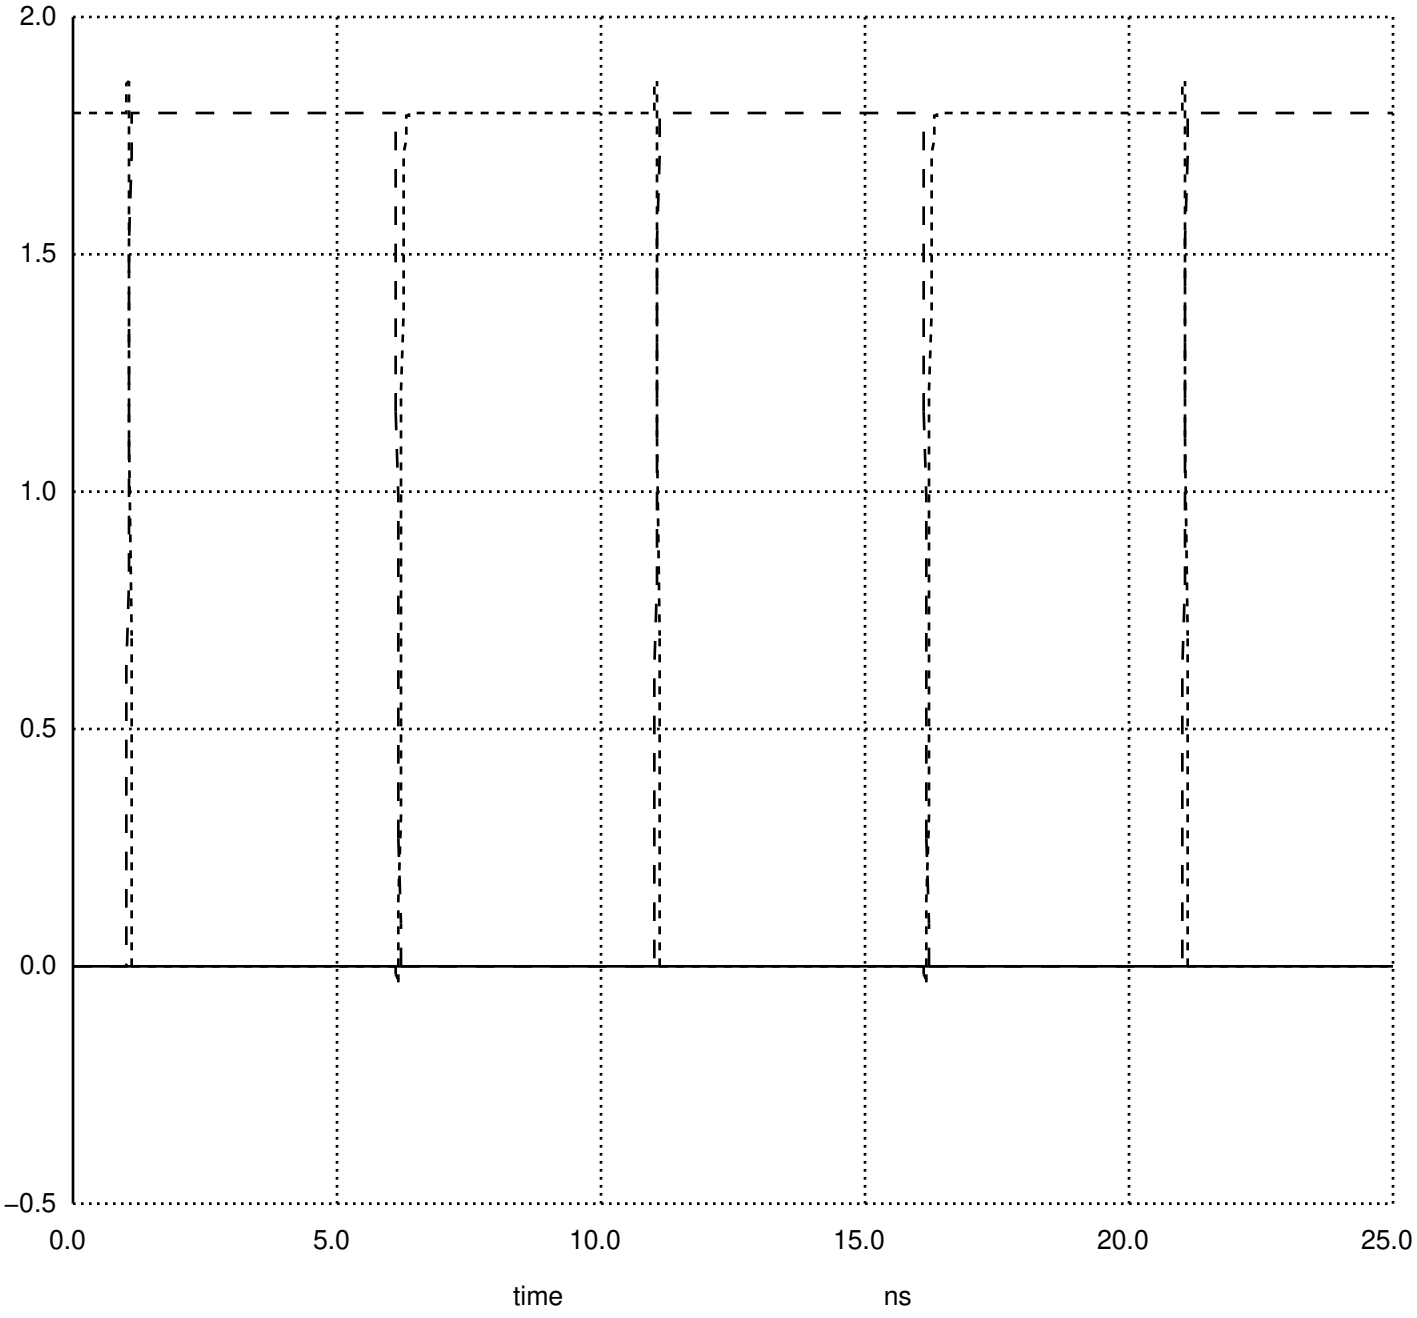
tran1: * sky130 hd inverter transient check for the accelerator's standard−cell library.
V
v(out)
v(in)
2.0
1.5
1.0
0.5
0.0
−0.5
0.0
5.0
10.0
15.0
20.0
25.0
time
ns