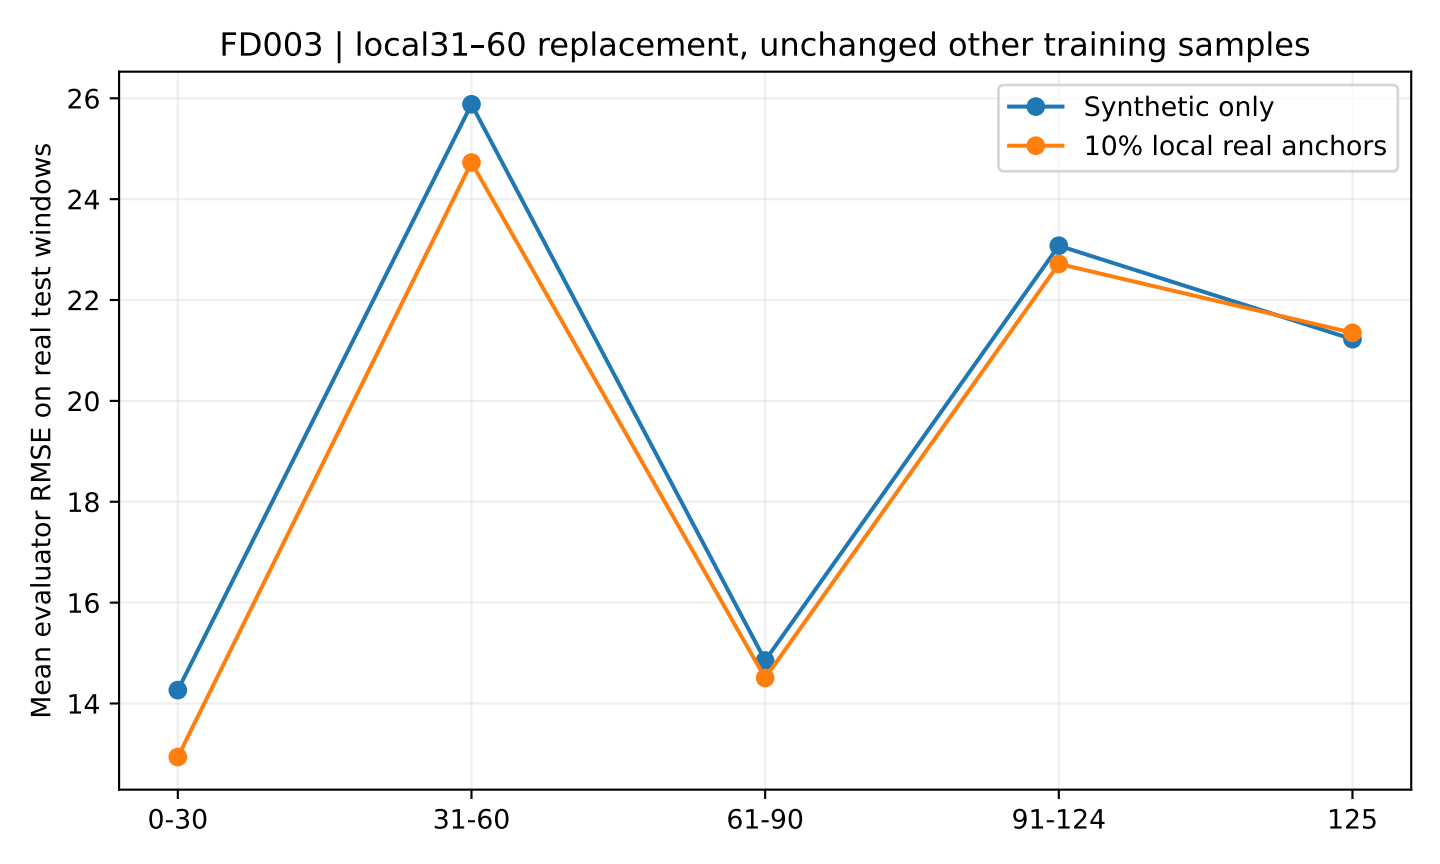
FD003 | local31–60 replacement, unchanged other training samples
Mean evaluator RMSE on real test windows
26
24
22
20
18
16
14
Synthetic only
10% local real anchors
0-30
31-60
61-90
91-124
125