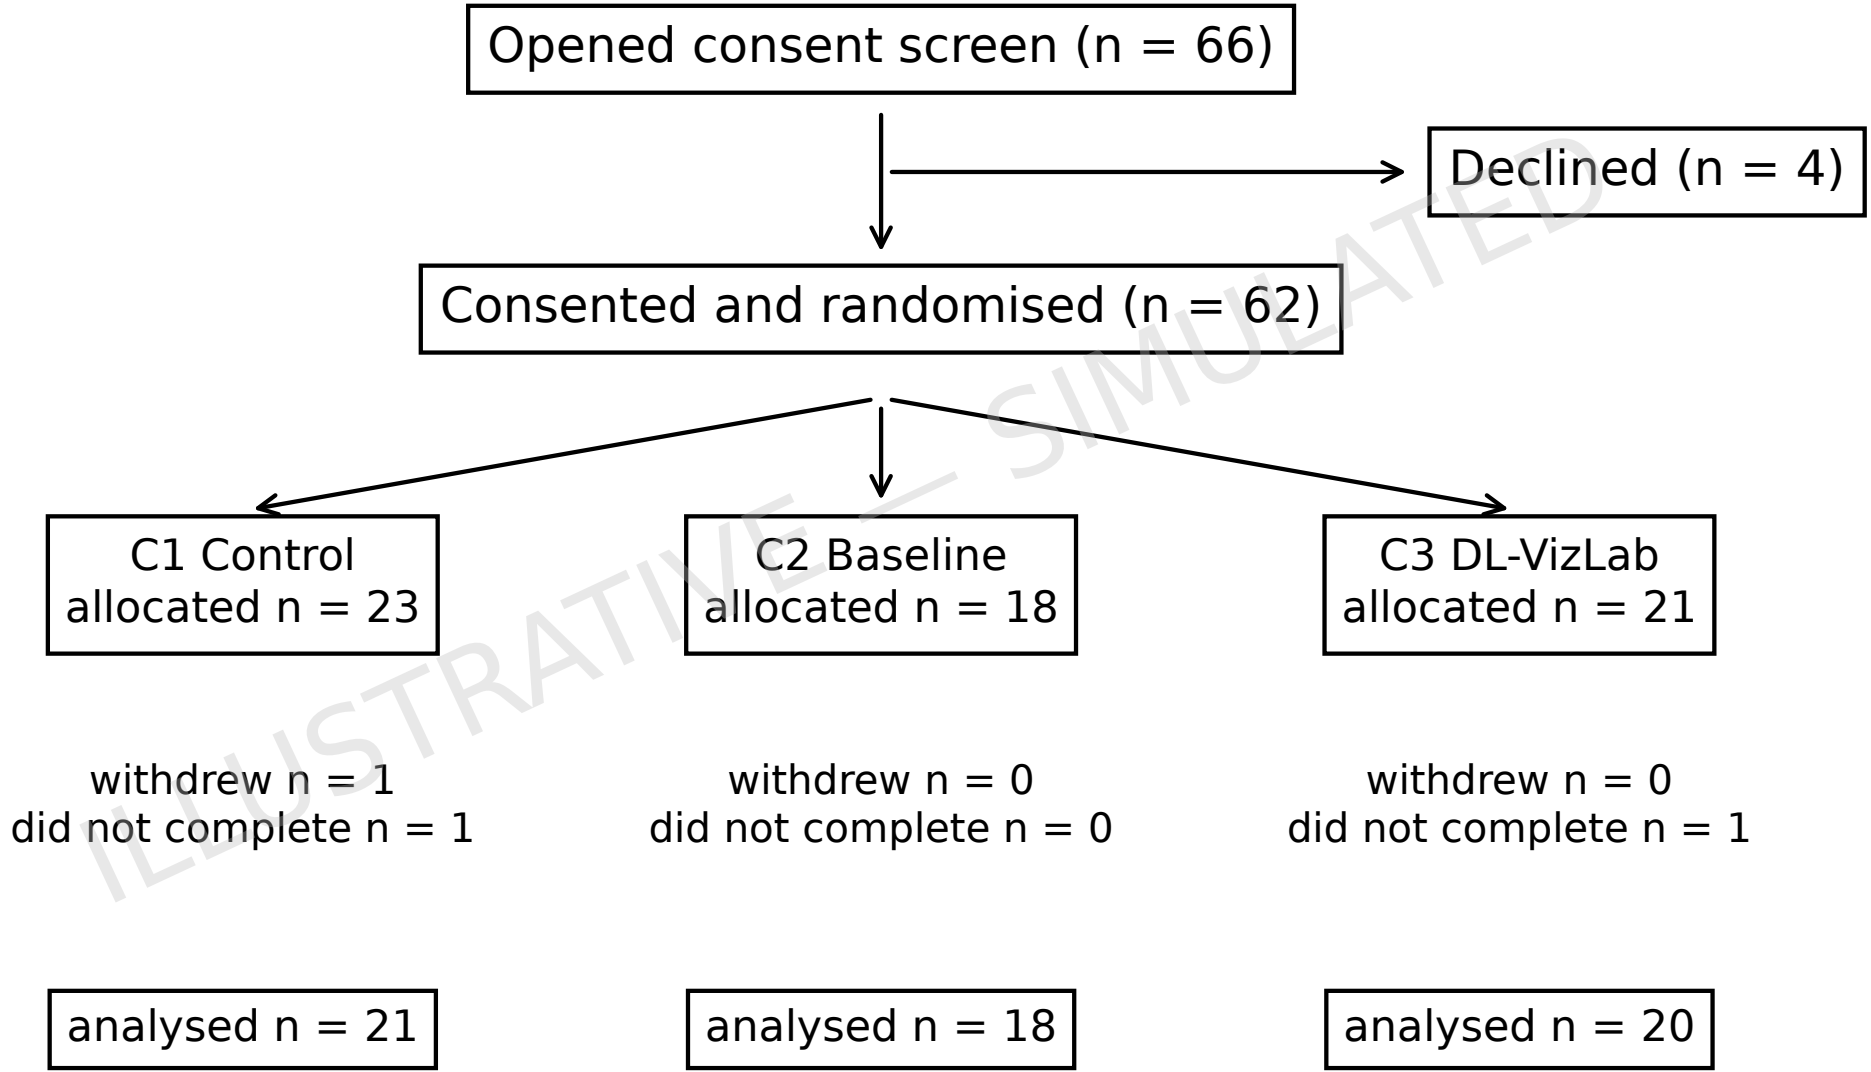
Opened consent screen (n = 66)
Declined (n = 4)
Consented and randomised (n = 62)
C1 Control
allocated n = 23
C2 Baseline
allocated n = 18
C3 DL-VizLab
allocated n = 21
withdrew n = 1
did not complete n = 1
withdrew n = 0
did not complete n = 0
withdrew n = 0
did not complete n = 1
analysed n = 21
analysed n = 18
analysed n = 20
ILLUSTRATIVE — SIMULATED