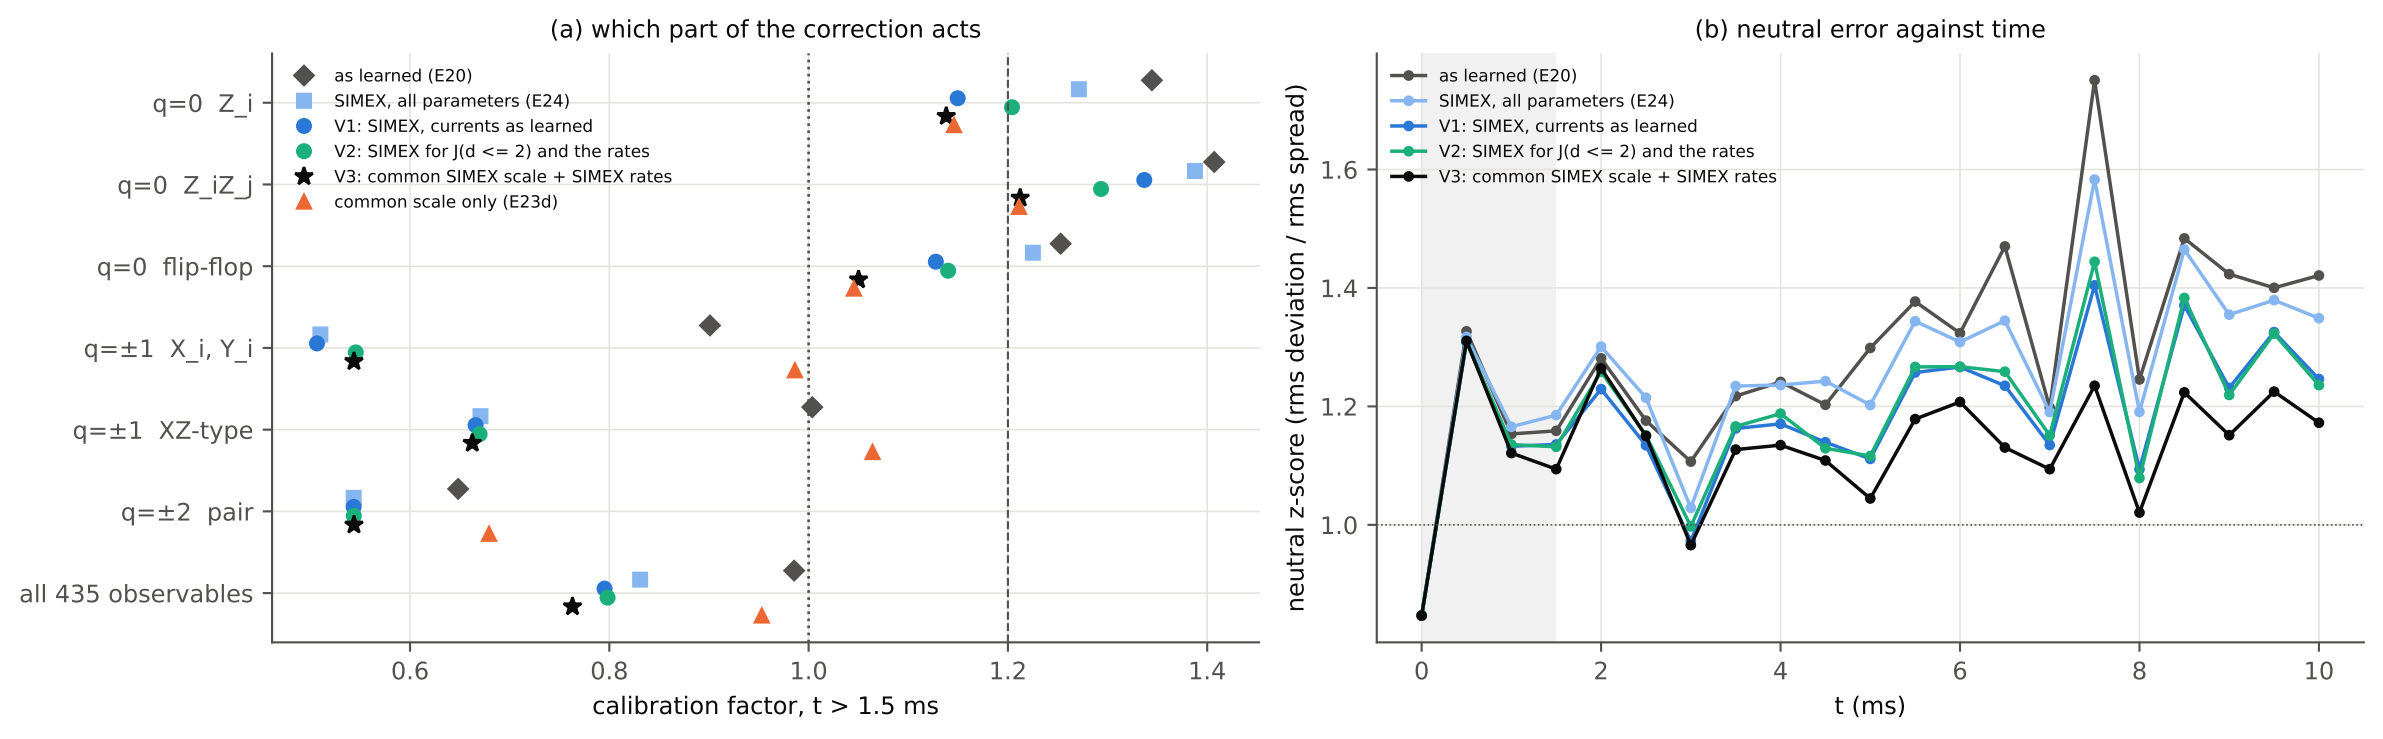
(a) which part of the correction acts
as learned (E20)
SIMEX, all parameters (E24)
V1: SIMEX, currents as learned
V2: SIMEX for J(d <= 2) and the rates
V3: common SIMEX scale + SIMEX rates
common scale only (E23d)
q=0 Z_i
q=0 Z_iZ_j
q=0 flip-flop
q=±1 X_i, Y_i
q=±1 XZ-type
q=±2 pair
all 435 observables
0.6
0.8
1.0
1.2
1.4
calibration factor, t > 1.5 ms
(b) neutral error against time
as learned (E20)
SIMEX, all parameters (E24)
V1: SIMEX, currents as learned
V2: SIMEX for J(d <= 2) and the rates
V3: common SIMEX scale + SIMEX rates
neutral z-score (rms deviation / rms spread)
1.0
1.2
1.4
1.6
0
2
4
6
8
10
t (ms)