
CONVENIENCE STORE - FLOOR PLANS (BUSINESS NEEDS)

Top view of both floors, room names and areas tagged | dimensions in millimetres | grids 1-4 / A-C


GROUND FLOOR

FFL +0.15 | 15.00 x 10.00 m | floor area 150 m²

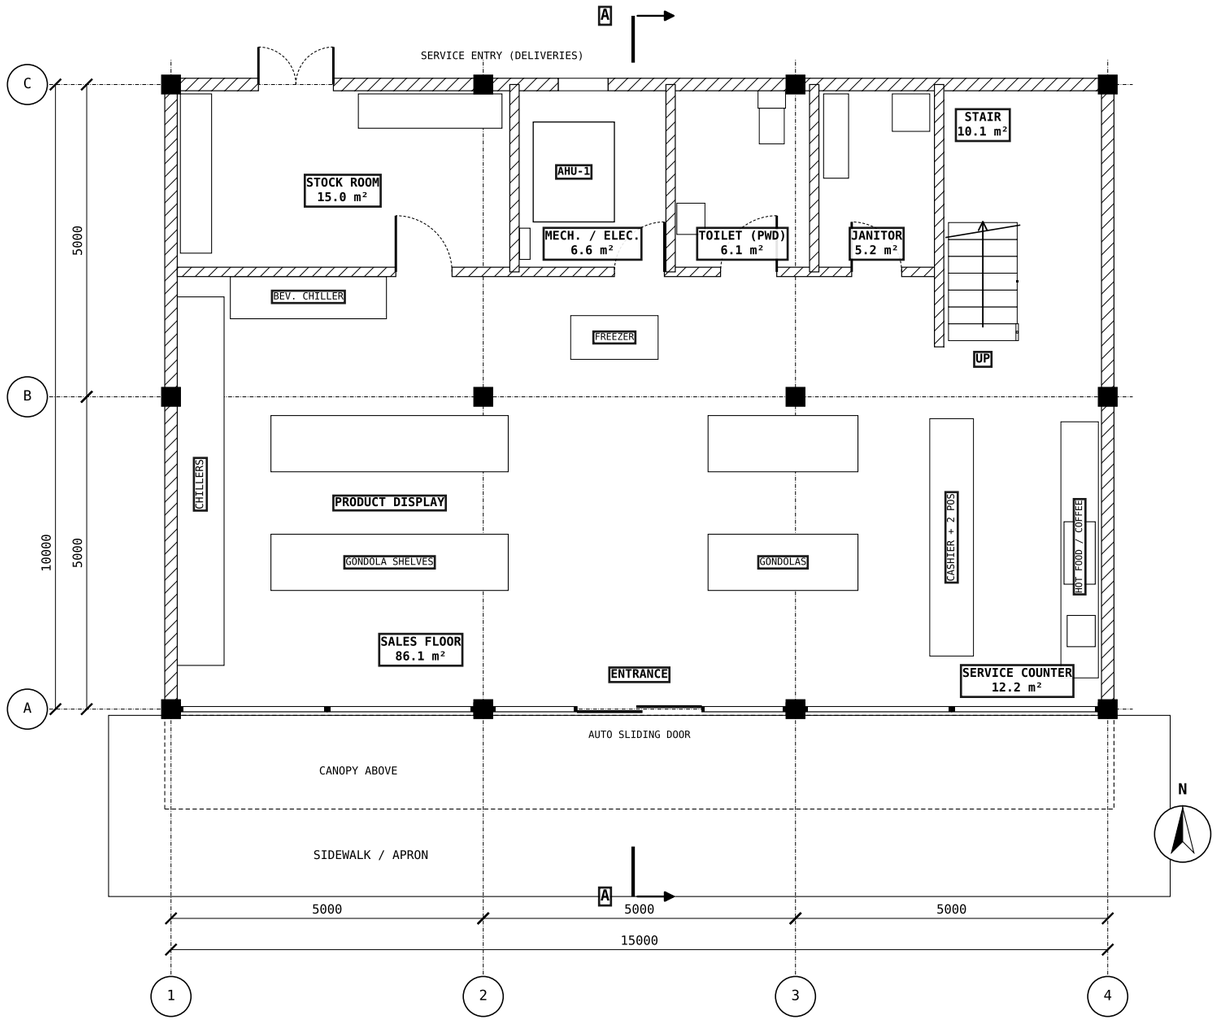

SECOND FLOOR

FFL +4.00 | 15.00 x 10.00 m | floor area 150 m²

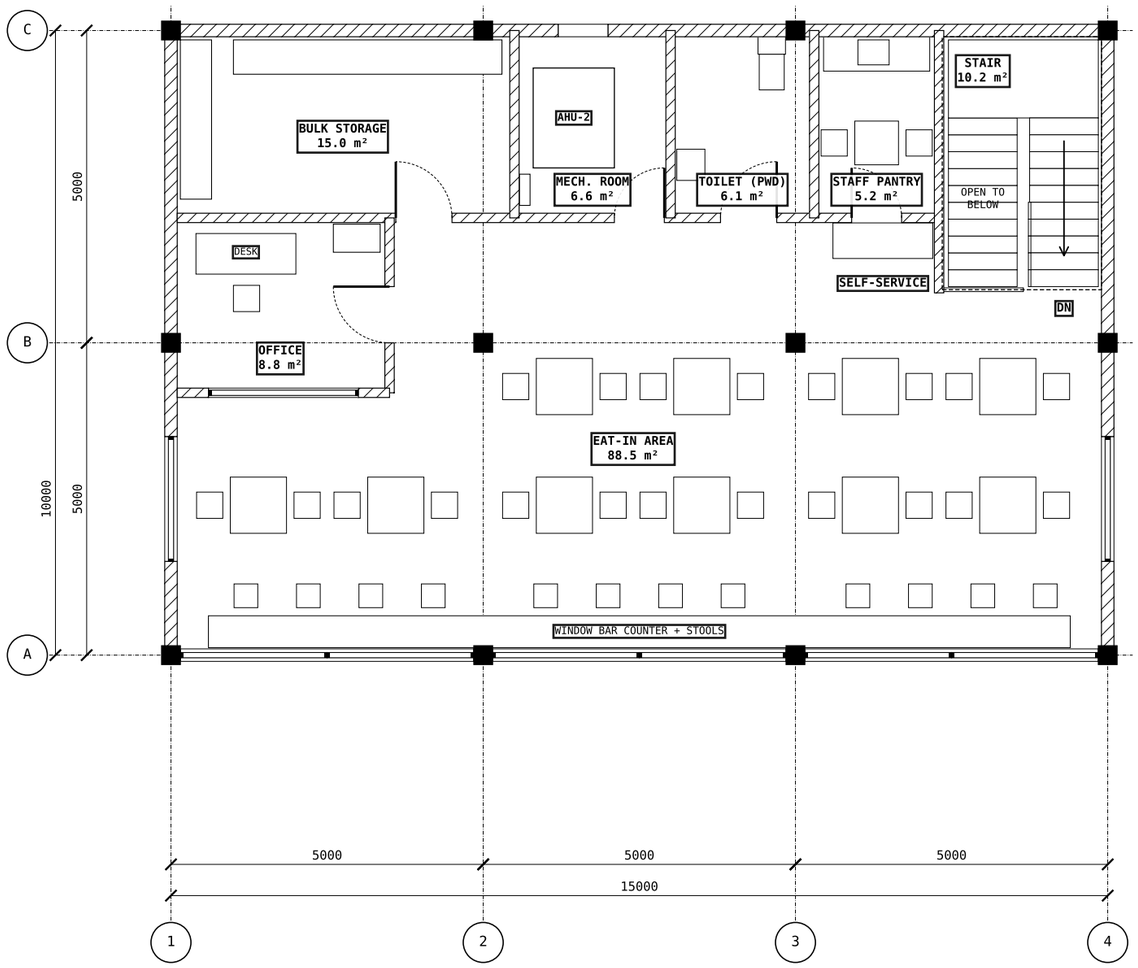

NOTES

1. Customer area: sales floor (GF) + eat-in area (2F).
2. Service counter: cashier with 2 POS + hot food / coffee back counter;
   2F self-service water & condiment station.
3. Product display: 8 gondola shelves, reach-in & beverage chillers, freezer.
4. Storage: GF stock room (rear delivery door) + 2F bulk storage.
5. Basic utilities: PWD toilet each floor, mechanical / electrical room,
   janitor closet, staff pantry, office.
6. Structure: RC frame, 300x300 columns, 250x450 beams, 150 slabs.
7. Walls: 200 CHB exterior, 150 CHB partitions; storefront glass + auto door.


PROJECT: **CONVENIENCE STORE (2-STOREY)**	
NAME: **JOHN EARL LAWRENCE C. VERANO**	
SHEET A-101 FLOOR PLANS	SCALE 1:100 (NTS on screen)

CONVENIENCE STORE - HVAC LAYOUT

Ducted system: one AHU per floor in the mechanical room | supply / return ducts above ceiling


HVAC - GROUND FLOOR

FFL +0.15

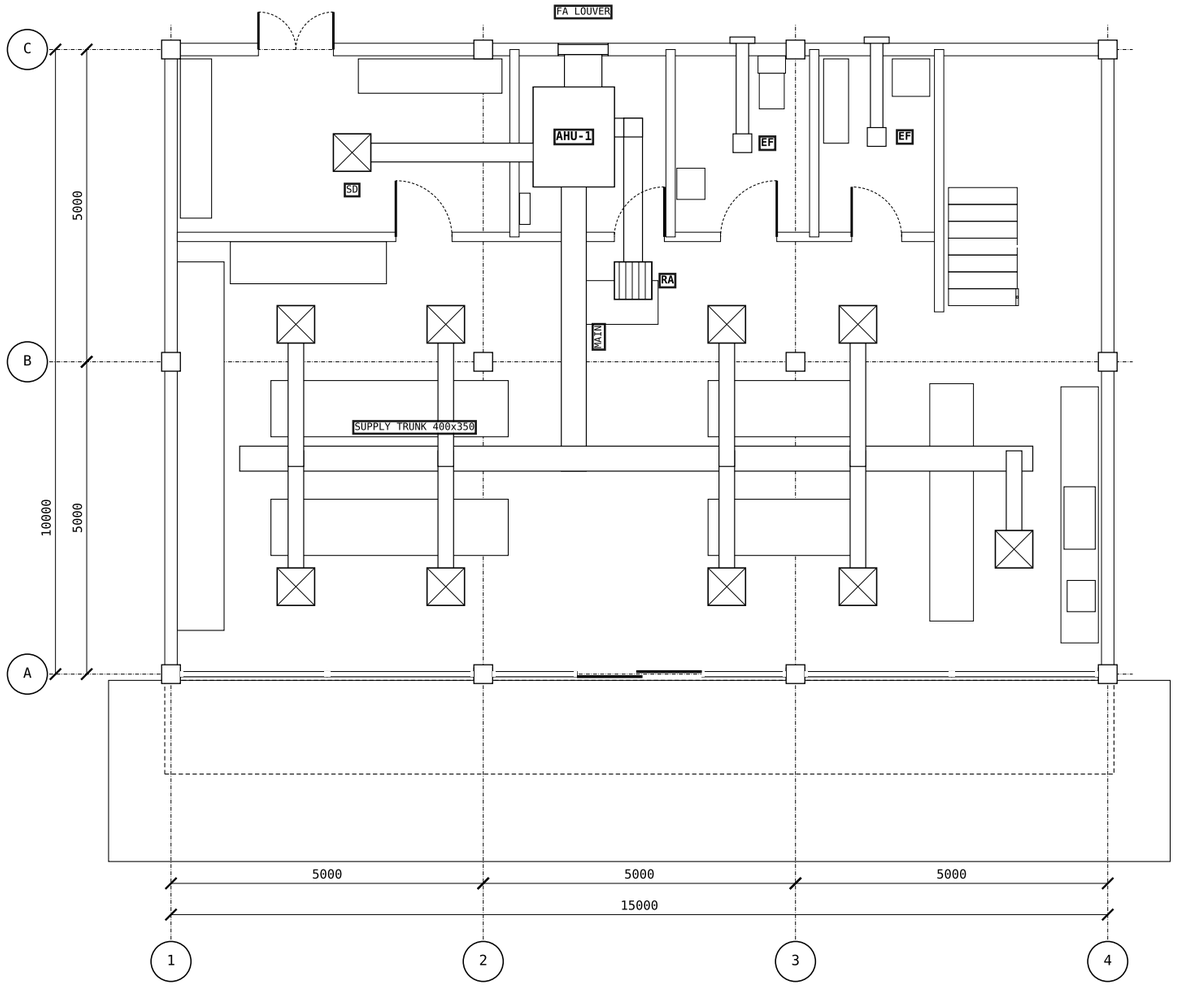

HVAC - SECOND FLOOR

FFL +4.00

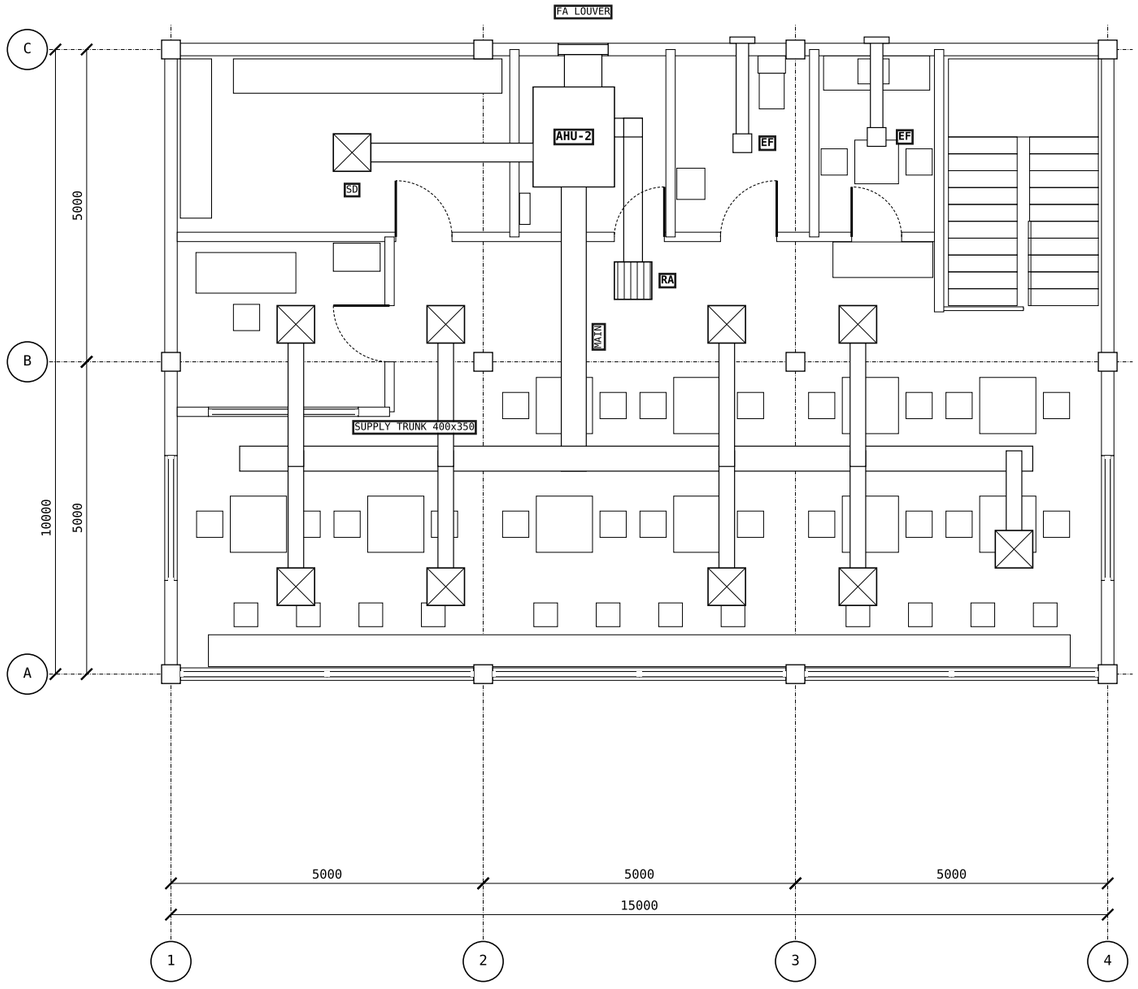

HVAC LEGEND

- Supply air duct
- Return / exhaust duct
- Ceiling supply diffuser 600x600
- Return air grille 600x600
- AHU / FCU (indoor unit)
- Exhaust fan (EF)
- Fresh-air duct + louver

EQUIPMENT SCHEDULE

AHU-1 GF mech. room, floor-mounted, ~3 TR, serves sales floor + stock room
AHU-2 2F mech. room, floor-mounted, ~3 TR, serves eat-in area + office
SD ceiling supply diffuser 600x600, 9 per floor (+1 storage)
RA return air grille 600x600 ducted back to AHU
EF ceiling exhaust fan, toilet / janitor / pantry, ducted to wall louver
FA fresh-air louver on rear wall ducted to AHU intake
Duct sizes: trunk 400x350, main 400x350, branches 250x250


PROJECT: **CONVENIENCE STORE (2-STOREY)**	
NAME: **JOHN EARL LAWRENCE C. VERANO**	
SHEET M-101 HVAC LAYOUT	SCALE 1:100 (NTS on screen)

CONVENIENCE STORE - FIRE SPRINKLER LAYOUT

Wet-pipe automatic sprinkler system | Ordinary Hazard (mercantile) | city fire service + FDC -> 100 riser -> 65 cross main -> 32 branch lines -> pendent heads


SPRINKLERS - GROUND FLOOR

FFL +0.15

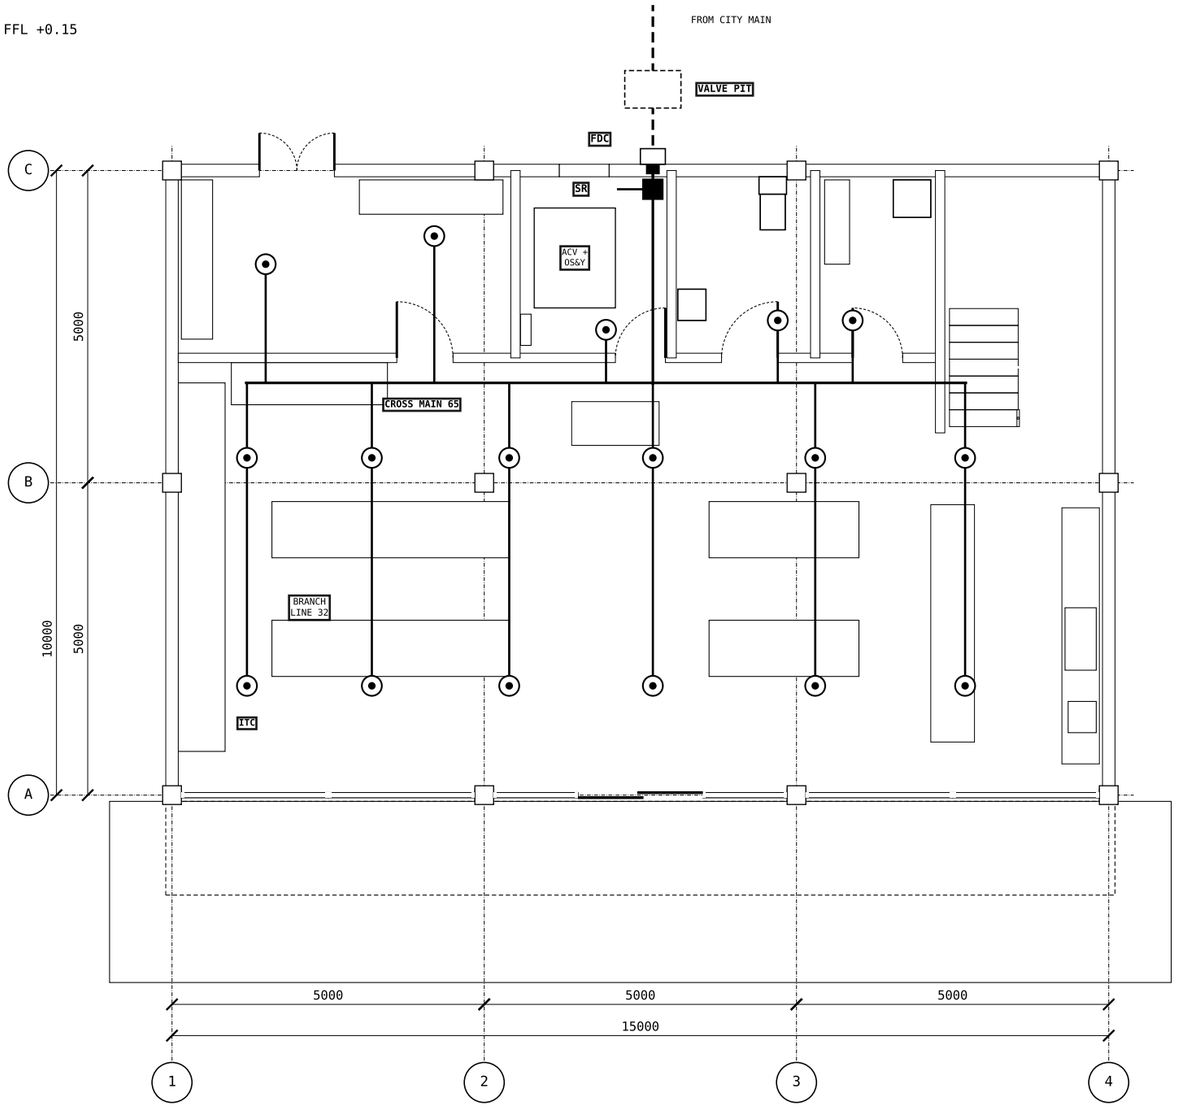

SPRINKLERS - SECOND FLOOR

FFL +4.00

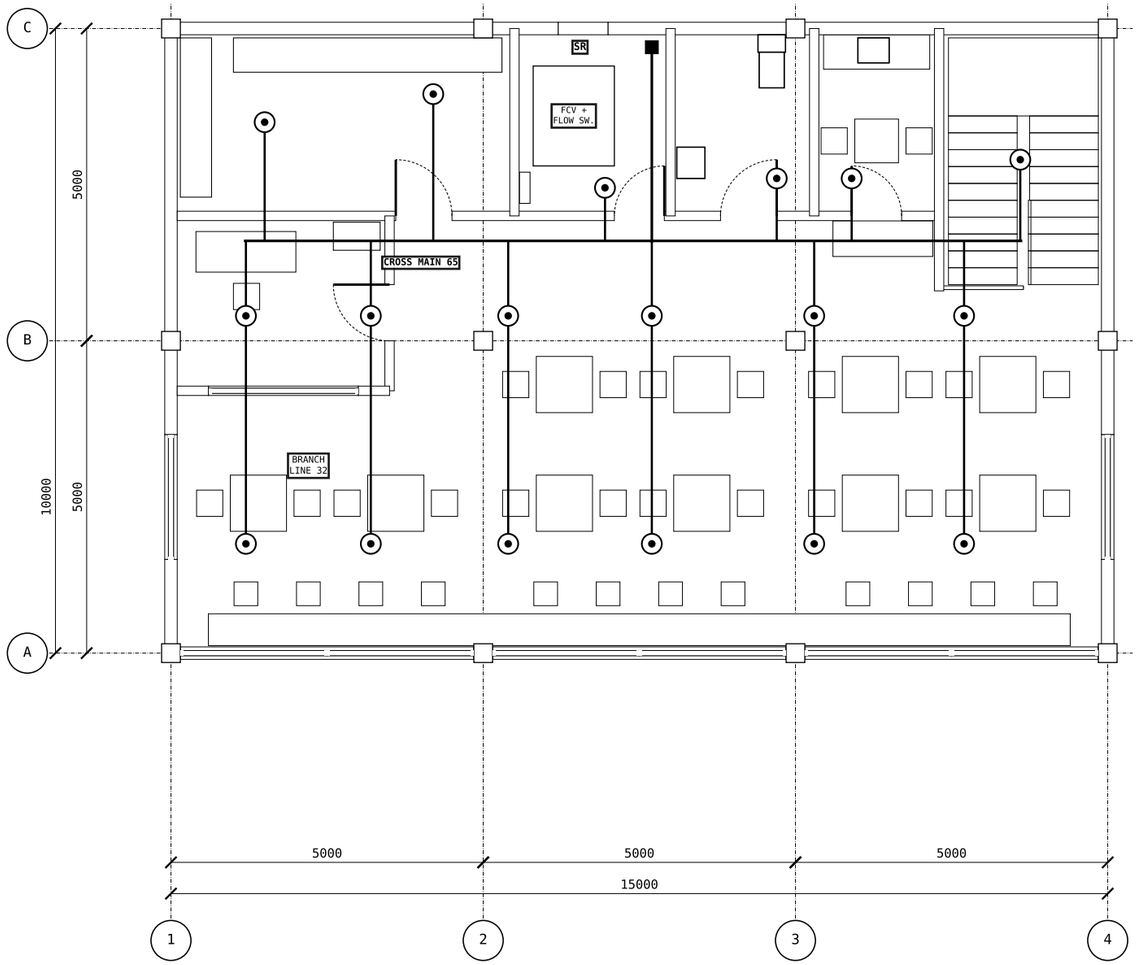

SPRINKLER LEGEND

- Pendent sprinkler head (68 C)
- Cross main 65 / branch line 32
- Fire service line (underground)
- Sprinkler riser 100
- Alarm check valve / control valve
- Fire dept. connection (Siamese)
- Valve pit (check + backflow)

DESIGN NOTES / ABBREVIATIONS

Heads: GF 17 + 2F 18 = 35 pendent, 68 C, K80, deflector at ceiling line (EL +2.65 / +6.60)
Spacing: max 4.6 m, max 12.1 m2 per head, max 2.3 m to wall (Ordinary Hazard)
SR sprinkler riser 100 (black steel)   cross main 65   branch lines 32   drops 25
Pipes run above ducts / below beams: centre EL +3.20 (GF), +7.15 (2F)
ACV alarm check valve   OS&Y main control valve   FCV floor control valve + flow switch
FDC fire department connection (Siamese, back wall)   ITC inspector's test connection
Water: city fire service line via valve pit (detector check + backflow preventer)
Stair: open to 2F, covered by the 2F head over the stair. Levels: user datum GF 0.00

PROJECT: **CONVENIENCE STORE (2-STOREY)**	
NAME: **JOHN EARL LAWRENCE C. VERANO**	
SHEET FP-101 FIRE SPRINKLER LAYOUT	SCALE 1:100 (NTS on screen)