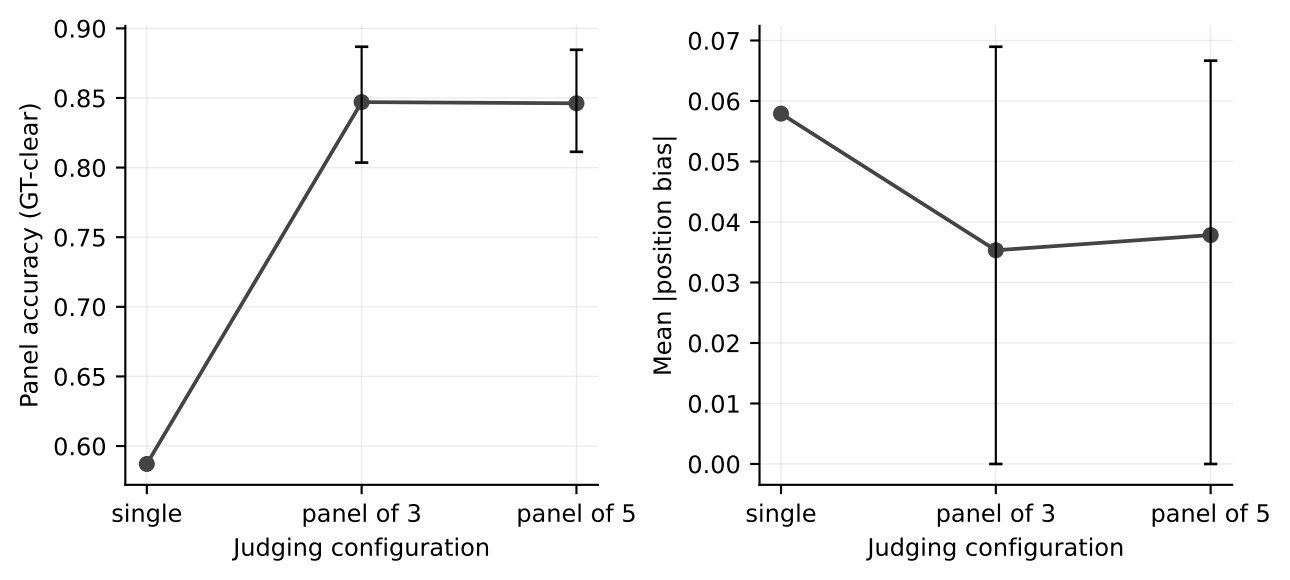
Panel accuracy (GT-clear)
0.90
0.85
0.80
0.75
0.70
0.65
0.60
single
panel of 3
panel of 5
Judging configuration
Mean |position bias|
0.07
0.06
0.05
0.04
0.03
0.02
0.01
0.00
single
panel of 3
panel of 5
Judging configuration