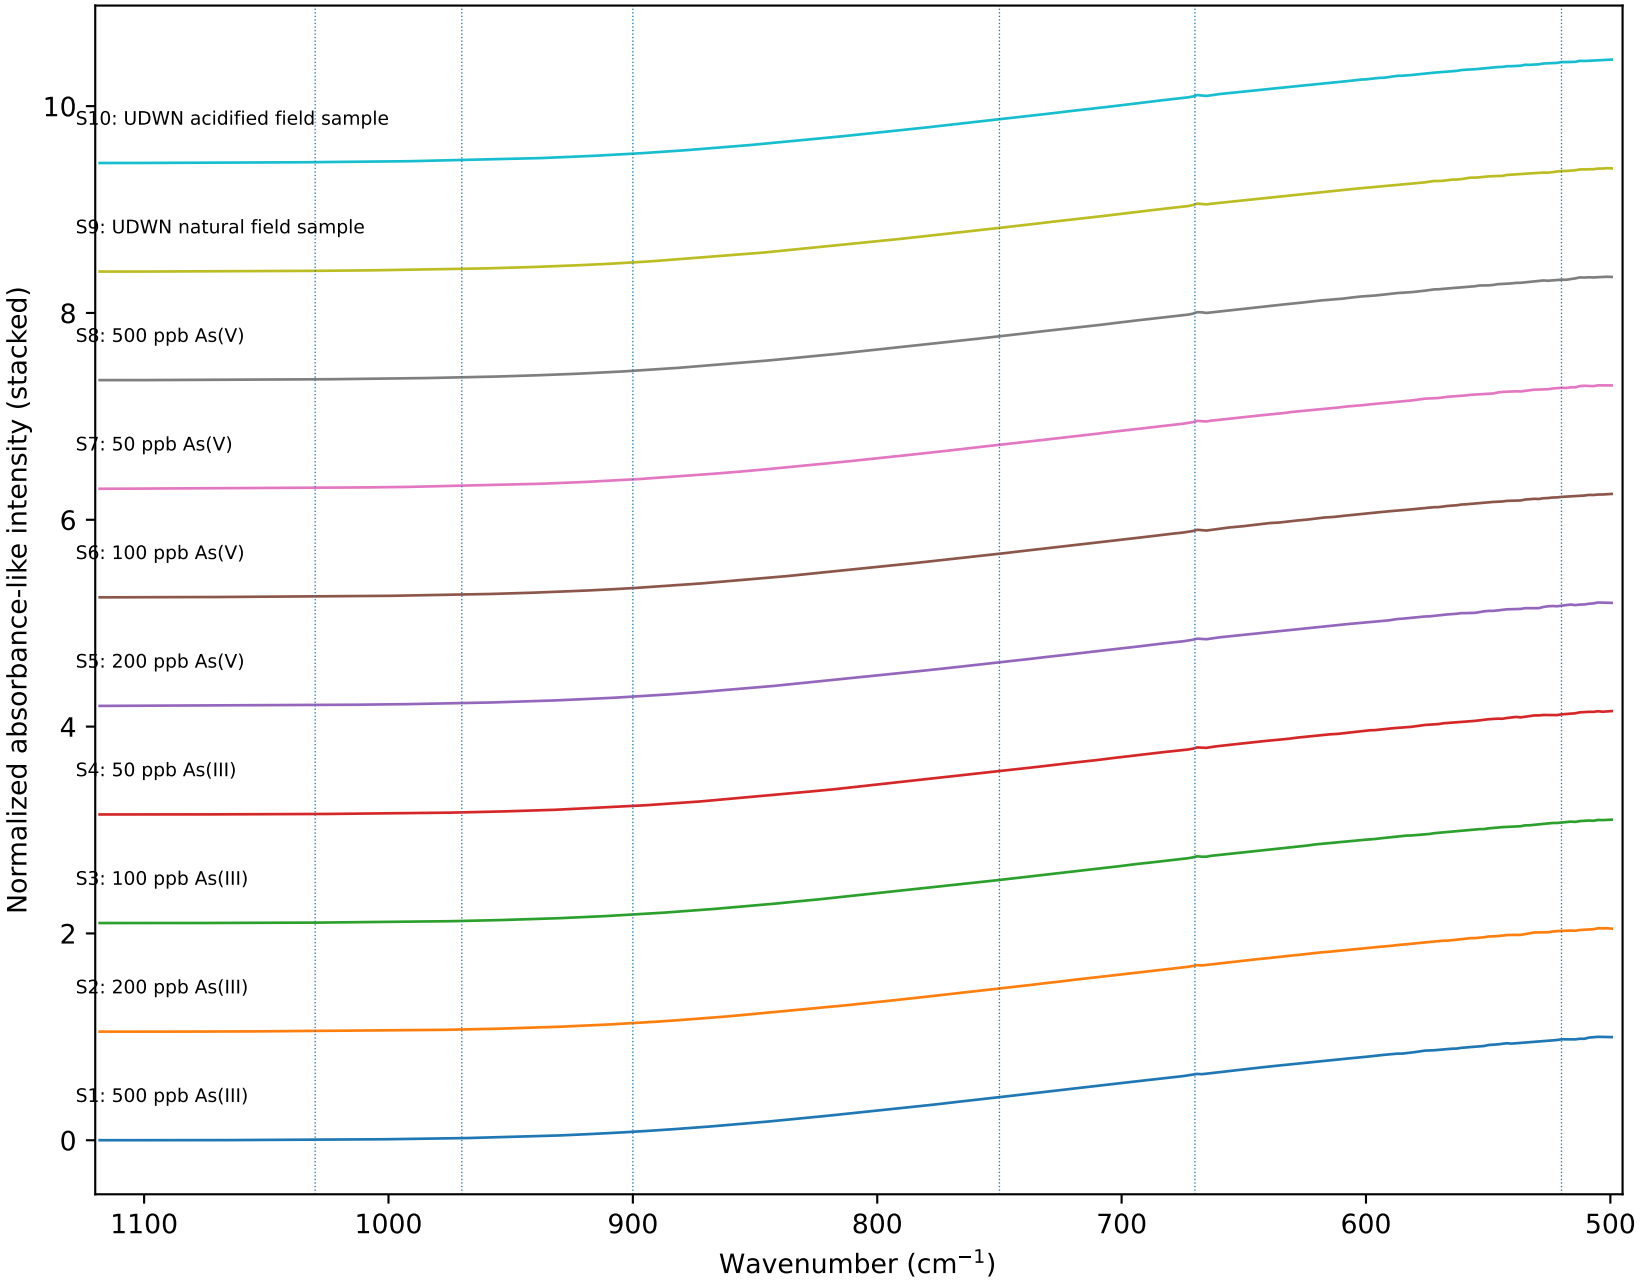
FTIR fingerprint-region comparison of arsenic standards and field samples
S10: UDWN acidified field sample
S9: UDWN natural field sample
S8: 500 ppb As(V)
S7: 50 ppb As(V)
S6: 100 ppb As(V)
S5: 200 ppb As(V)
S4: 50 ppb As(III)
S3: 100 ppb As(III)
S2: 200 ppb As(III)
S1: 500 ppb As(III)
Normalized absorbance-like intensity (stacked)
0
2
4
6
8
10
1100
1000
900
800
700
600
500
Wavenumber (cm^{-1})