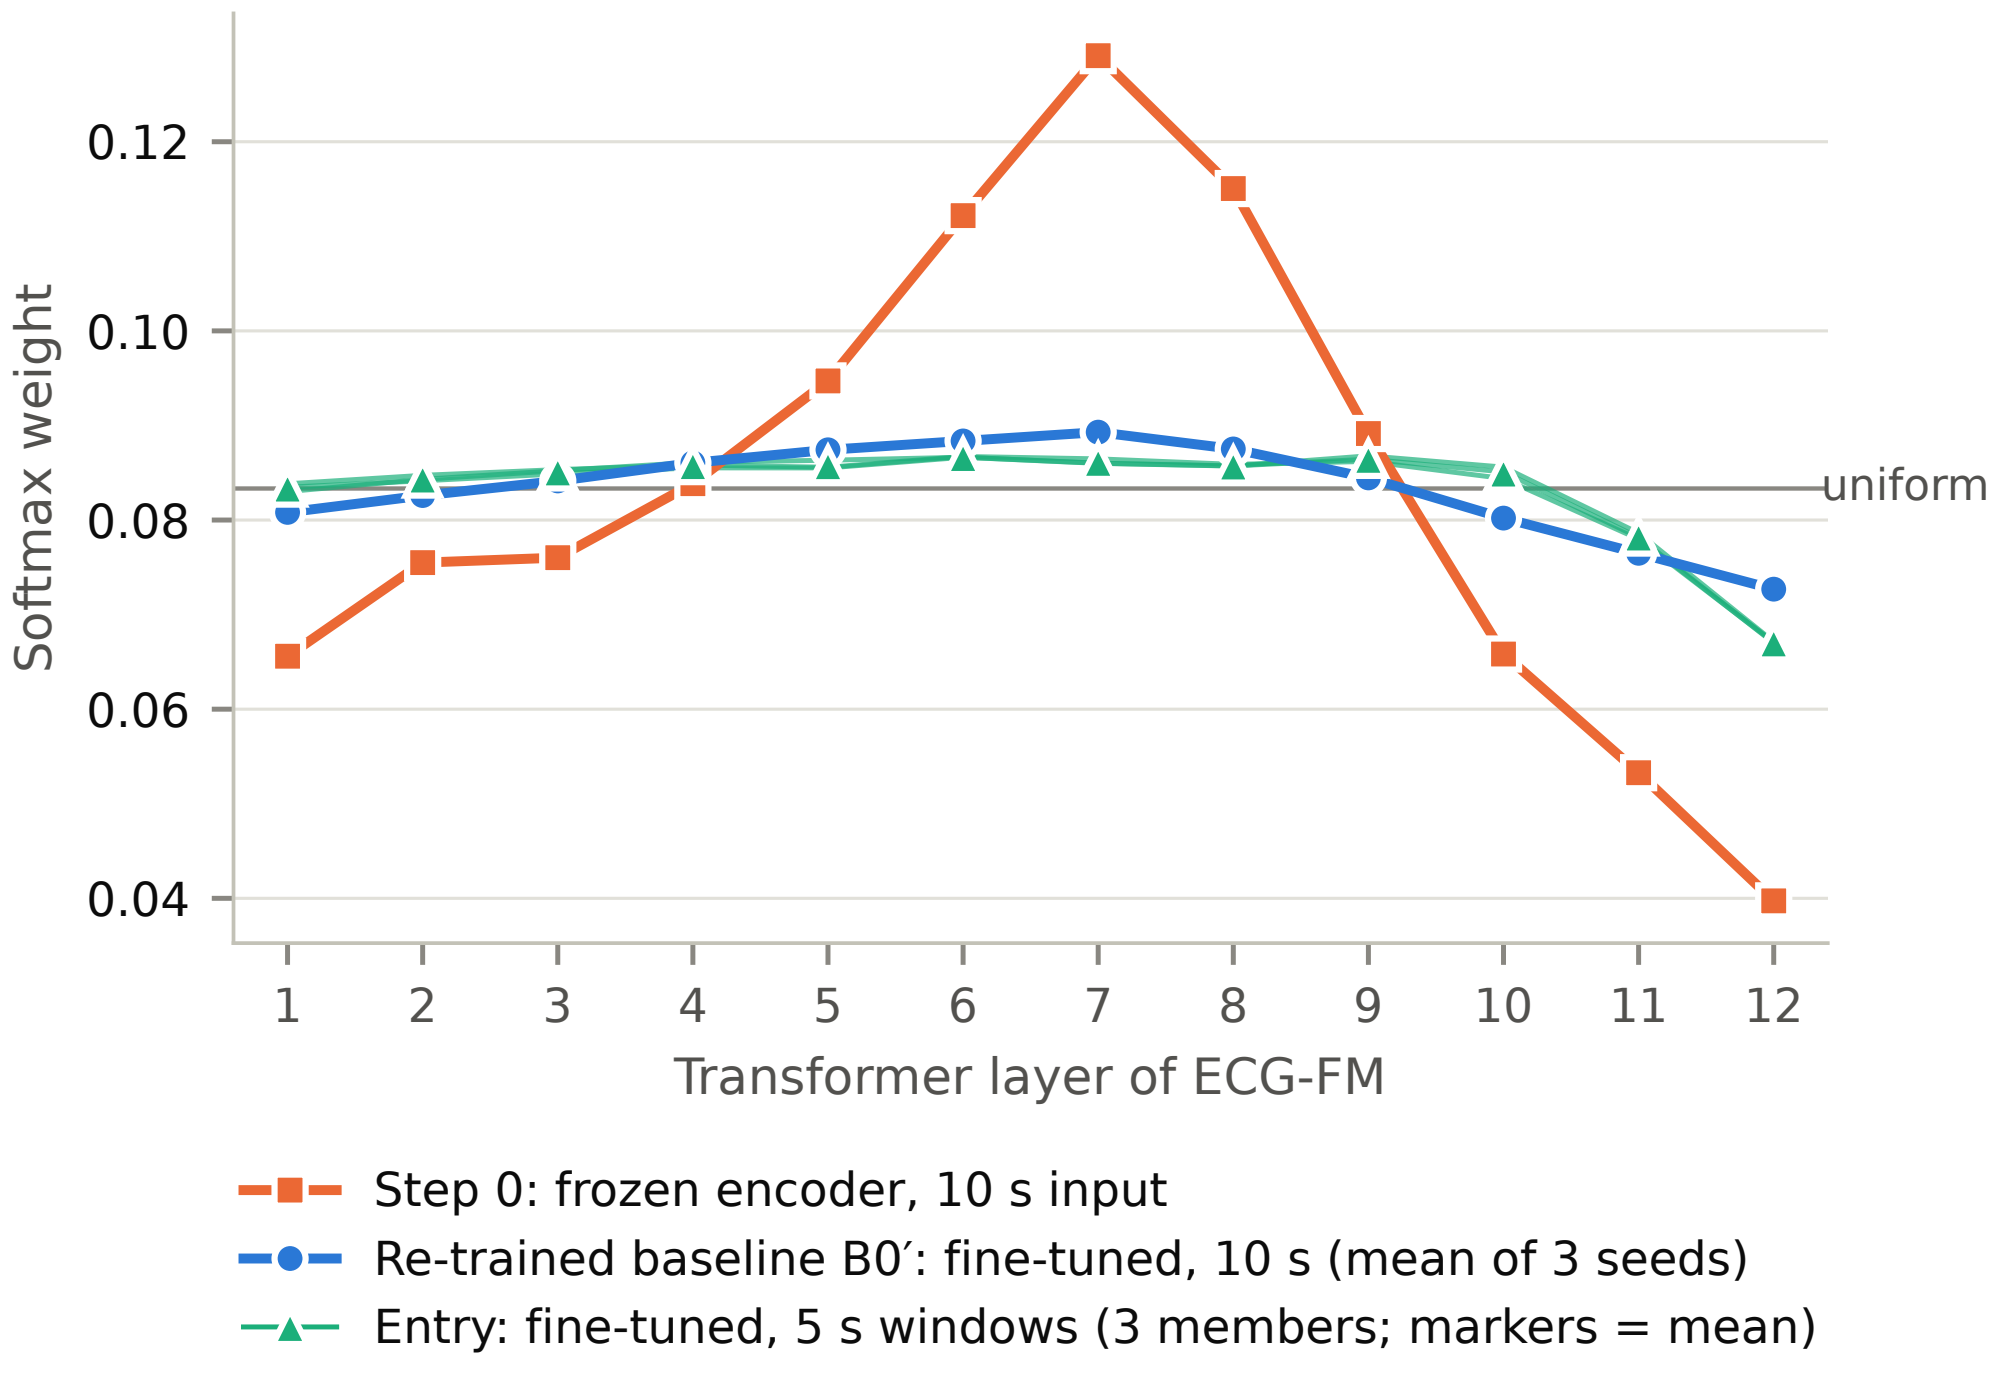
0.12
0.10
0.08
0.06
0.04
Softmax weight
uniform
1
2
3
4
5
6
7
8
9
10
11
12
Transformer layer of ECG-FM
Step 0: frozen encoder, 10 s input
Re-trained baseline B0′: fine-tuned, 10 s (mean of 3 seeds)
Entry: fine-tuned, 5 s windows (3 members; markers = mean)