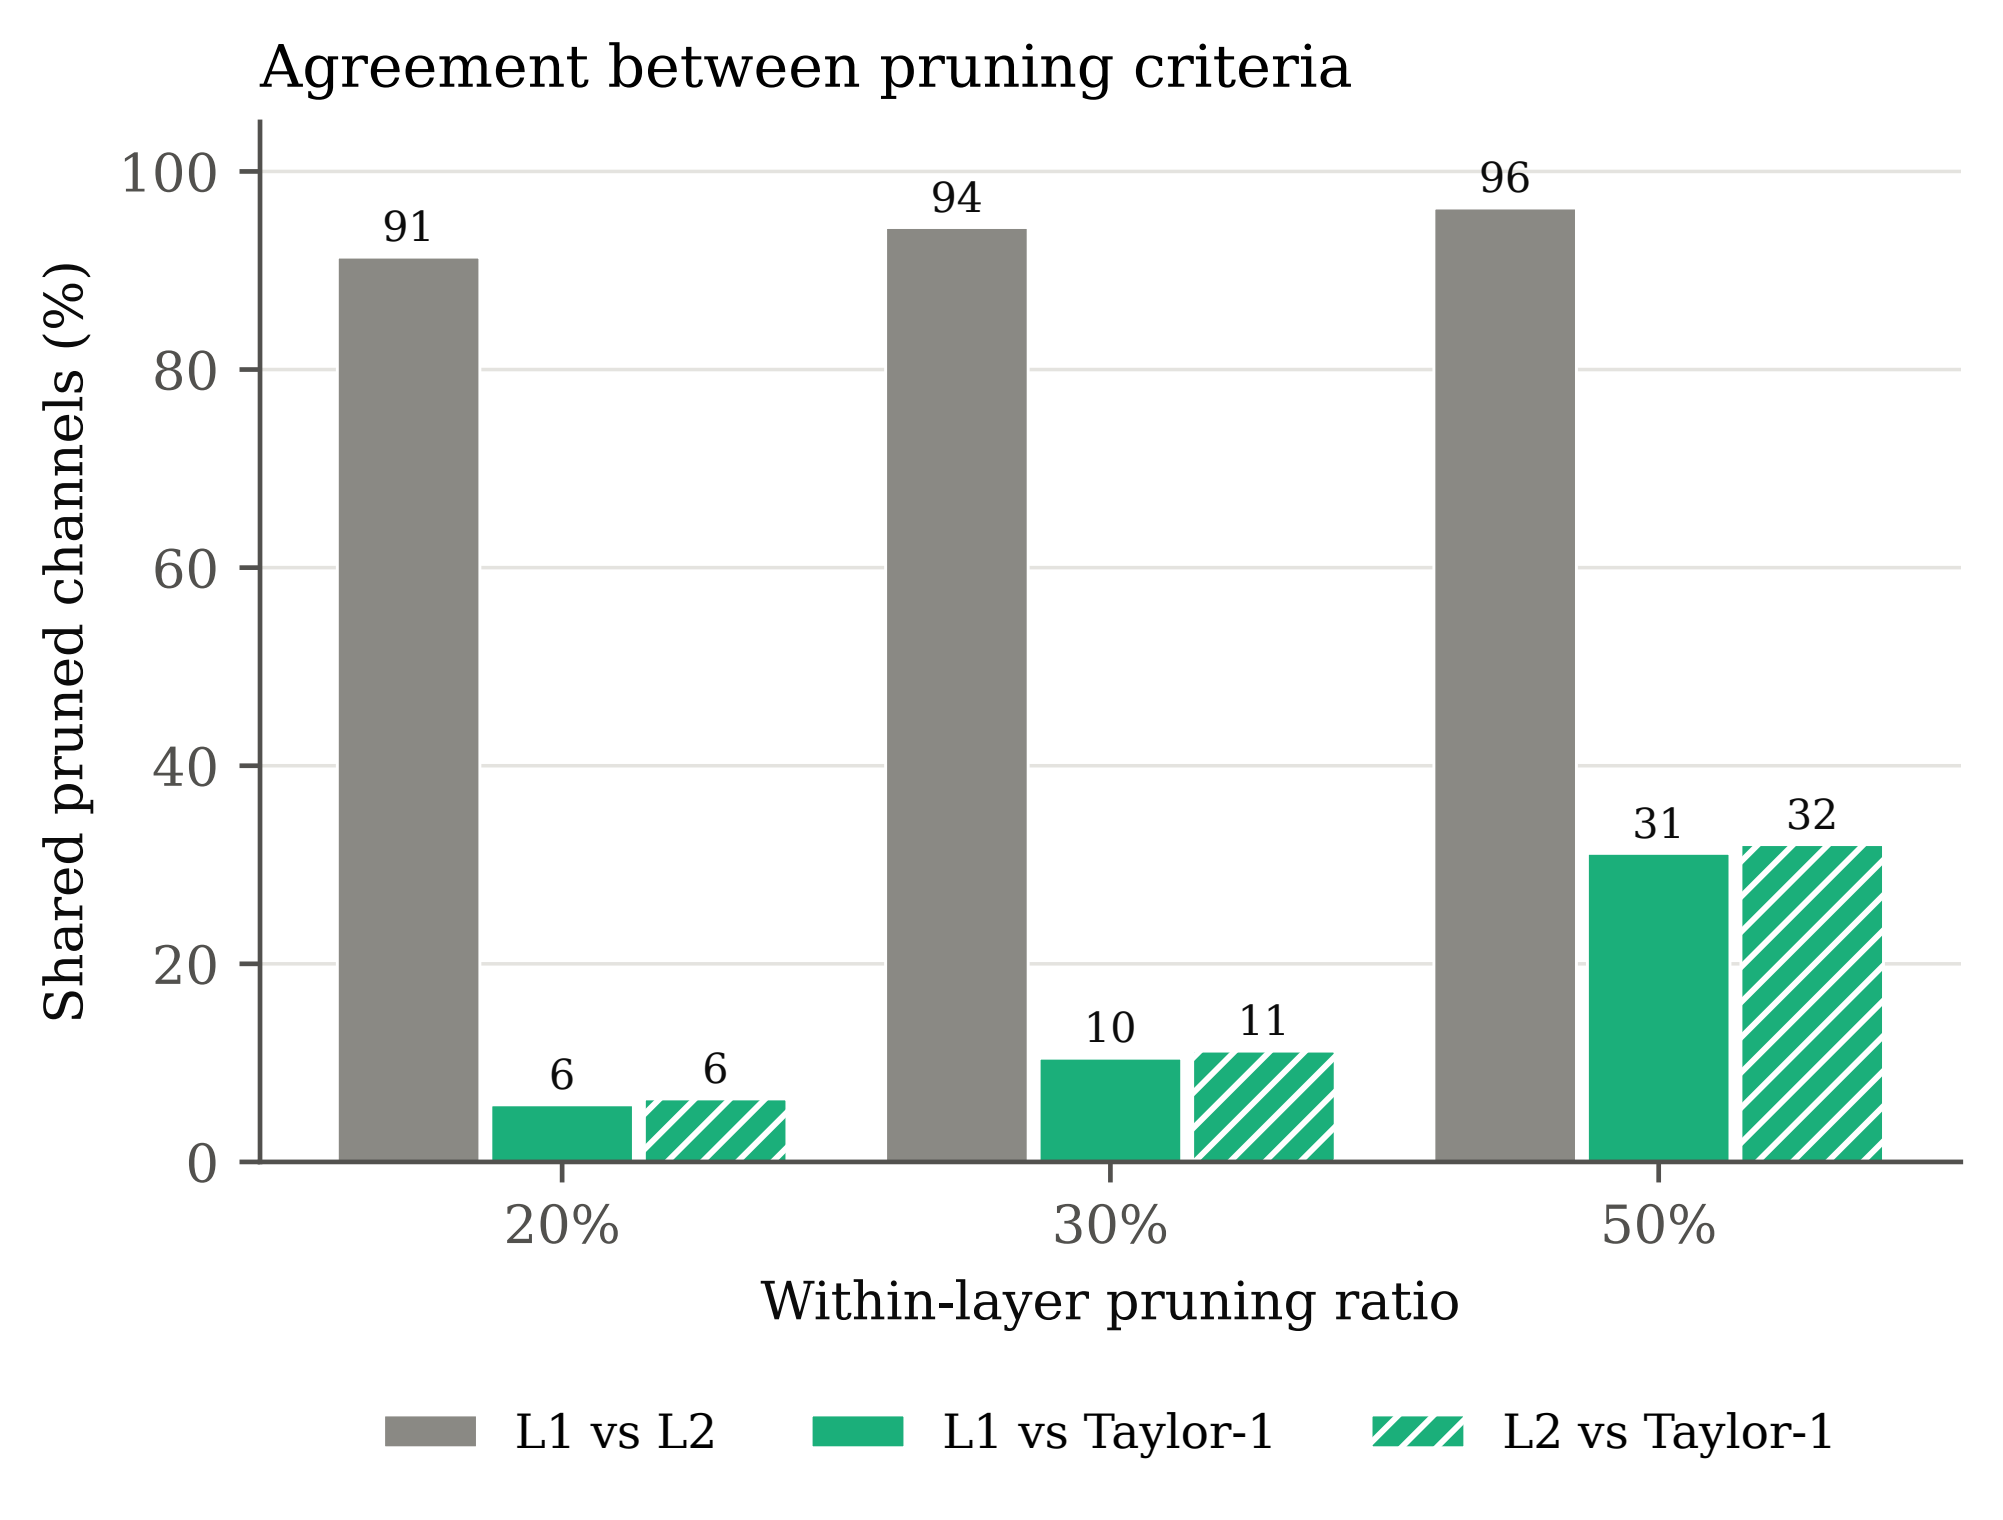
Agreement between pruning criteria
Shared pruned channels (%)
100
80
60
40
20
0
91
6
6
94
10
11
96
31
32
20%
30%
50%
Within-layer pruning ratio
L1 vs L2
L1 vs Taylor-1
L2 vs Taylor-1