




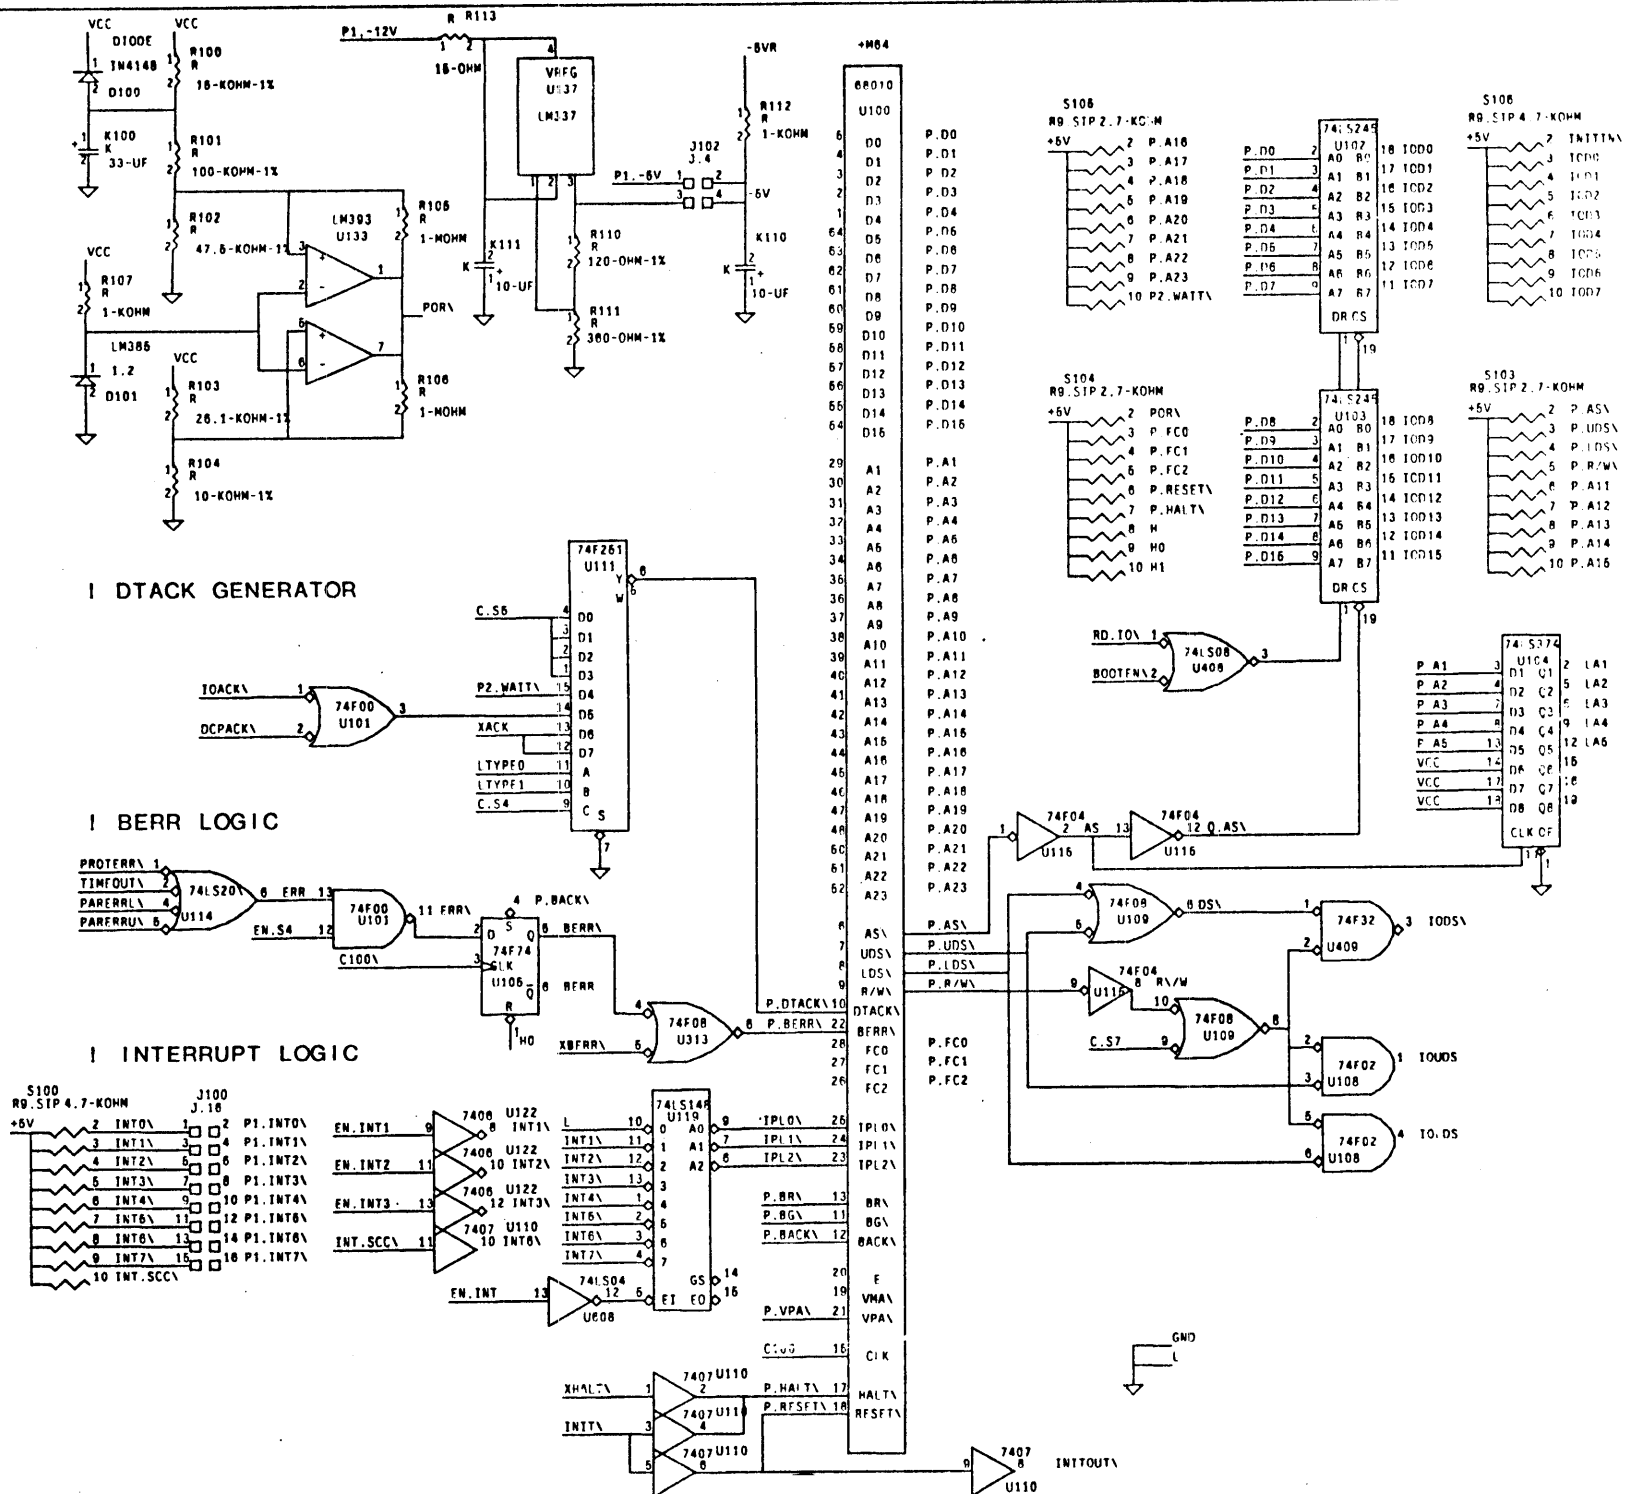



1 TIMEOUT COUNTER 1 TIMER CONTROLLER

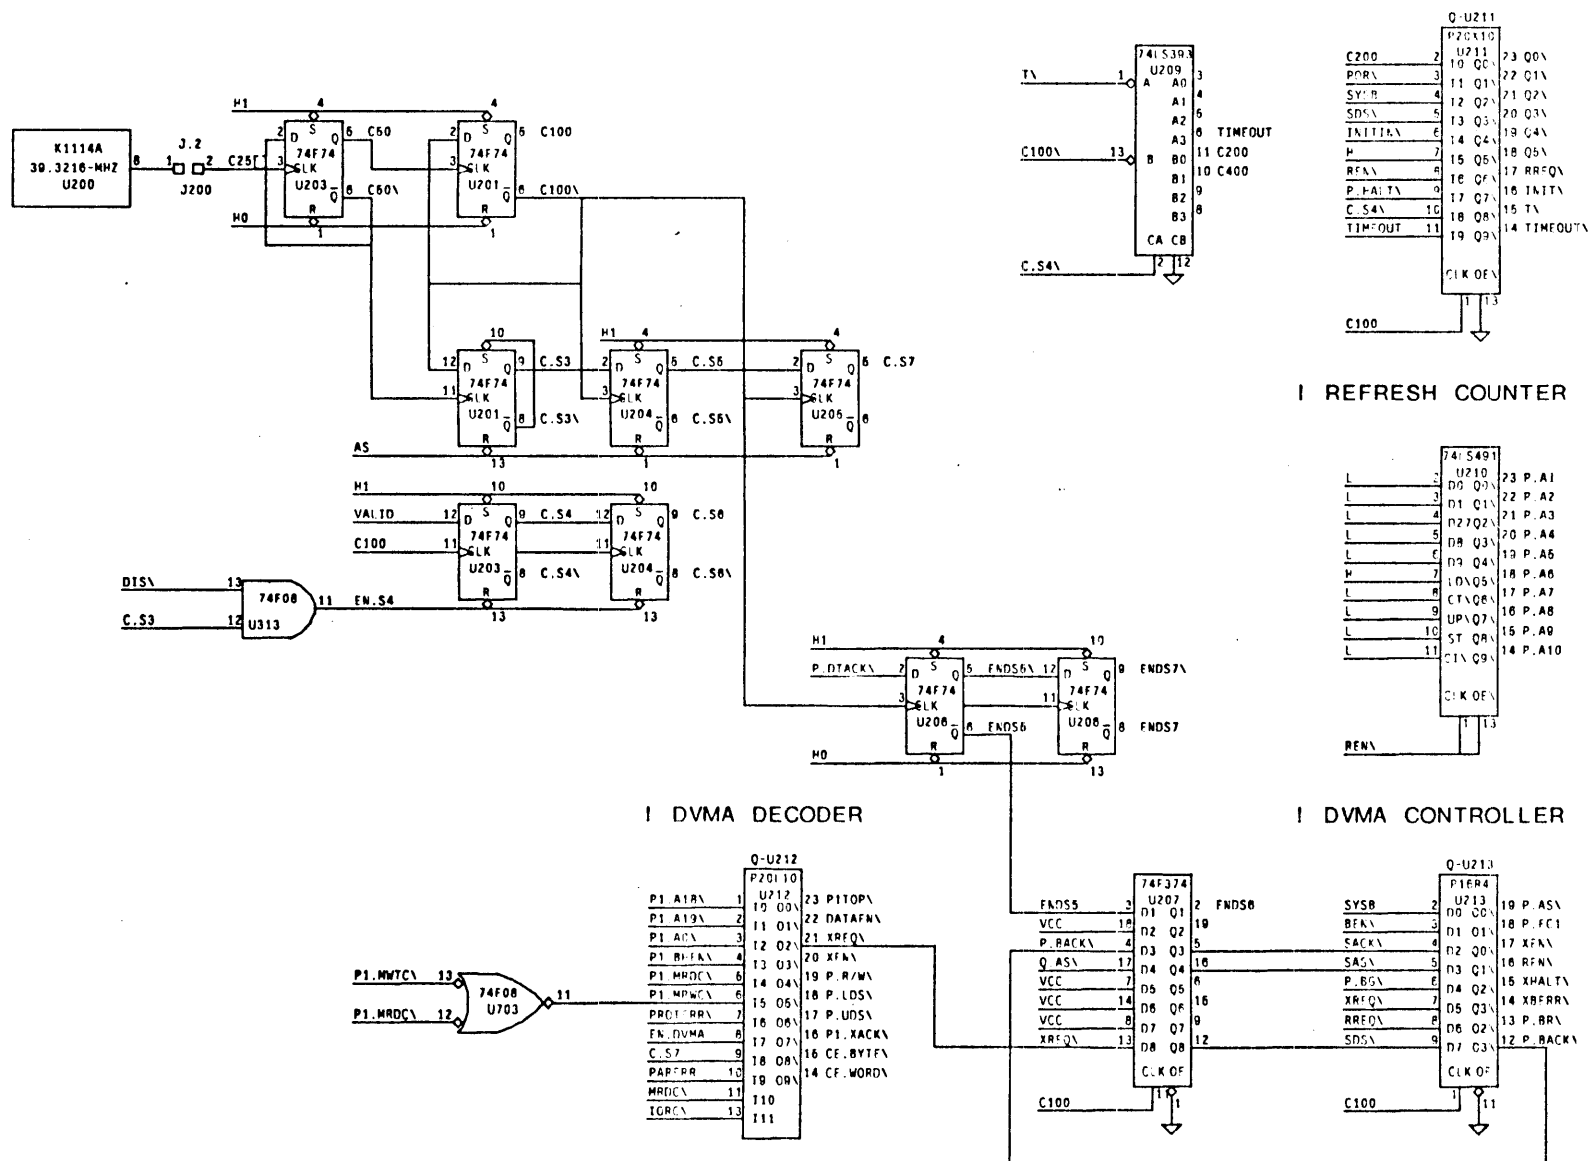


I CONTEXT REGISTER

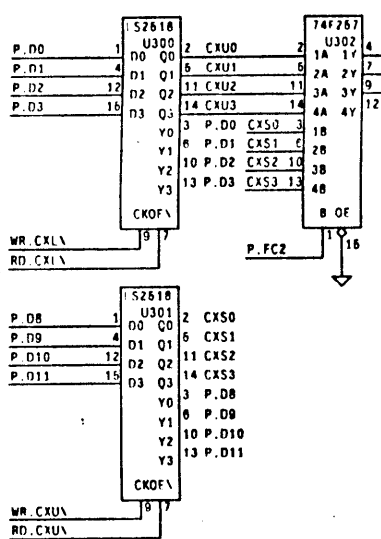



1 REAL-TIME CLOCK

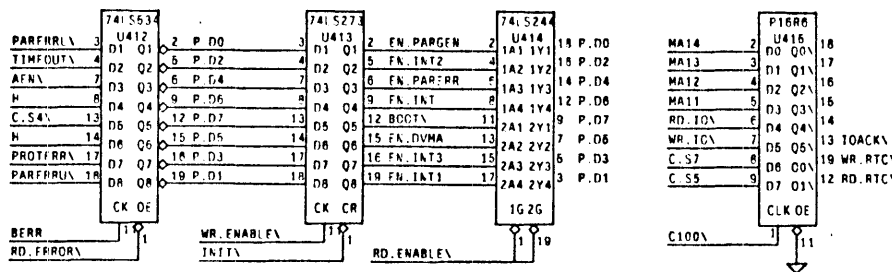

1 P2-BUS INTERFACE

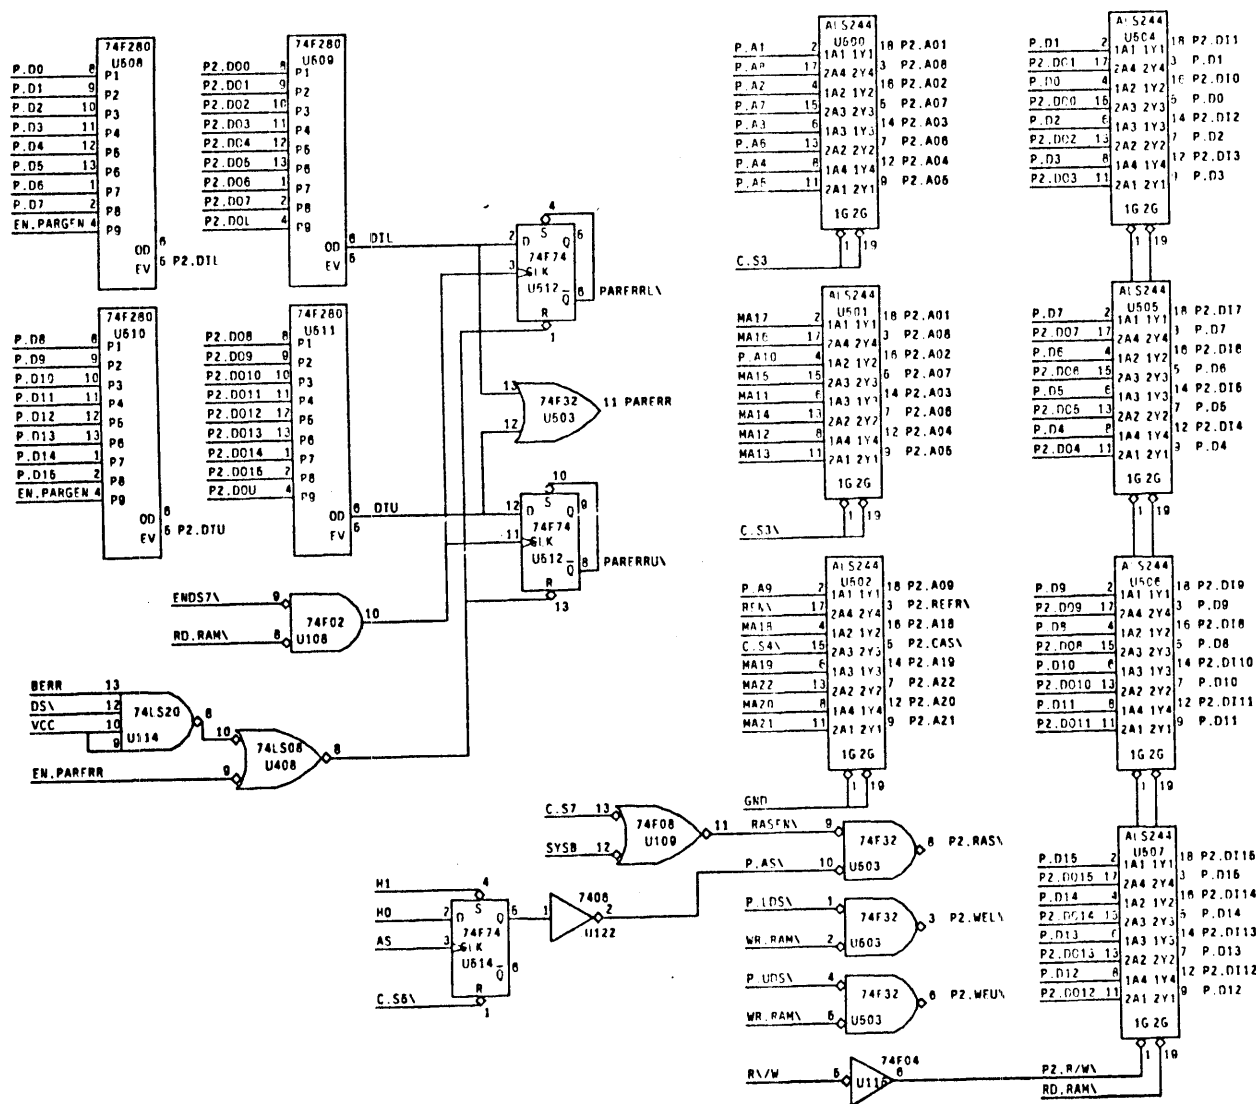


1 RS423 DRIVERS

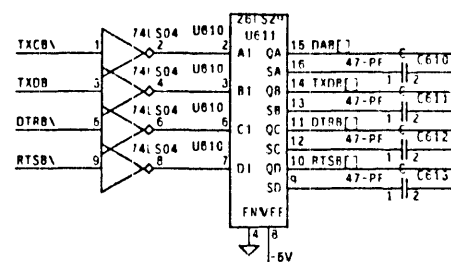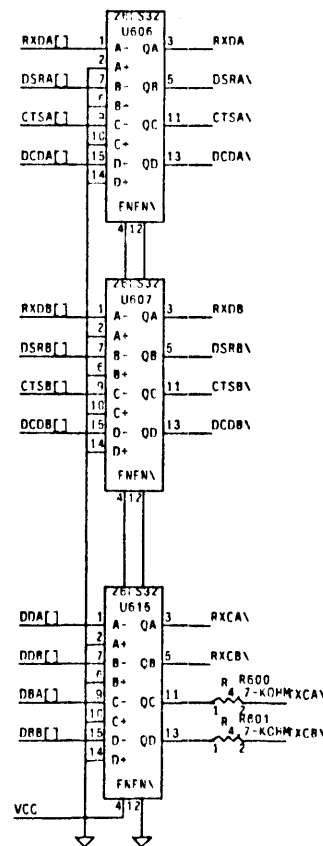


I ADDRESS OUT


I ADDRESS IN

I DATA BUFFERS




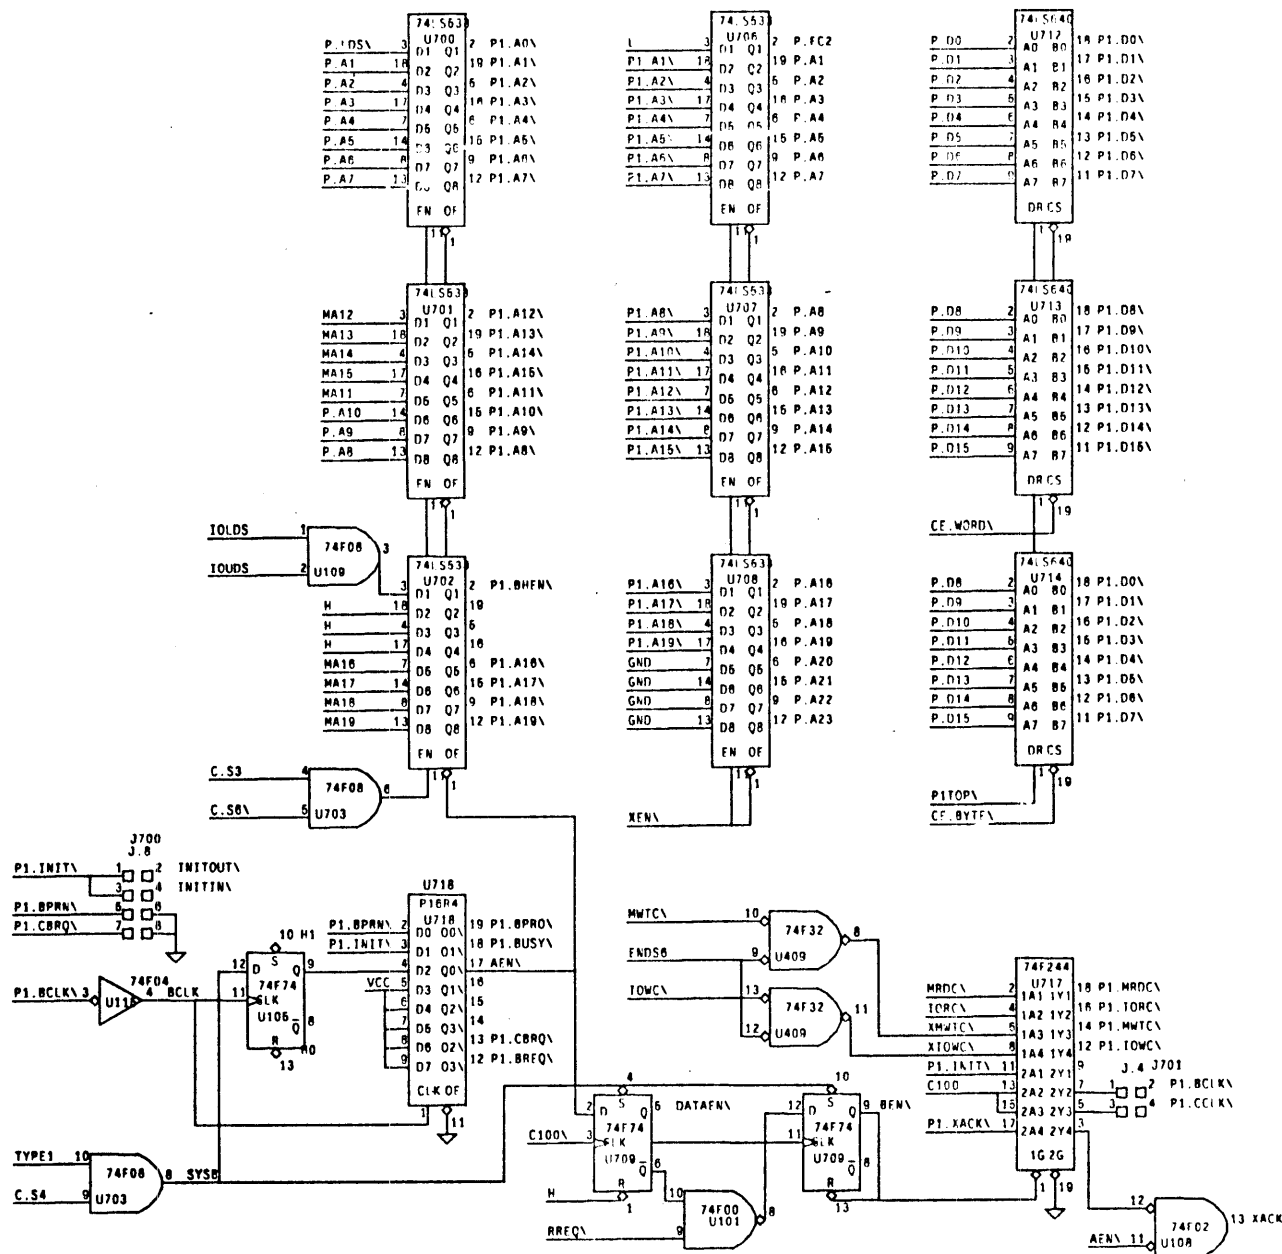


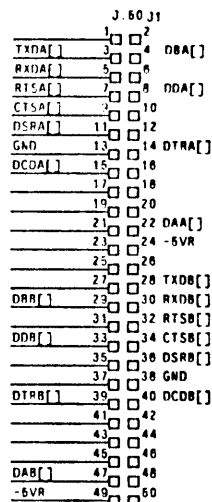



I DIAGNOSTIC REGISTER

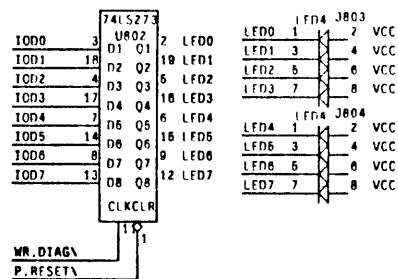

I INPUT PORT

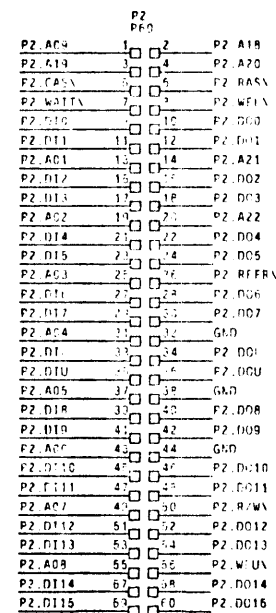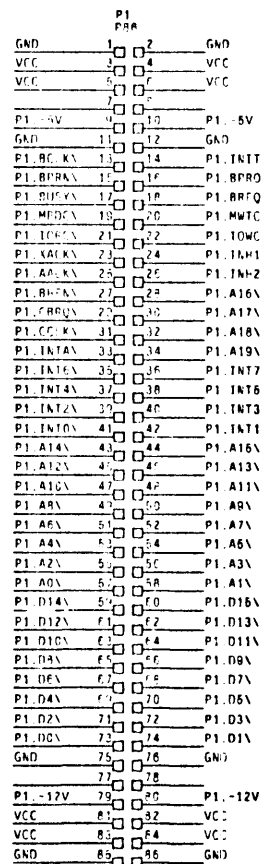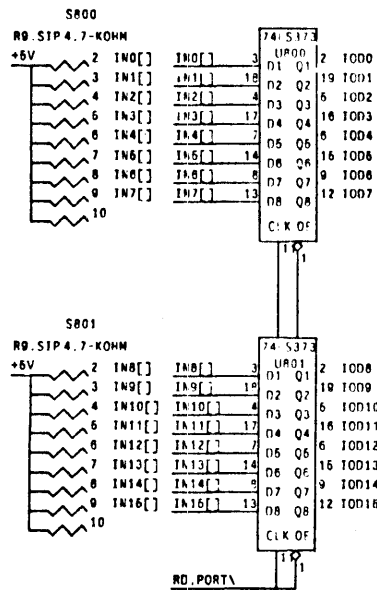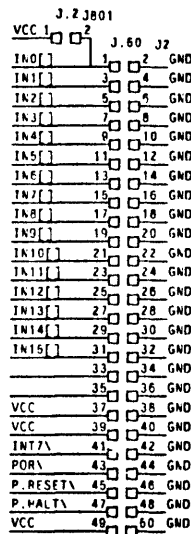

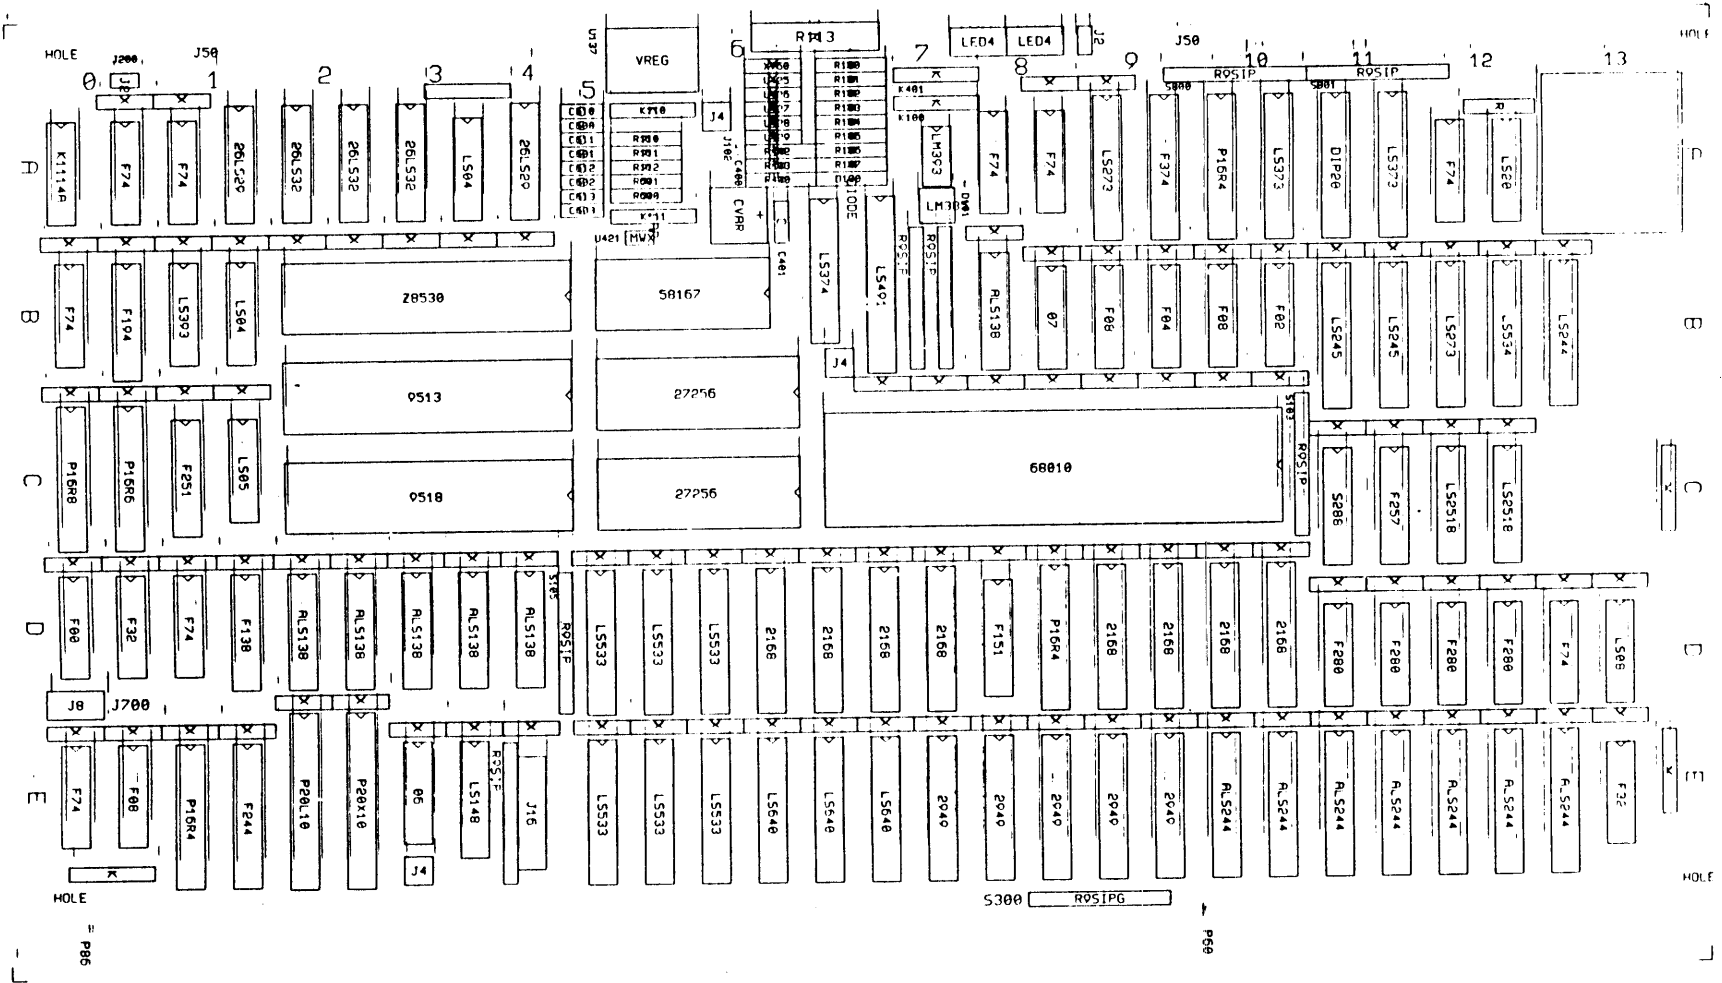

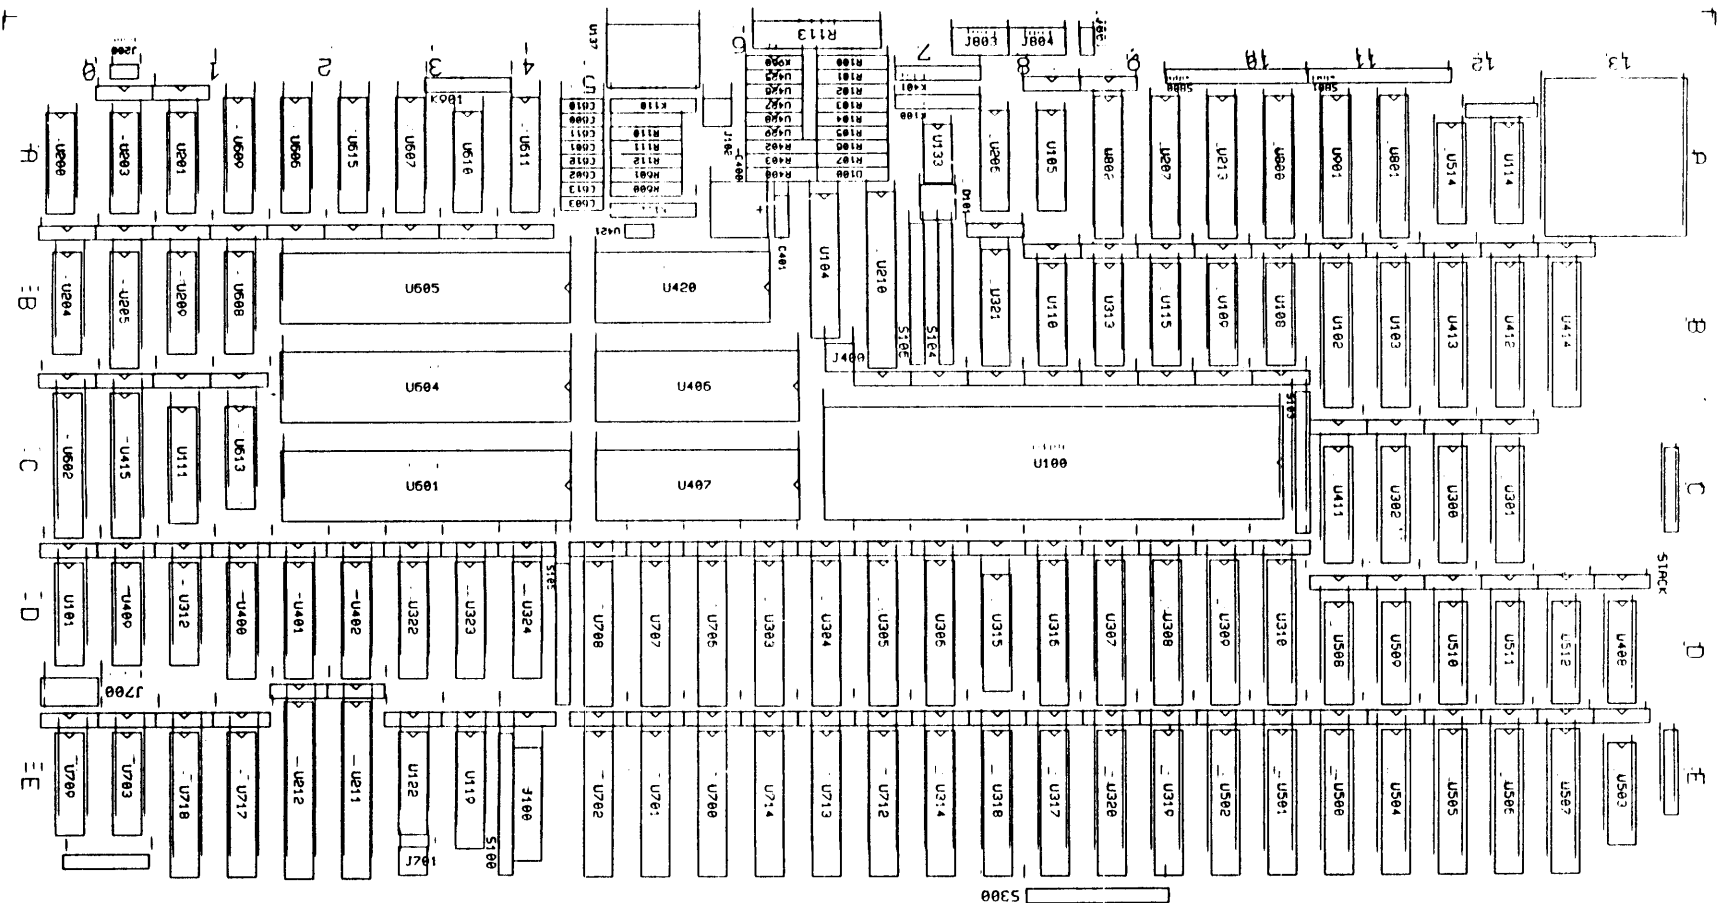

5300