


B2 - BACnet / Modbus (Advanced)

BACnet - Workshop I

PR


B2 - BACnet - Workshop I – Network - PR

Team A
YABE



Addr = ____
InstNr = ____

Team B
YABE



Addr = ____
InstNr = ____

First define the network addresses within your group

Group 1: BACnet Addresses 10..19, Instance IDs 110..119

Group 2: BACnet Addresses 20..29, Instance IDs 120..129

Group 3: BACnet Addresses 30..39, Instance IDs 130..139

Group 4: BACnet Addresses 40..49, Instance IDs 140..149

Baudrate 19'200

Max Master 127



BKN

Addr = ____
InstNr = ____



PRCA-BAC

Addr = ____
InstNr = ____



22DTH-16M

Addr = ____
InstNr = ____



EP015R6+BAC-HHM

Addr = ____
InstNr = ____



EP015R2+BAC

Addr = ____
InstNr = ____



P-22RTM-1U00D-2

Addr = ____
InstNr = ____

— Serial network (RS485)

B2 - BACnet - Workshop I – PR


1. Configure all the devices according to network overview.

💡 Find your appropriate configuration tool in the documents (LINK.10, Belimo Assistant 2, etc.)

2. Start YABE. Click on **Add device** and **Add yourself with BACnet/MSTP**.

💡 Check on which COM port your RS485-USB adapter is

💡 Pay attention to the BACnet settings on your actuator you just made

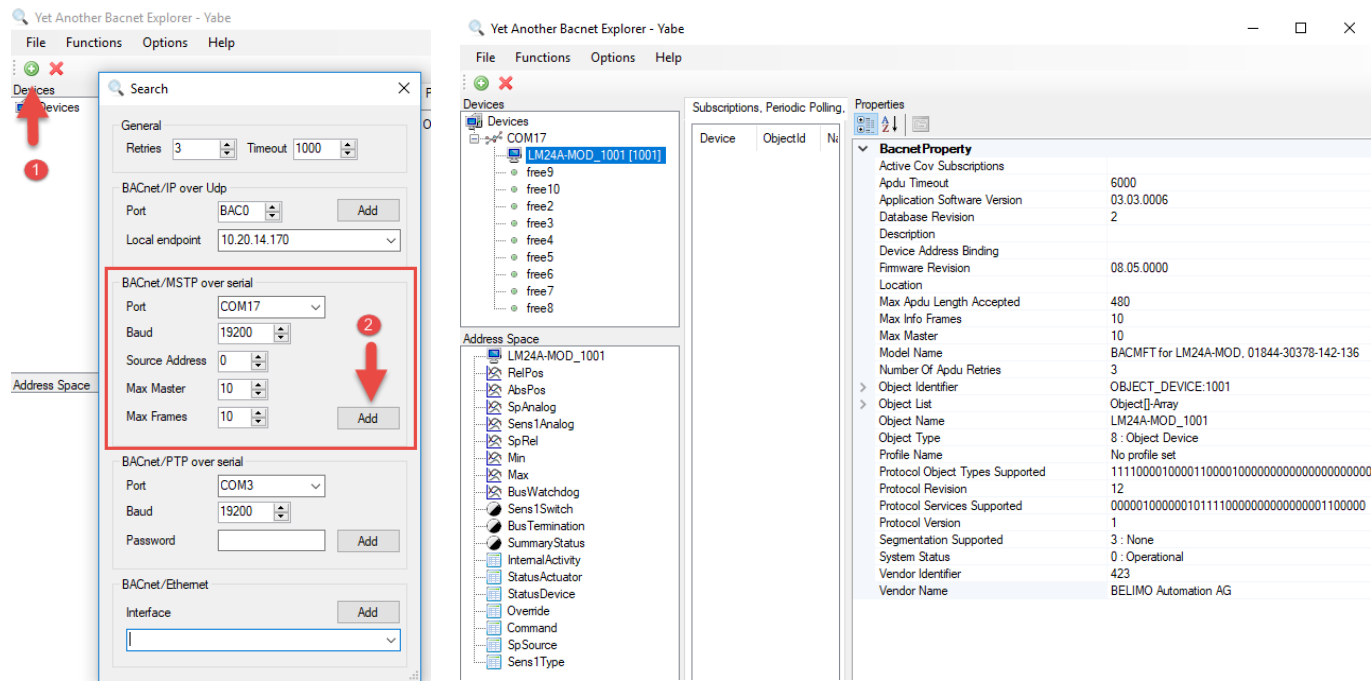

B2 - BACnet - Workshop I – PR

- 3. Select the PR under *Devices*.**
- 4. Read out all the BACnet objects of the device.**
- 5. Set the setpoint to 100%. Observe the position.**
- 6. Set Max to 70%. Observe the position.**
- 7. Set Max back to 100%.**