


B2 – BACnet / Modbus (Advanced)

Modbus - Workshop III

TCP

B2 – Modbus - Workshop III – TCP - Network

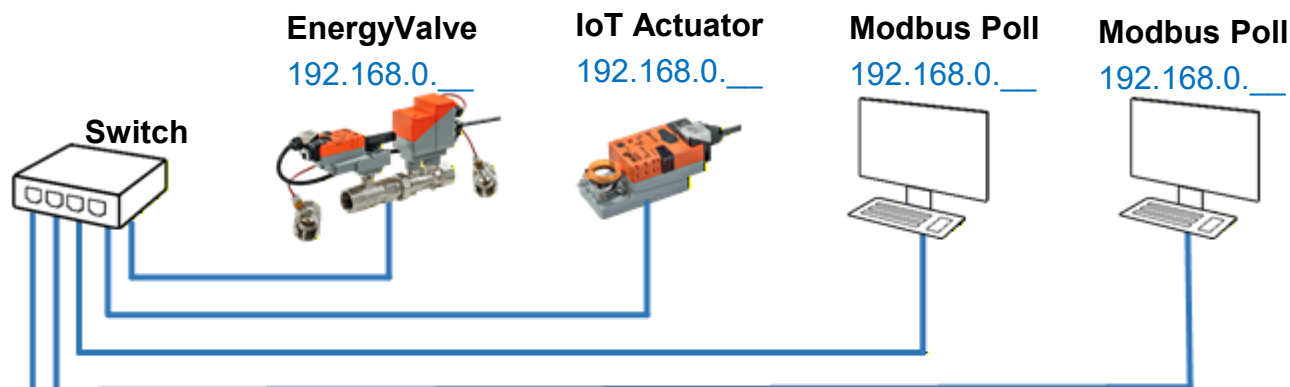

Baudrate 38'400
Format 1-8-N-2



BKN

Addr = ____

PRCA-BAC

Addr = ____

22DTH-15M

Addr = ____

6wEPIV4

Addr = ____

2wEPIV4

Addr = ____

P-22RTM-1U00D-2

Addr = ____

First define the network addresses within your group

Group 1: Modbus Addresses 10..19

Group 2: Modbus Addresses 20..29

Group 3: Modbus Addresses 30..39

Group 4: Modbus Addresses 40..49

Group 1: IP Adresses 192.168.0.10..19

Group 2: IP Adresses 192.168.0.20..29

Group 3: IP Adresses 192.168.0.30..39

Group 4: IP Adresses 192.168.0.40..49

— Serial network (RS485)


— IP Subnet 192.168.0.1 – 192.168.0.254

B2 - Modbus – Workshop III - TCP

- 1. Start Modbus Poll.**
 - 2. Read out the Energy Valve on the TCP network.**
 - 3. Can you read out a second device?**
-

B2 - Modbus – Workshop III - TCP

4. Open a new Modbus Poll window and change function code to 16.

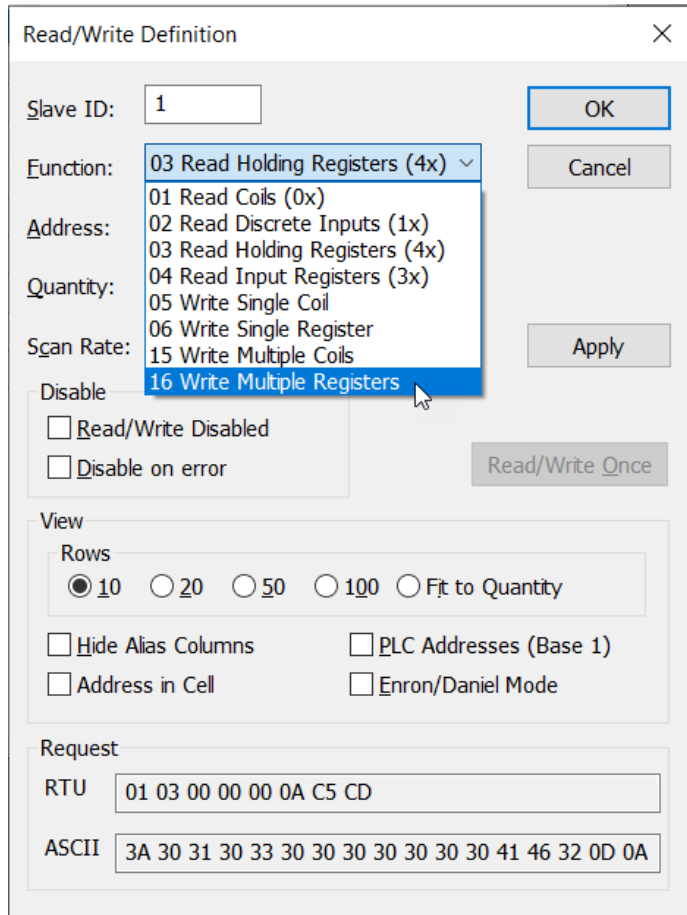

Read/Write Definition

Slave ID: 1

Function: 03 Read Holding Registers (4x) ▾

Address: 02 Read Discrete Inputs (1x)

Quantity: 04 Read Input Registers (3x)

Scan Rate: 15 Write Multiple Coils

Disable

☐ Read/Write Disabled

☐ Disable on error

Read/Write Once

Apply

Cancel

OK

View

Rows

☒ 10 ☐ 20 ☐ 50 ☐ 100 ☐ Fit to Quantity

☐ Hide Alias Columns ☐ PLC Addresses (Base 1)

☐ Address in Cell ☐ Enron/Daniel Mode

Request

RTU 01 03 00 00 00 0A C5 CD

ASCII 3A 30 31 30 33 30 30 30 30 30 30 41 46 32 0D 0A

B2 - Modbus – Workshop III - TCP

5. Write register No. 167/168.



See example in the Modbus Register Description on how to interpret 32-Bit values.

6. Read out an IoT actuator.