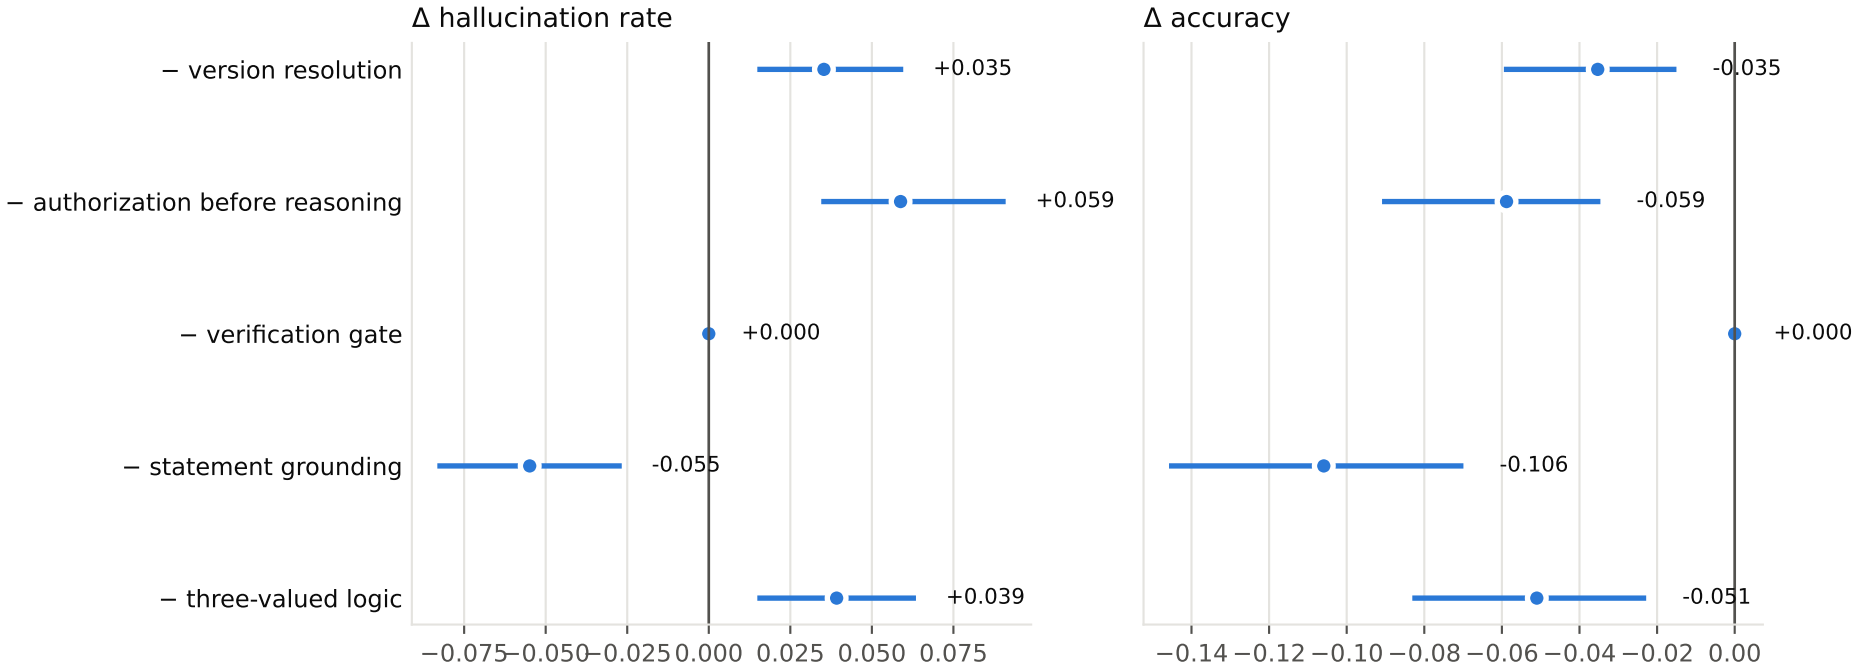

Each component removed from Praxis (offline encoder) · ablations-test; paired 95% bootstrap intervals on the difference.