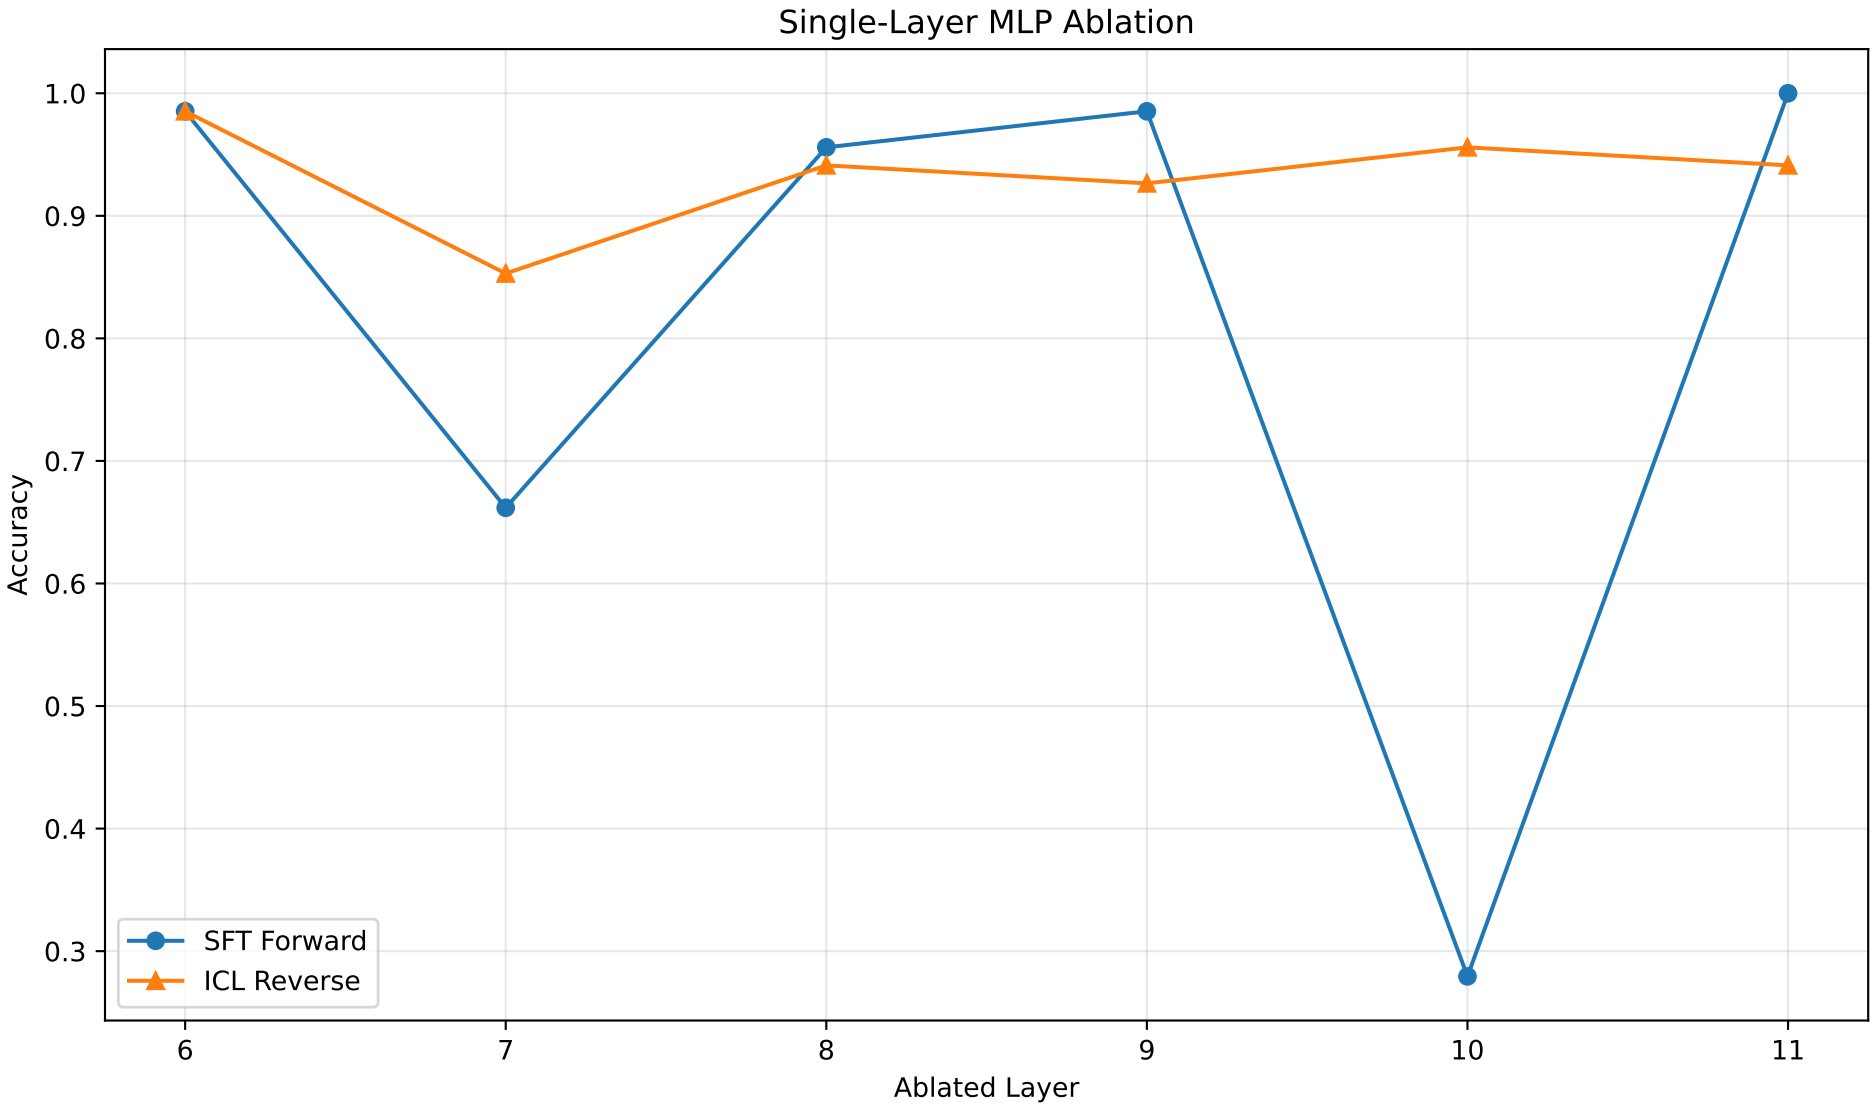
Single-Layer MLP Ablation
Accuracy
1.0
0.9
0.8
0.7
0.6
0.5
0.4
0.3
6
7
8
9
10
11
Ablated Layer
SFT Forward
ICL Reverse