


```
.param tdv=1 tdt=1 fn1=50 omega_n={2*pi*fn1}
.options vntol=1m abstol=1u reltol=0.003
.tran 0 4 0 0.1ms
```

For the overhead line configuration see ATPDraw File:
Ltspice_400kV_Donaumast.acp with geometry of line


For converting ATP to LTspice subcircuit in .libfile see file
ATP_cables_and_lines.xlsx

Line 1 is closed
Line 2 is closed then opened
Voltagesource is switched on exponentially

Net Impedance
SK=40GVA

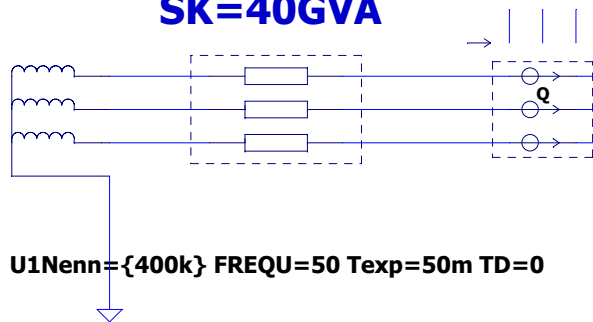

.param len=10

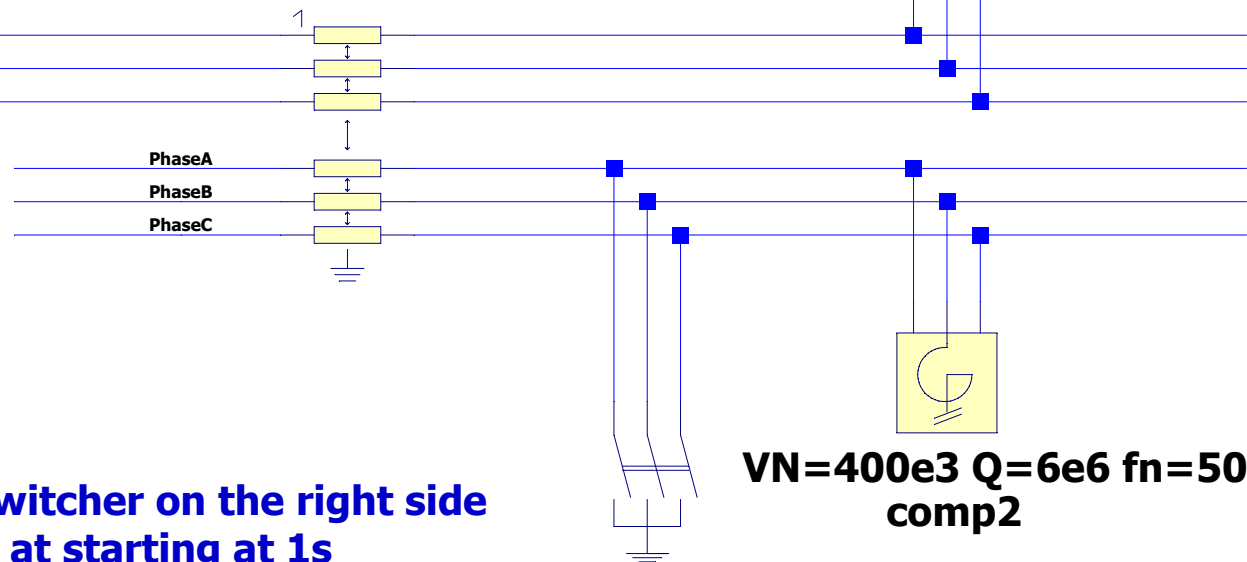

Energy of line2 = 2.5kJ

ALT/(ALT Gr)+Click on switcher on the right side
to get active power peak at starting at 1s

Set x-axis to 1s-2s.

Then ctrl+click on named trace expression above plot
to get the energy