IE/IE0 vs I1/IN regulation curve for pure inductive load
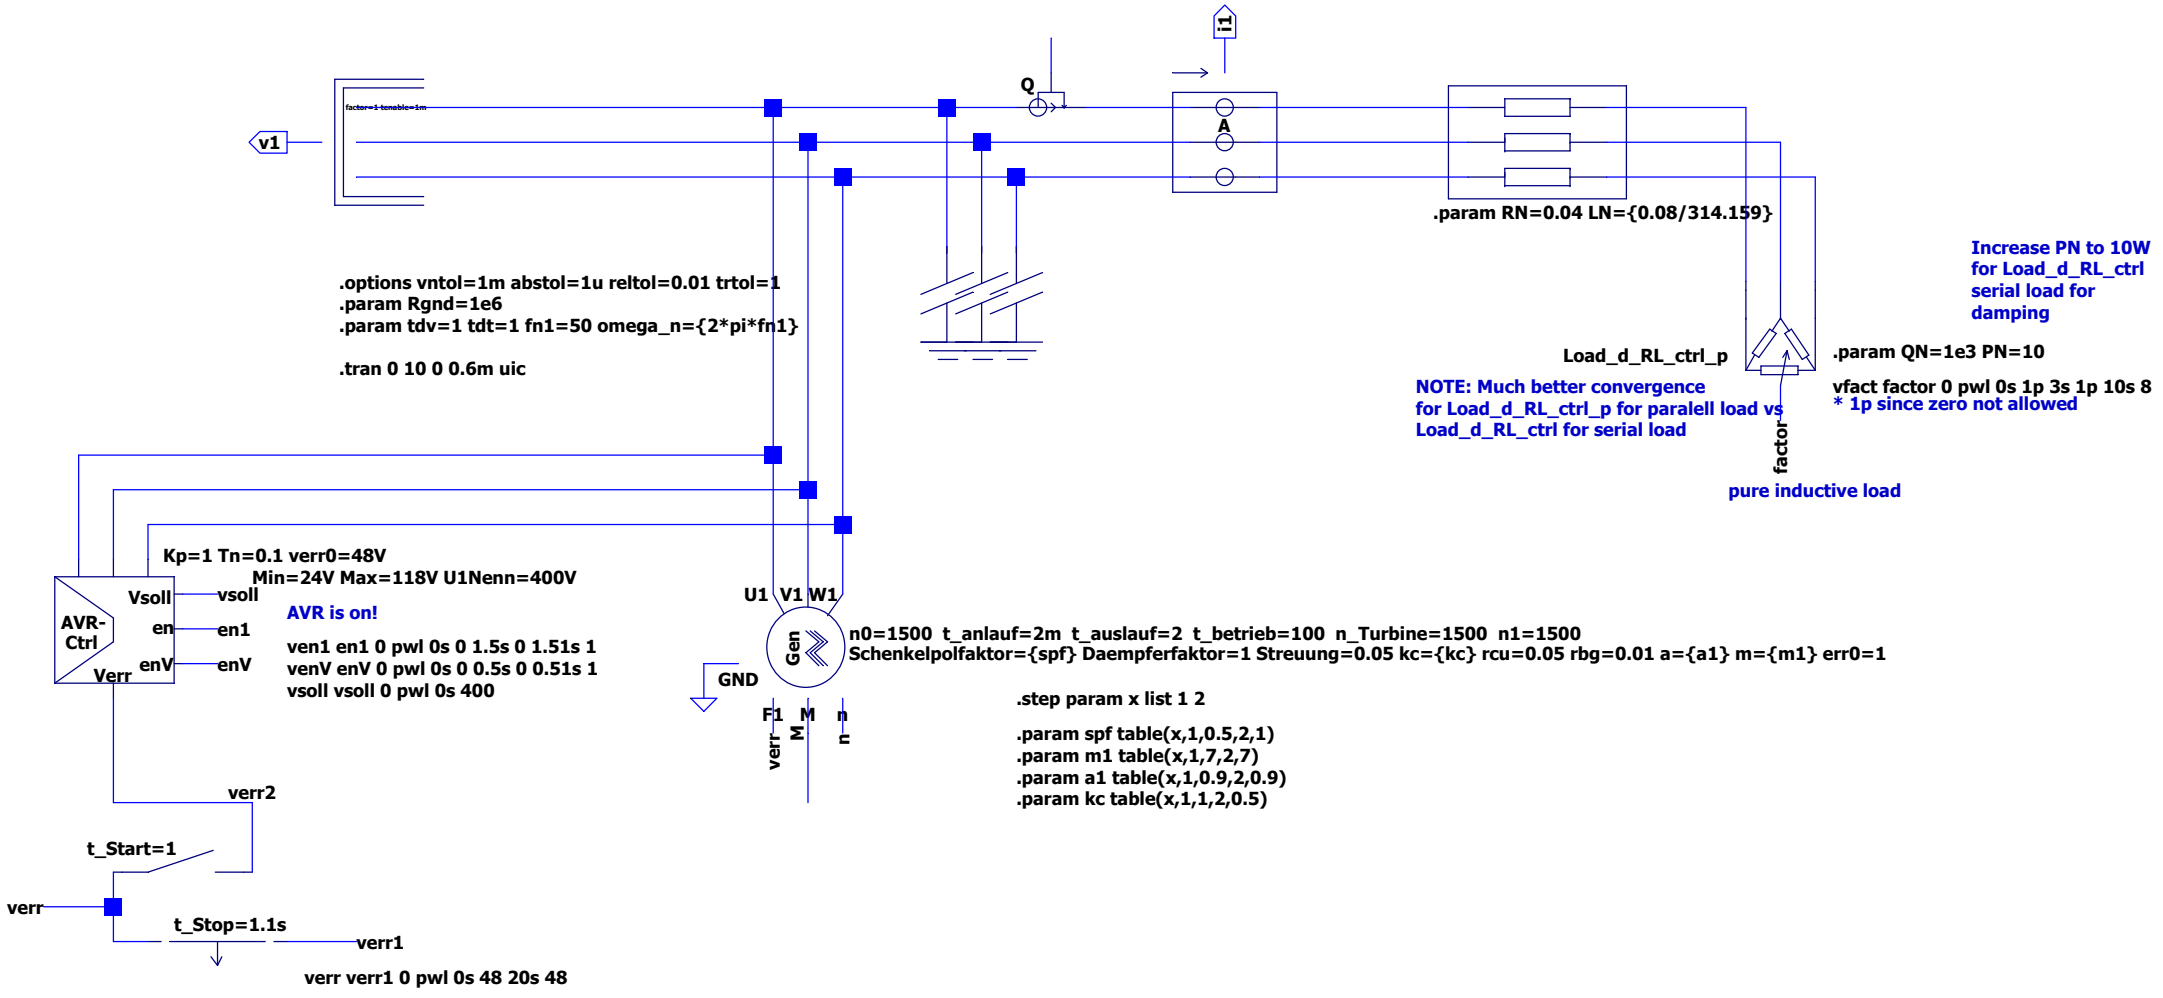
Generator voltage at terminals held constant
Magnetic field voltage regulated
Pure inductive load from 0 to 8kW (at 400V) starting with T=3s
RUN1: Schenkelpolfaktor=0.5 (salient pole machine)
RUN2: Schenkelpolfaktor=1 (cylindrical pole (round) machine)