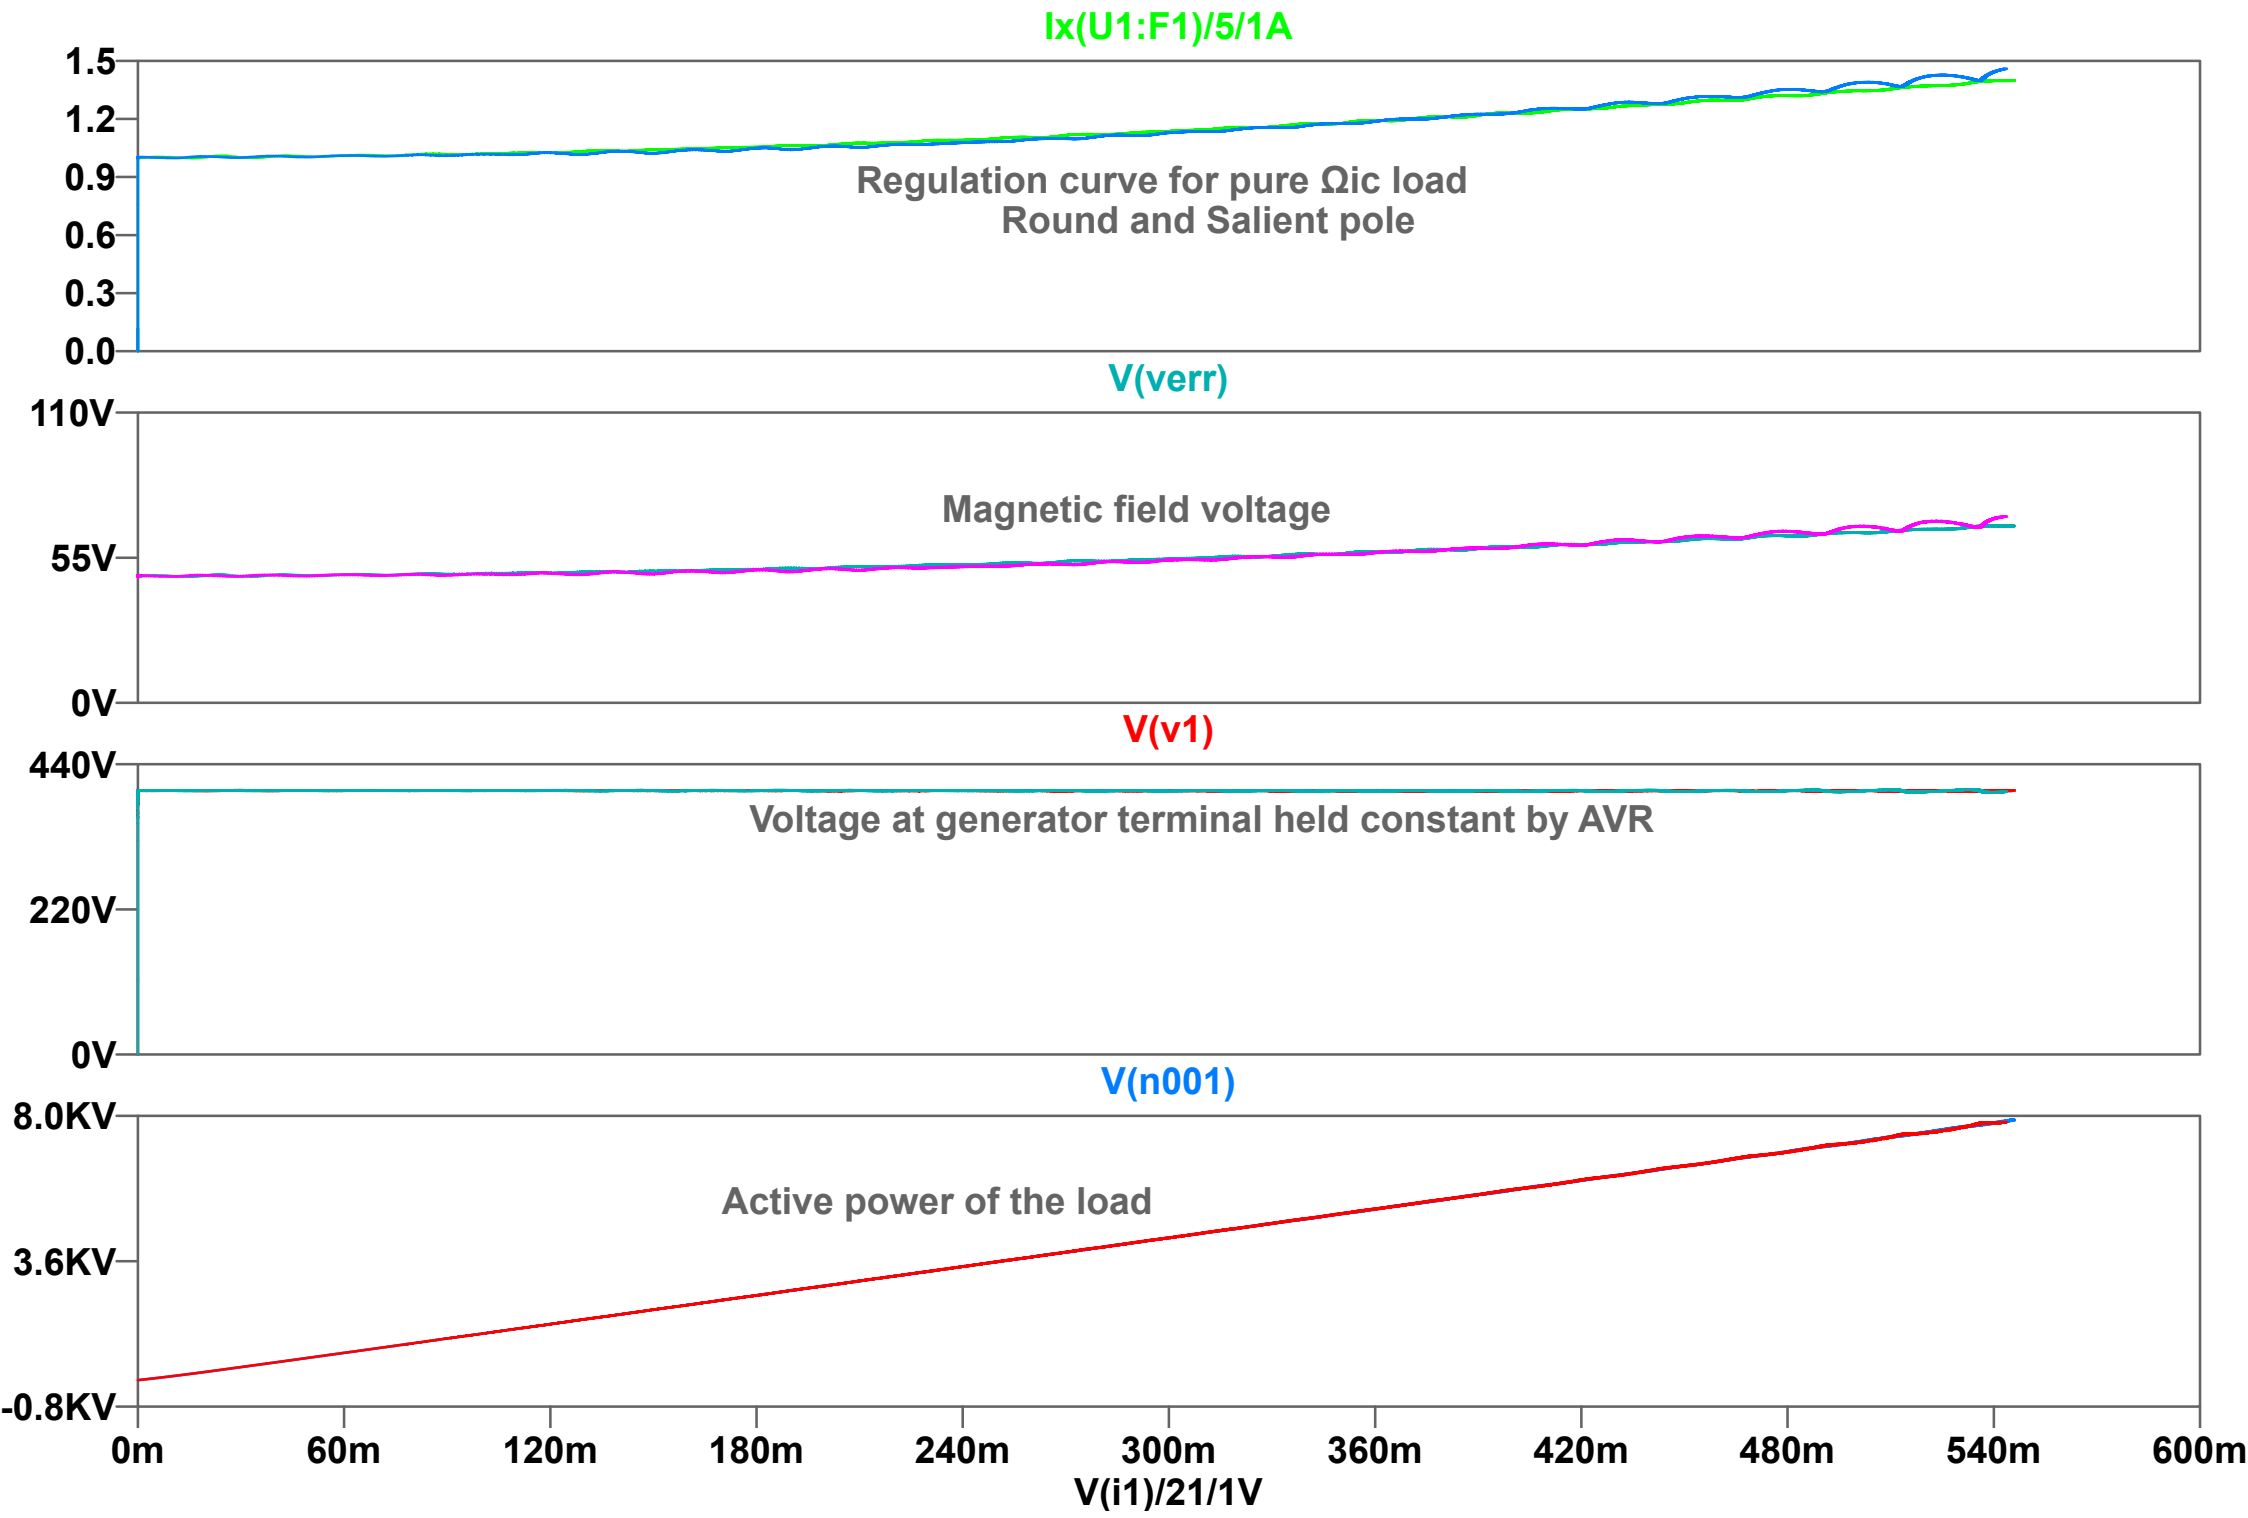

Ix(U1:F1)/5/1A
1.5
1.2
0.9
0.6
0.3
0.0
Regulation curve for pure Ωic load
Round and Salient pole
V(verr)
110V
55V
0V
Magnetic field voltage
V(v1)
440V
220V
0V
Voltage at generator terminal held constant by AVR
V(n001)
8.0KV
3.6KV
-0.8KV
Active power of the load
0m
60m
120m
180m
240m
300m
360m
420m
480m
540m
600m
V(i1)/21/1V