Middle voltage transformer with petersen 300A

(TRAN-Analysis for primary and secondary leakage flux)

```
.param last=20e6
.param last=20e-6
.param tdv=1 tdt=1 ce=5012n ce1=10n
fn1=50 .options vntol=1m abstol=1u

.tran 0 1s 0 0.1m
.ac lin 1000 40 52
```

Right Click on transformer for hierarchical subcircuit
Right Click on winding for deeper hierarchical subcircuit

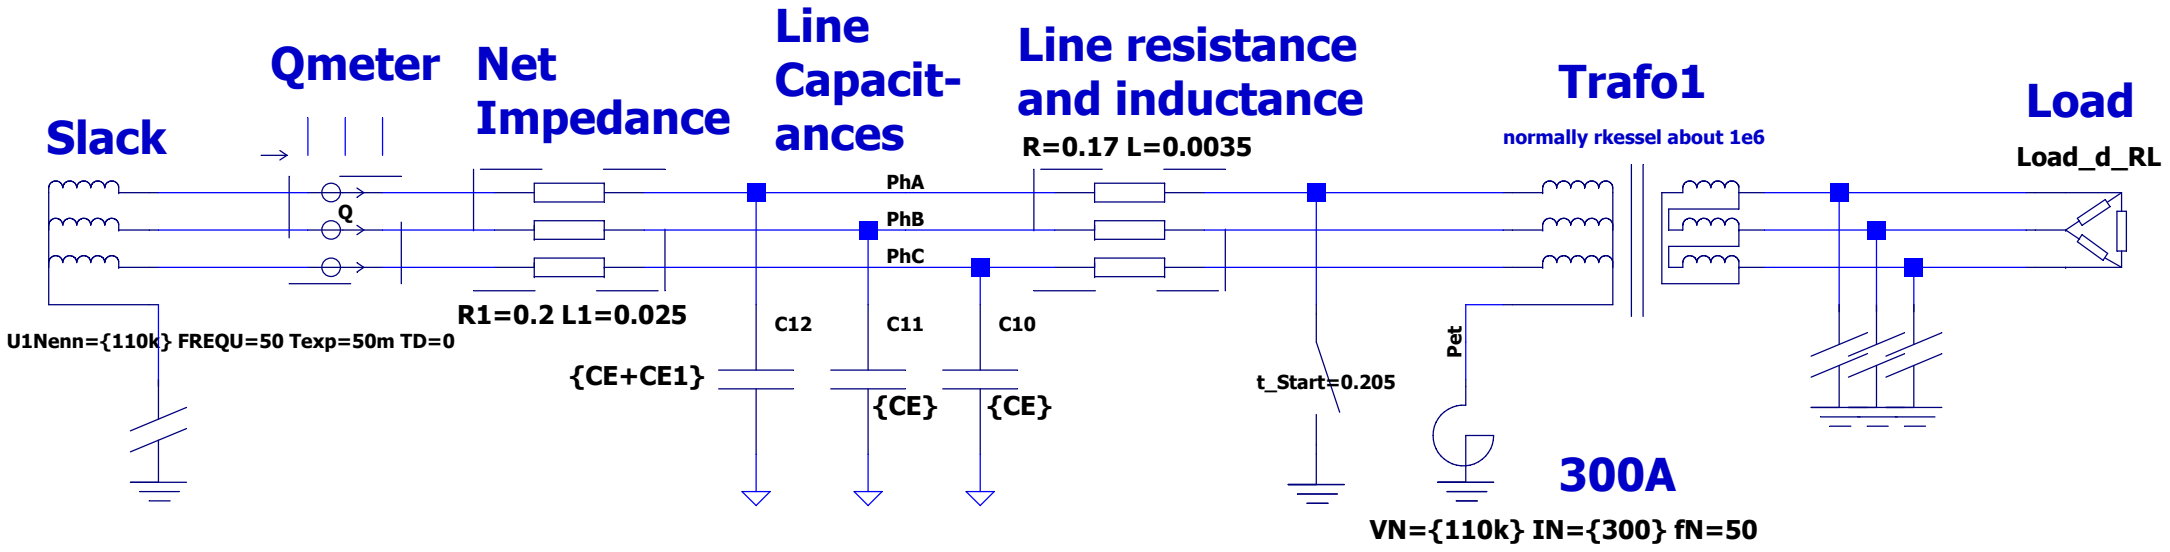

XC=1/omega/C = 1/314.159/5012e-9=635.1Ohm
I0=UN/1.73205/635.1Ohm=100A
IE=3*I0=300A (only for cables)