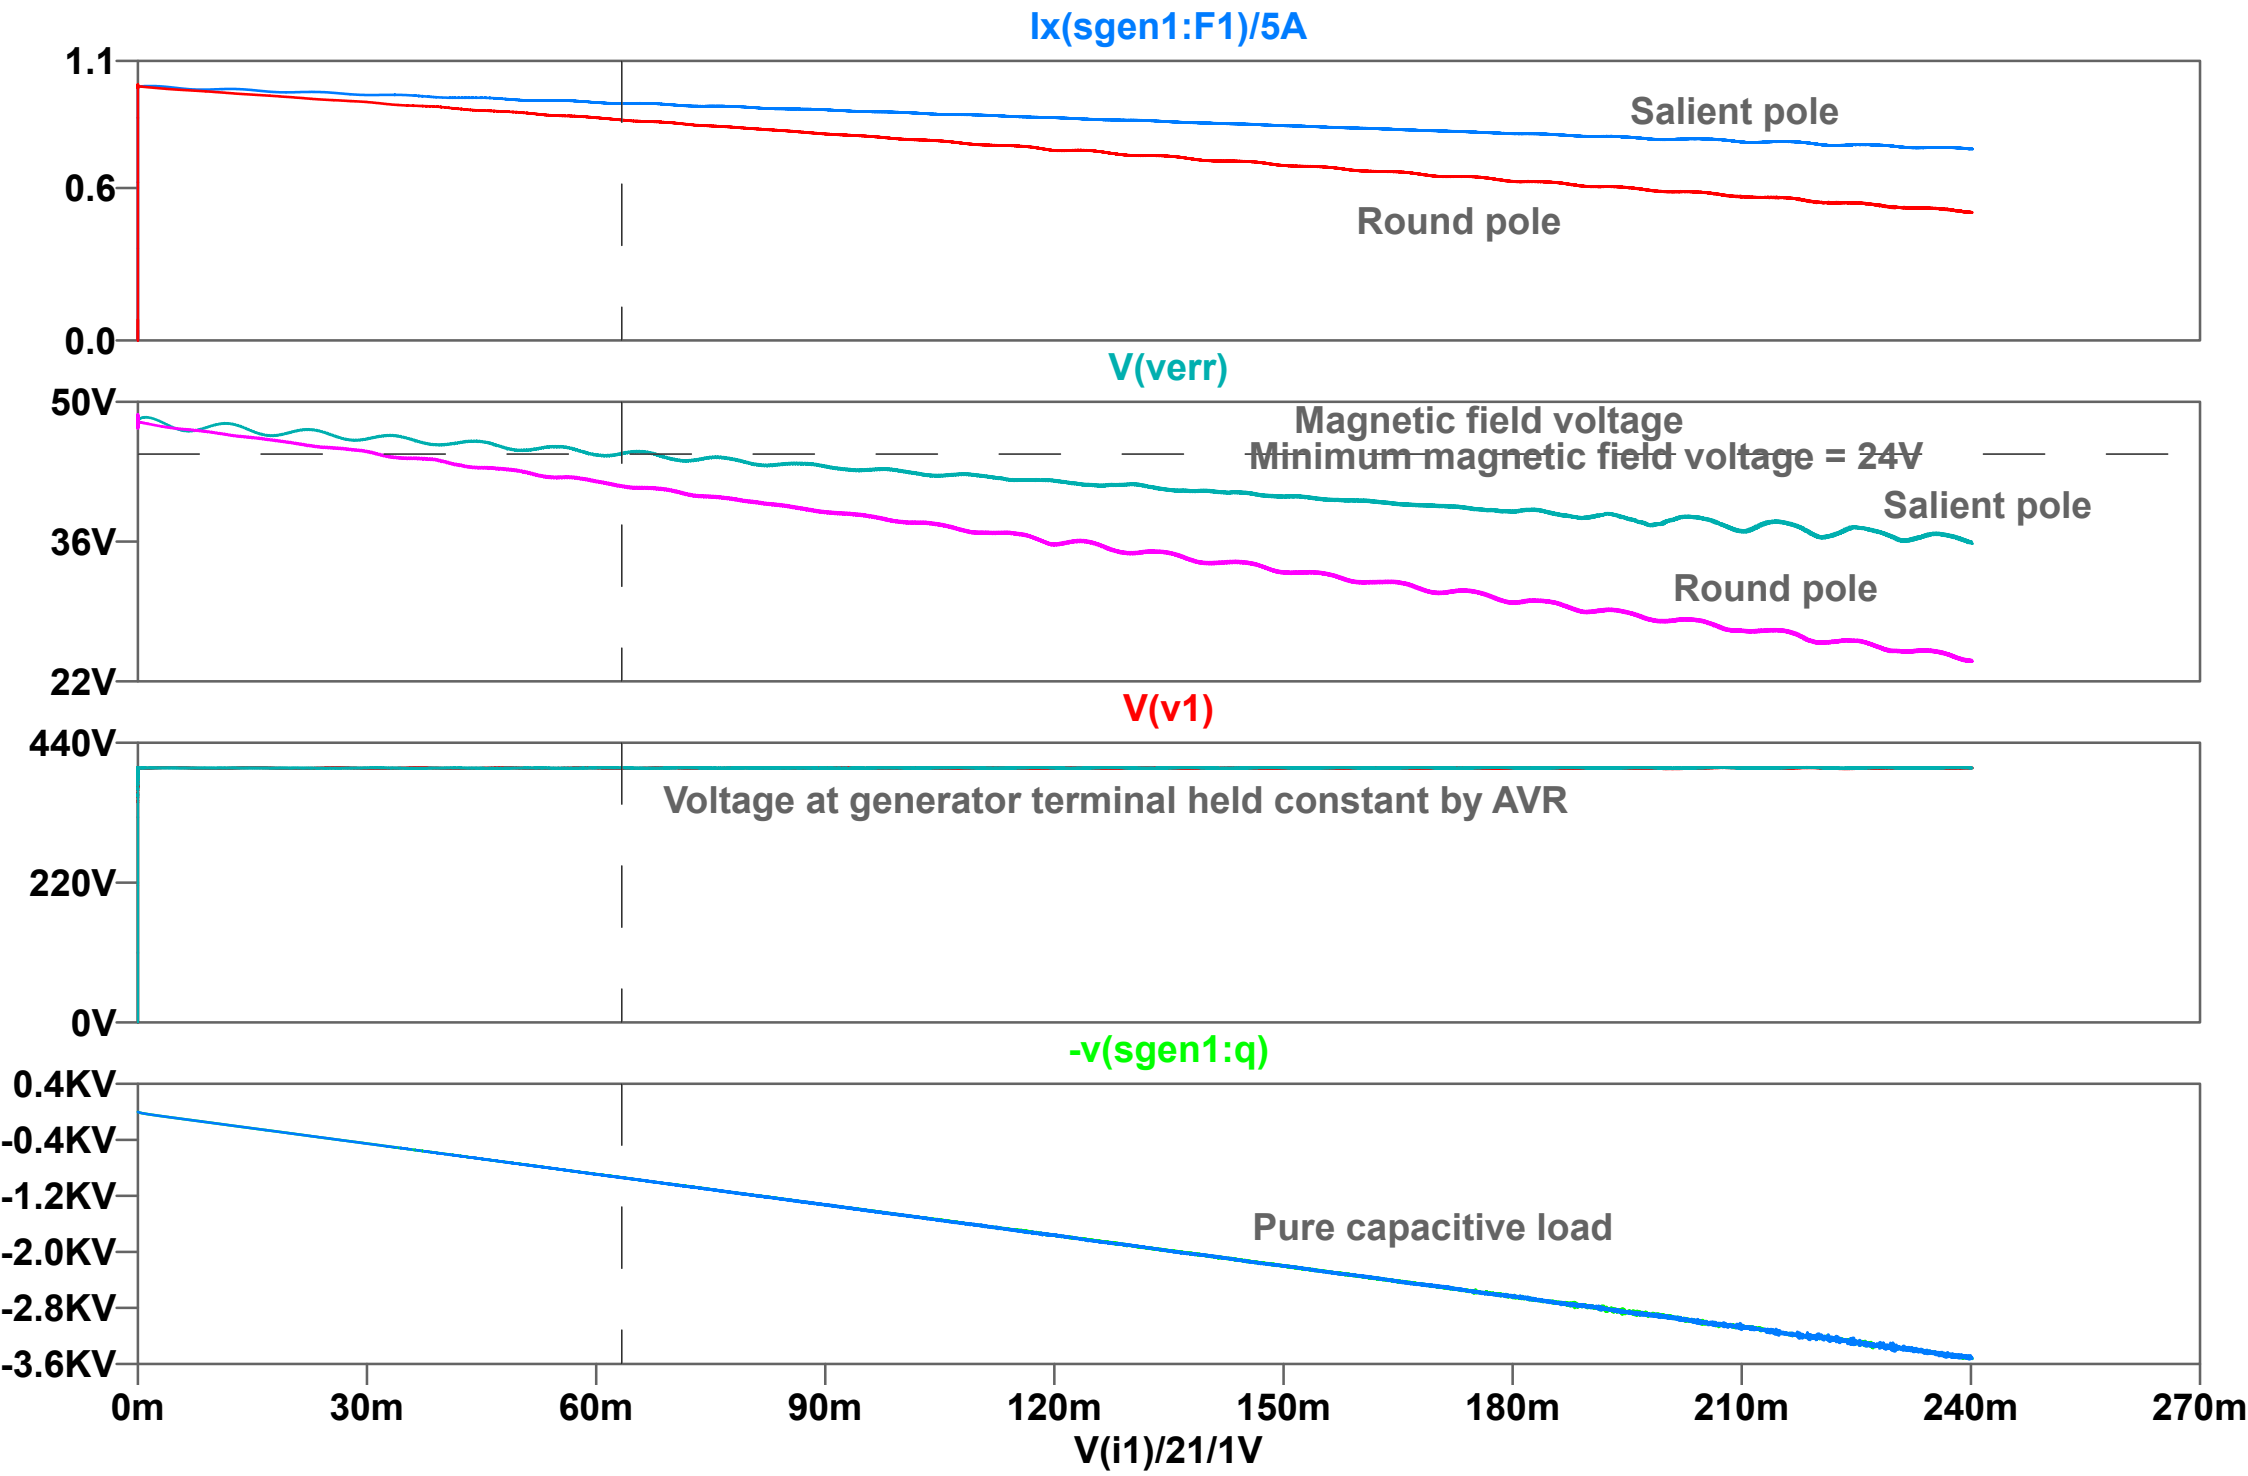

Ix(sgen1:F1)/5A
1.1
0.6
0.0
Salient pole
Round pole
V(verr)
50V
36V
22V
Magnetic field voltage
Minimum magnetic field voltage = 24V
Salient pole
Round pole
V(v1)
440V
220V
0V
Voltage at generator terminal held constant by AVR
-v(sgen1:q)
0.4KV
-0.4KV
-1.2KV
-2.0KV
-2.8KV
-3.6KV
Pure capacitive load
0m
30m
60m
90m
120m
150m
180m
210m
240m
270m
V(i1)/21/1V