




1									4
			Date	29/06/2020	-		PLC- POWER SUPPLY	=	
			Ed	Cristian				+	
			Appr		DOL starting without safety relay - pushbutton control				Page 3
Modification	Date	Name	Original		Replacement of	Replaced by		-	Page 2 / 9

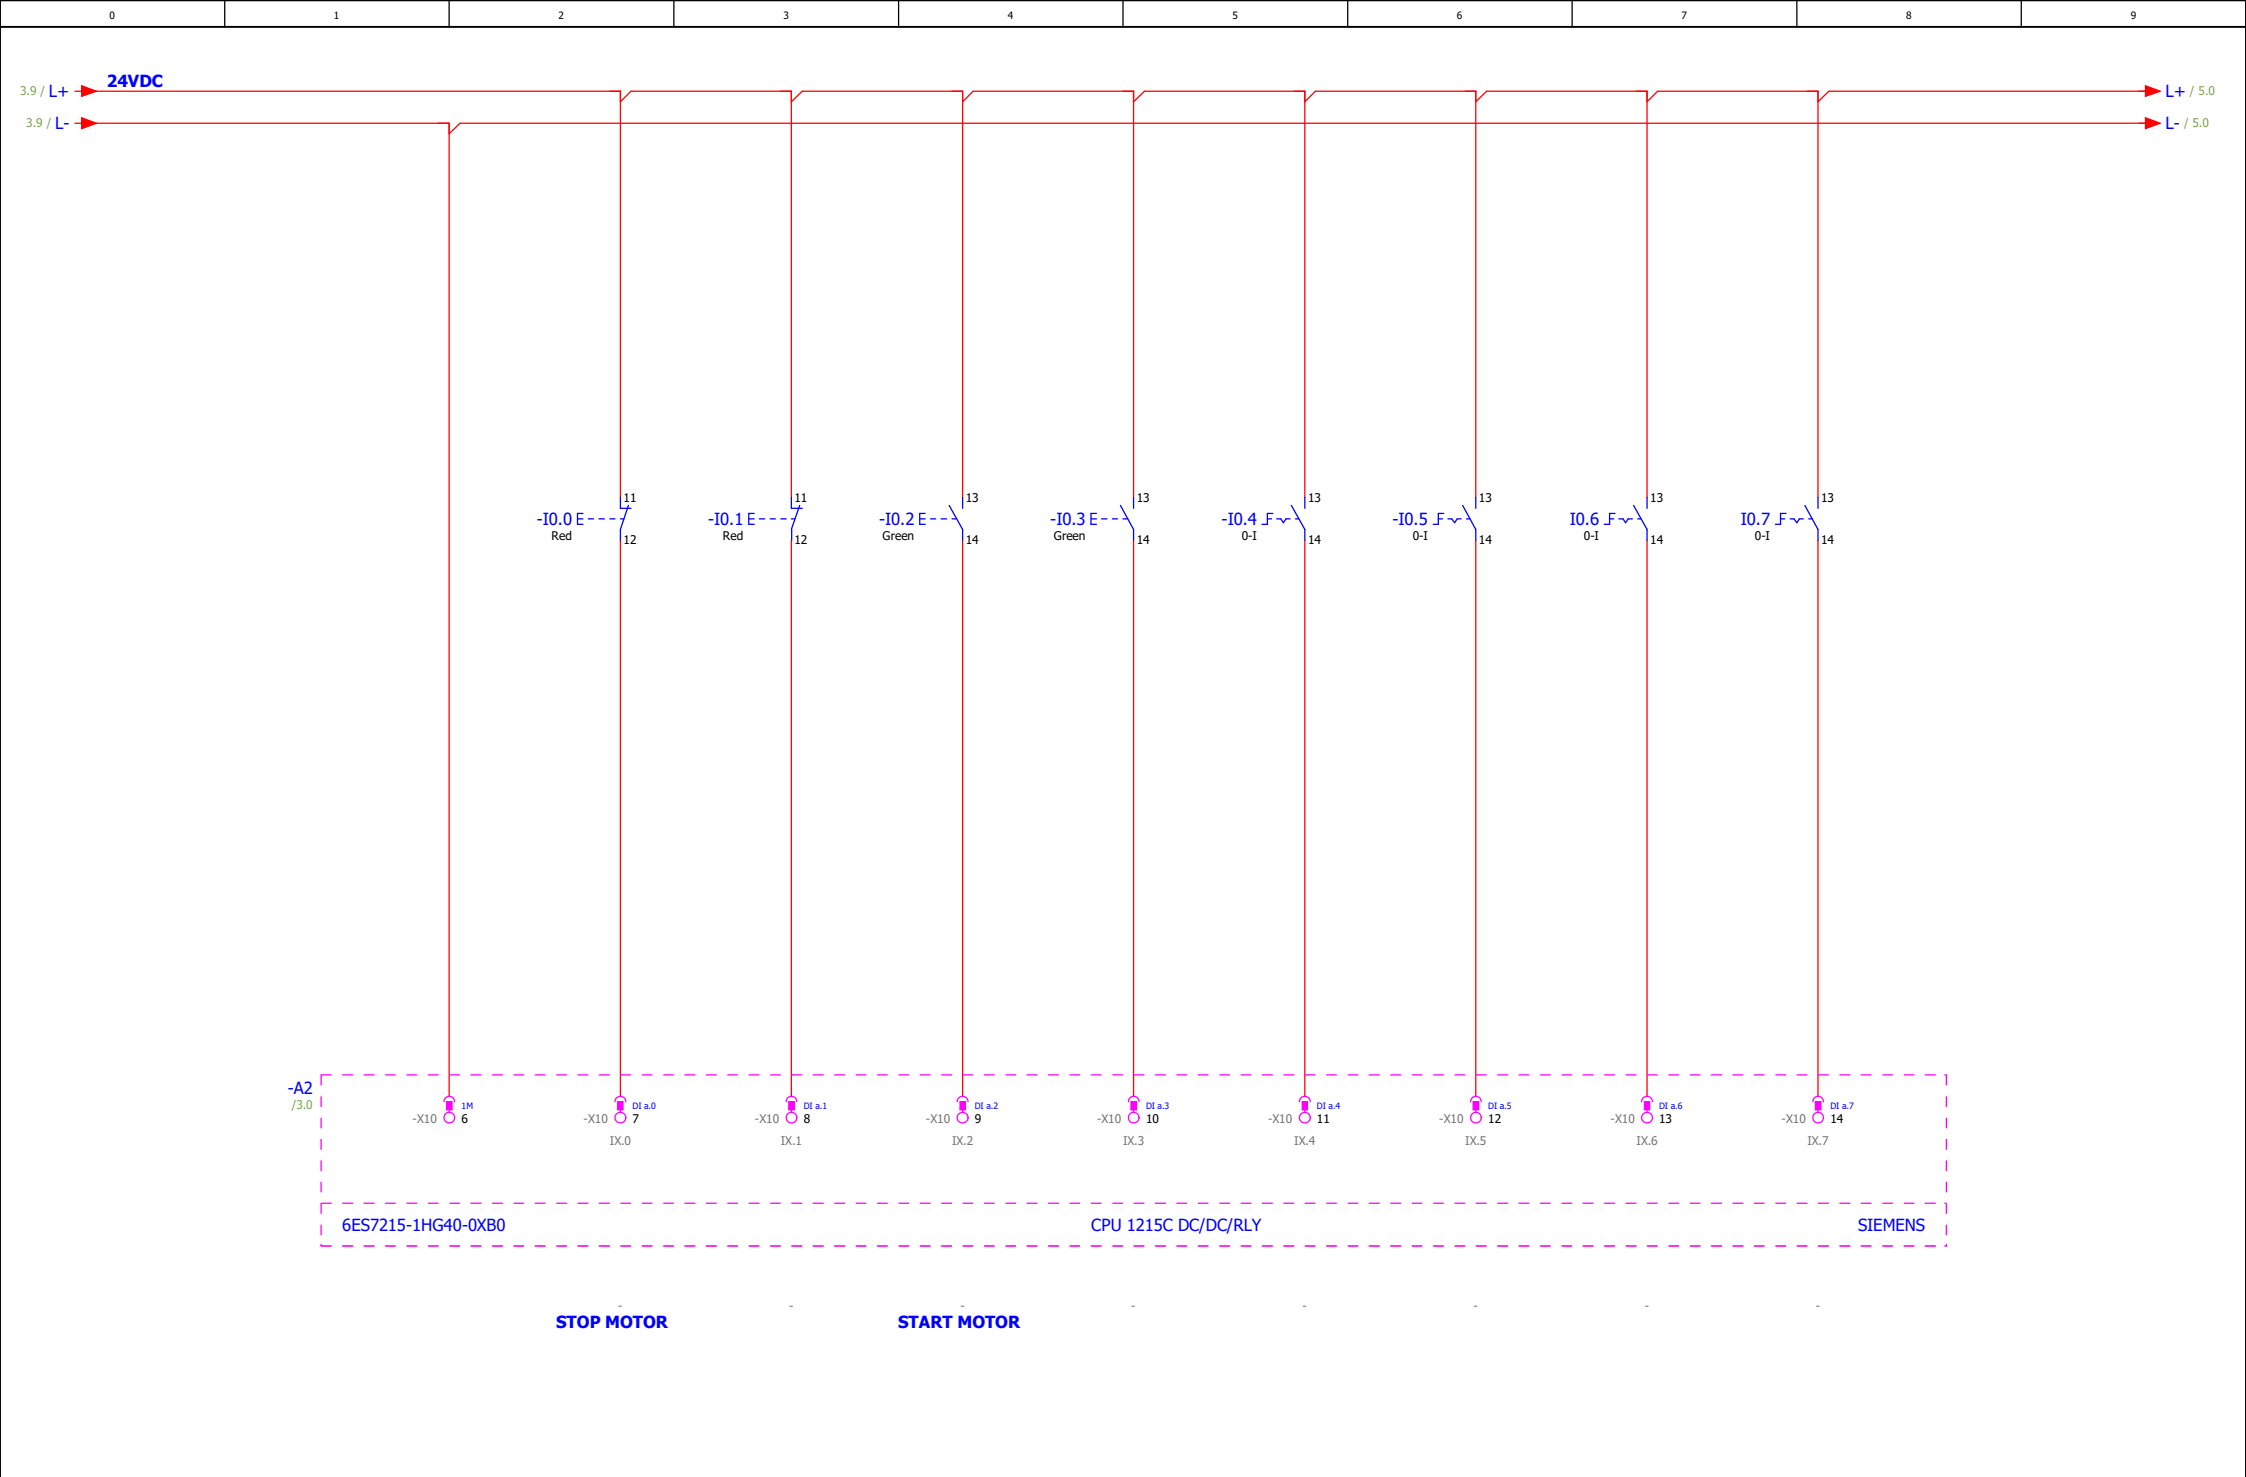


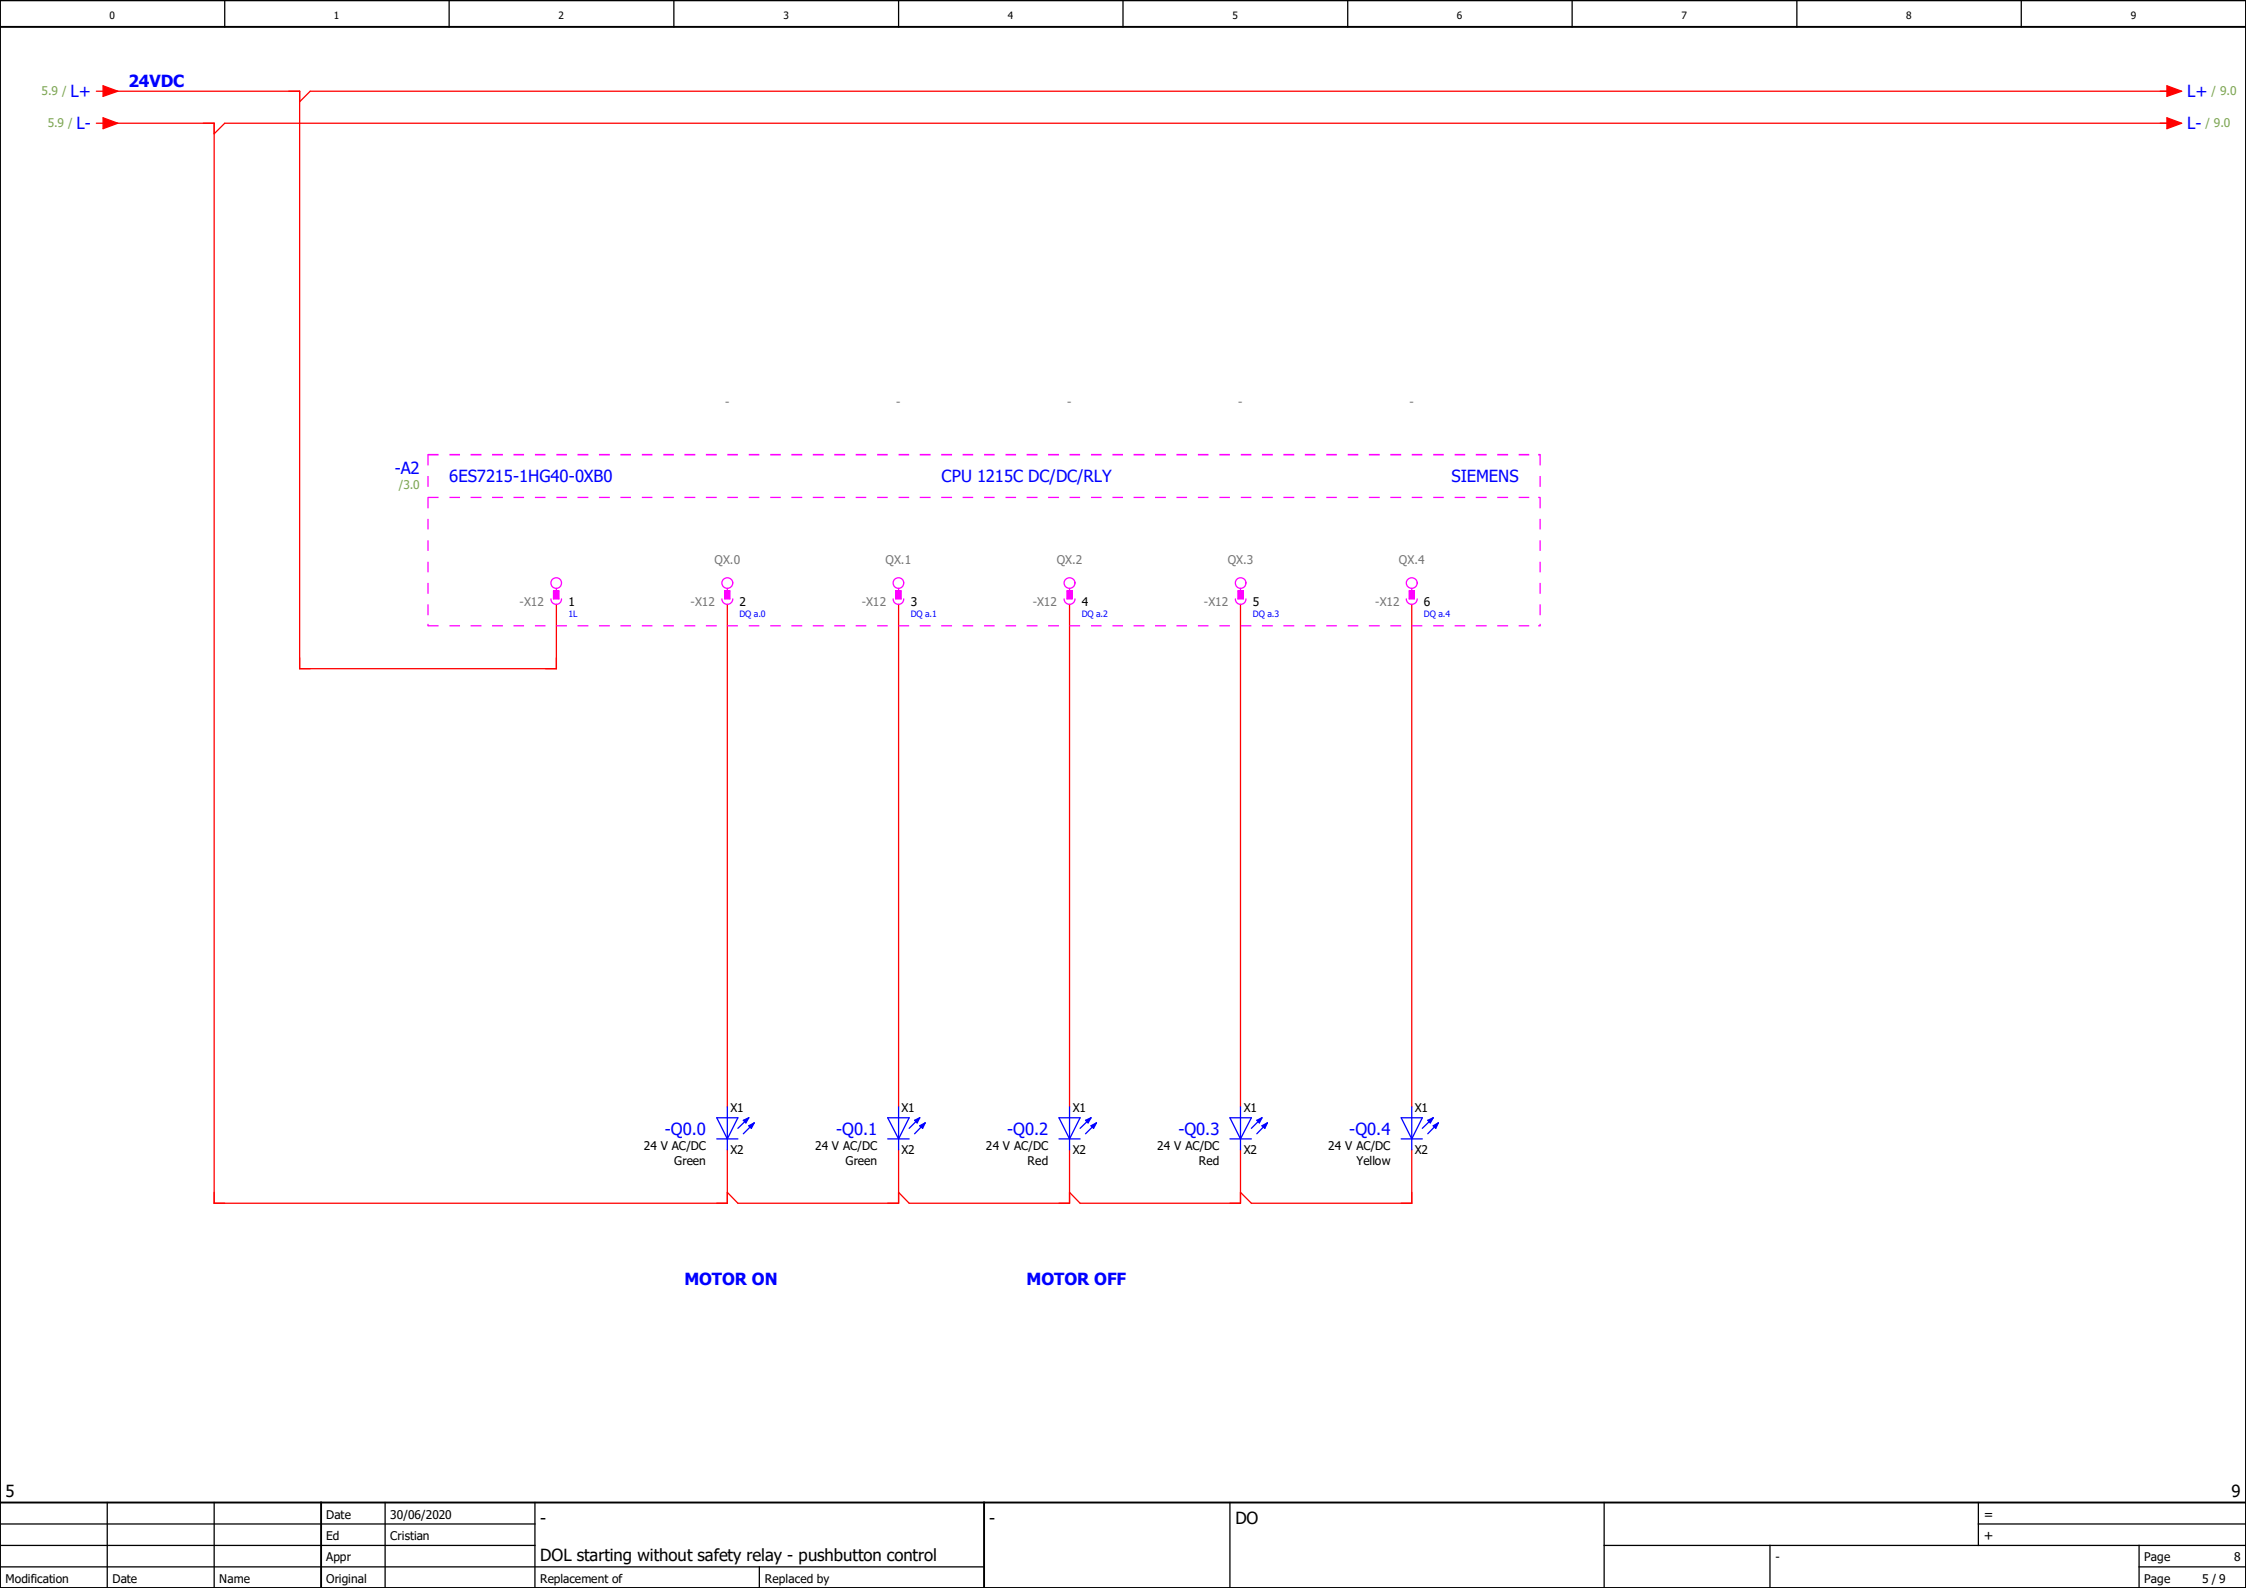

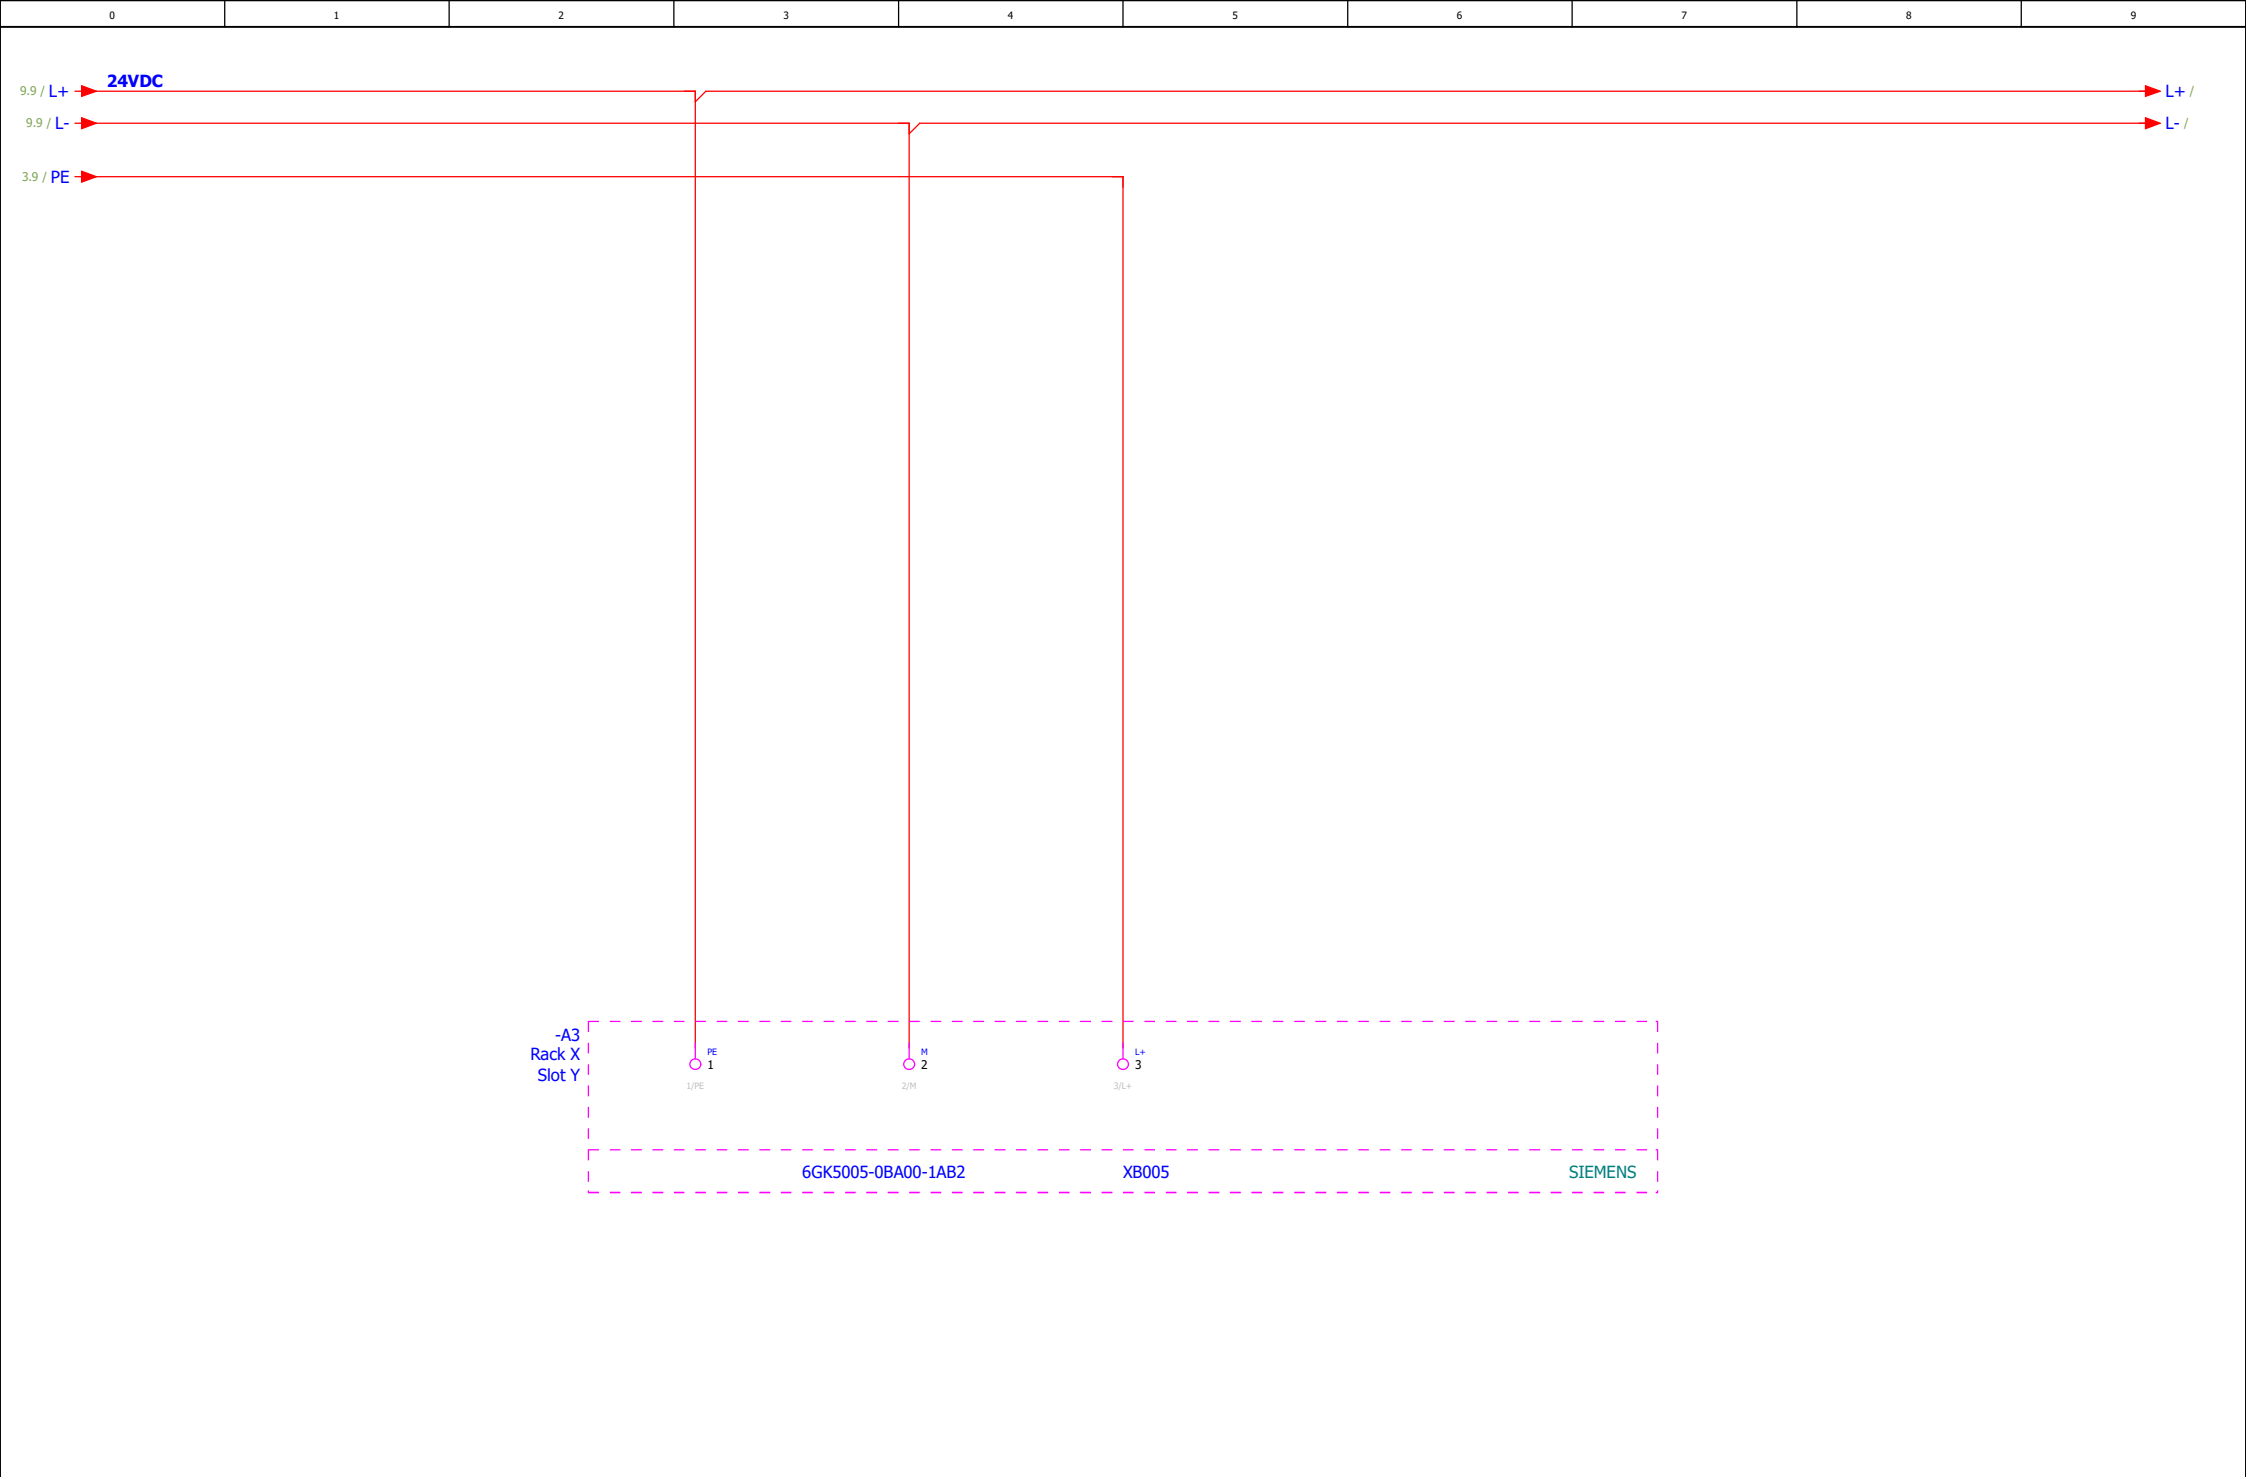

+FIELD

External Main Power Supply from CEE 32A, 400V, 5-pole wall socket outlet

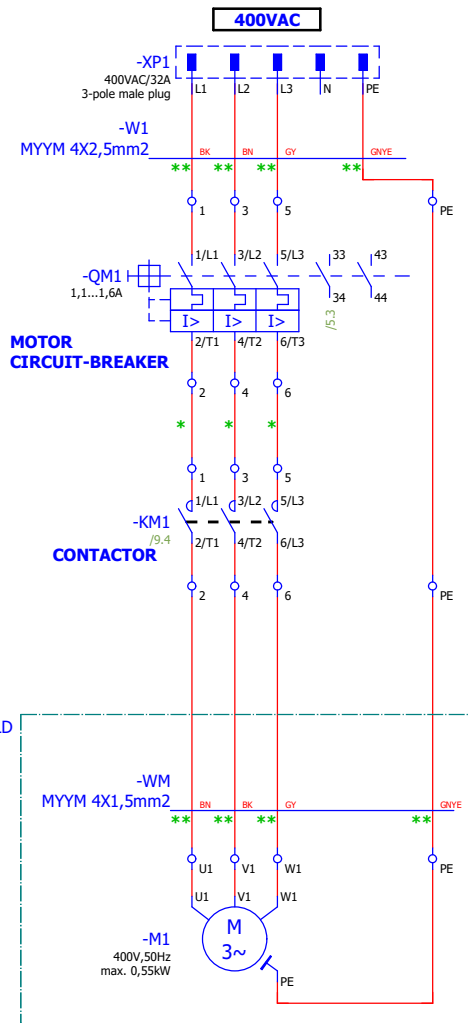

REMARK: * = CONNECTION TO BE MADE WITH SAFETY LEADS:



**=CONNECTION TO BE MADE WITH POWER CABLE WITH STRANDED COOPER CONDUCTORS.

			Date	15/07/2020	-				
			Ed	Cristian					
			Appr						
			Original						
Modification	Date	Name	Original		Replacement of	Replaced by			

DOL starting without safety relay - pushbutton control

DOL (Direct-On-Line) motor starting

=

+

