




			Date	08/07/2020	-		DI		=	
			Ed	Cristian	DOL starting 2 motors wo. safety relay - switch c-trol				+	
			Appr							
Modification	Date	Name	Original		Replacement of	Replaced by				
									Page	4
									Page	3 / 9

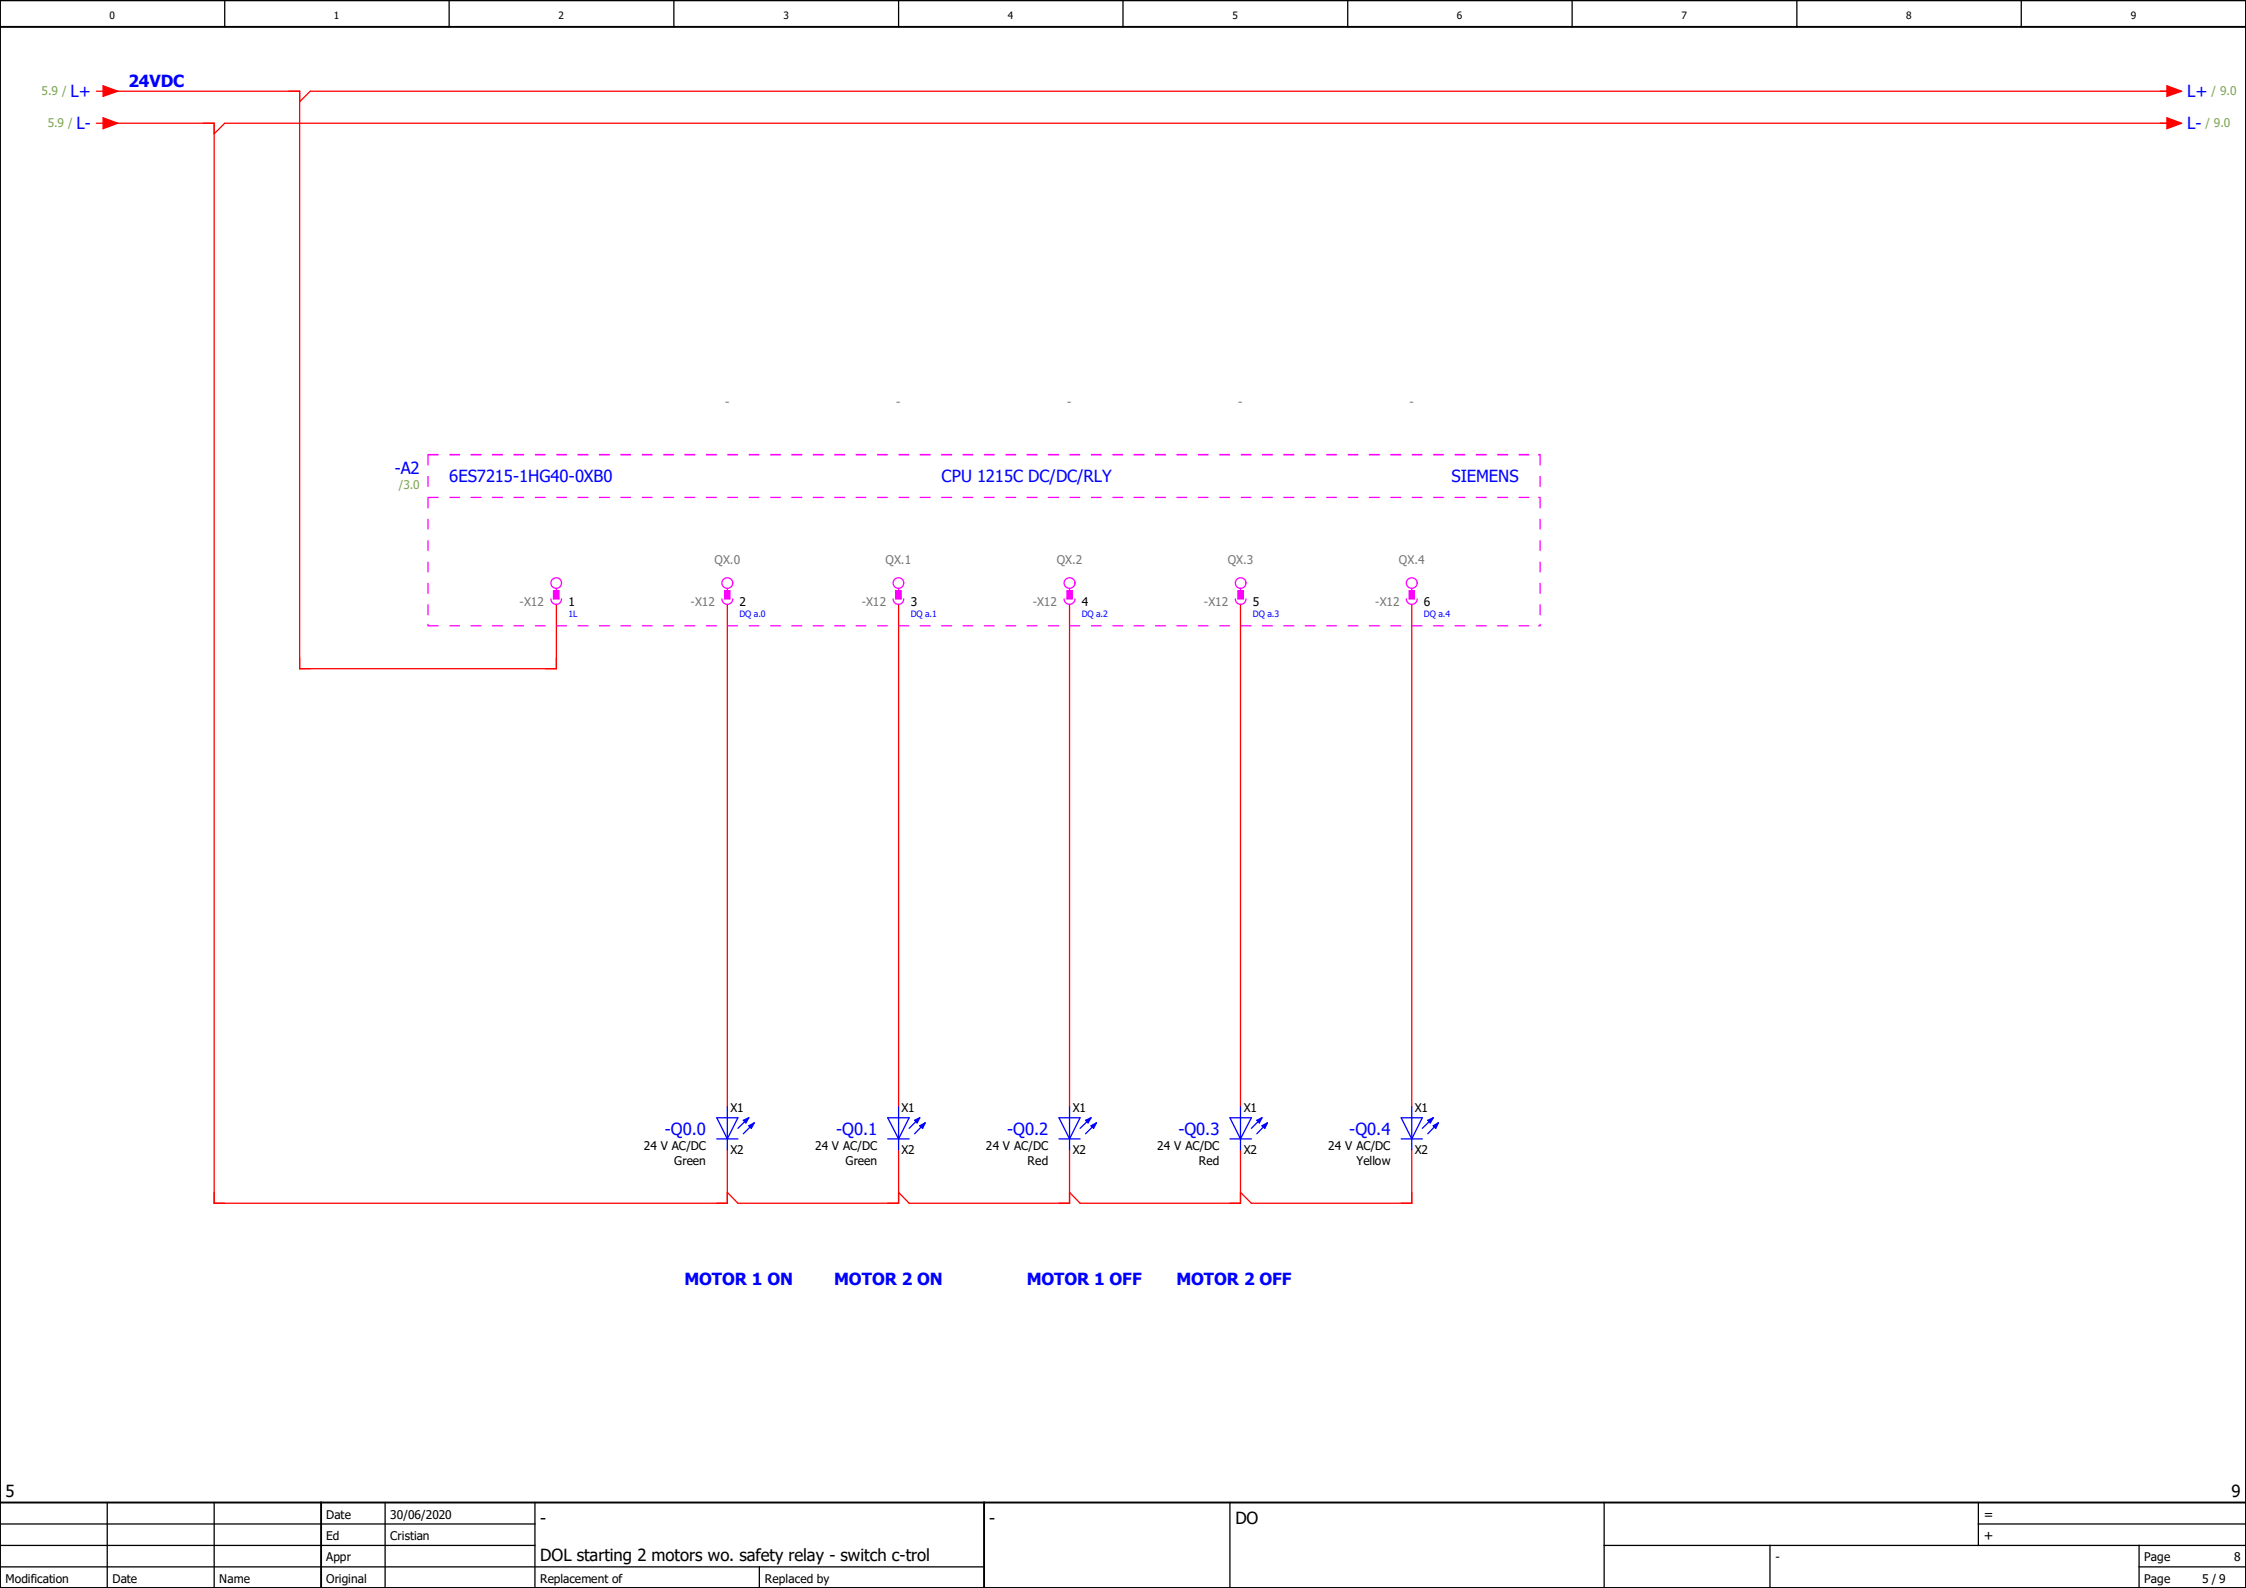




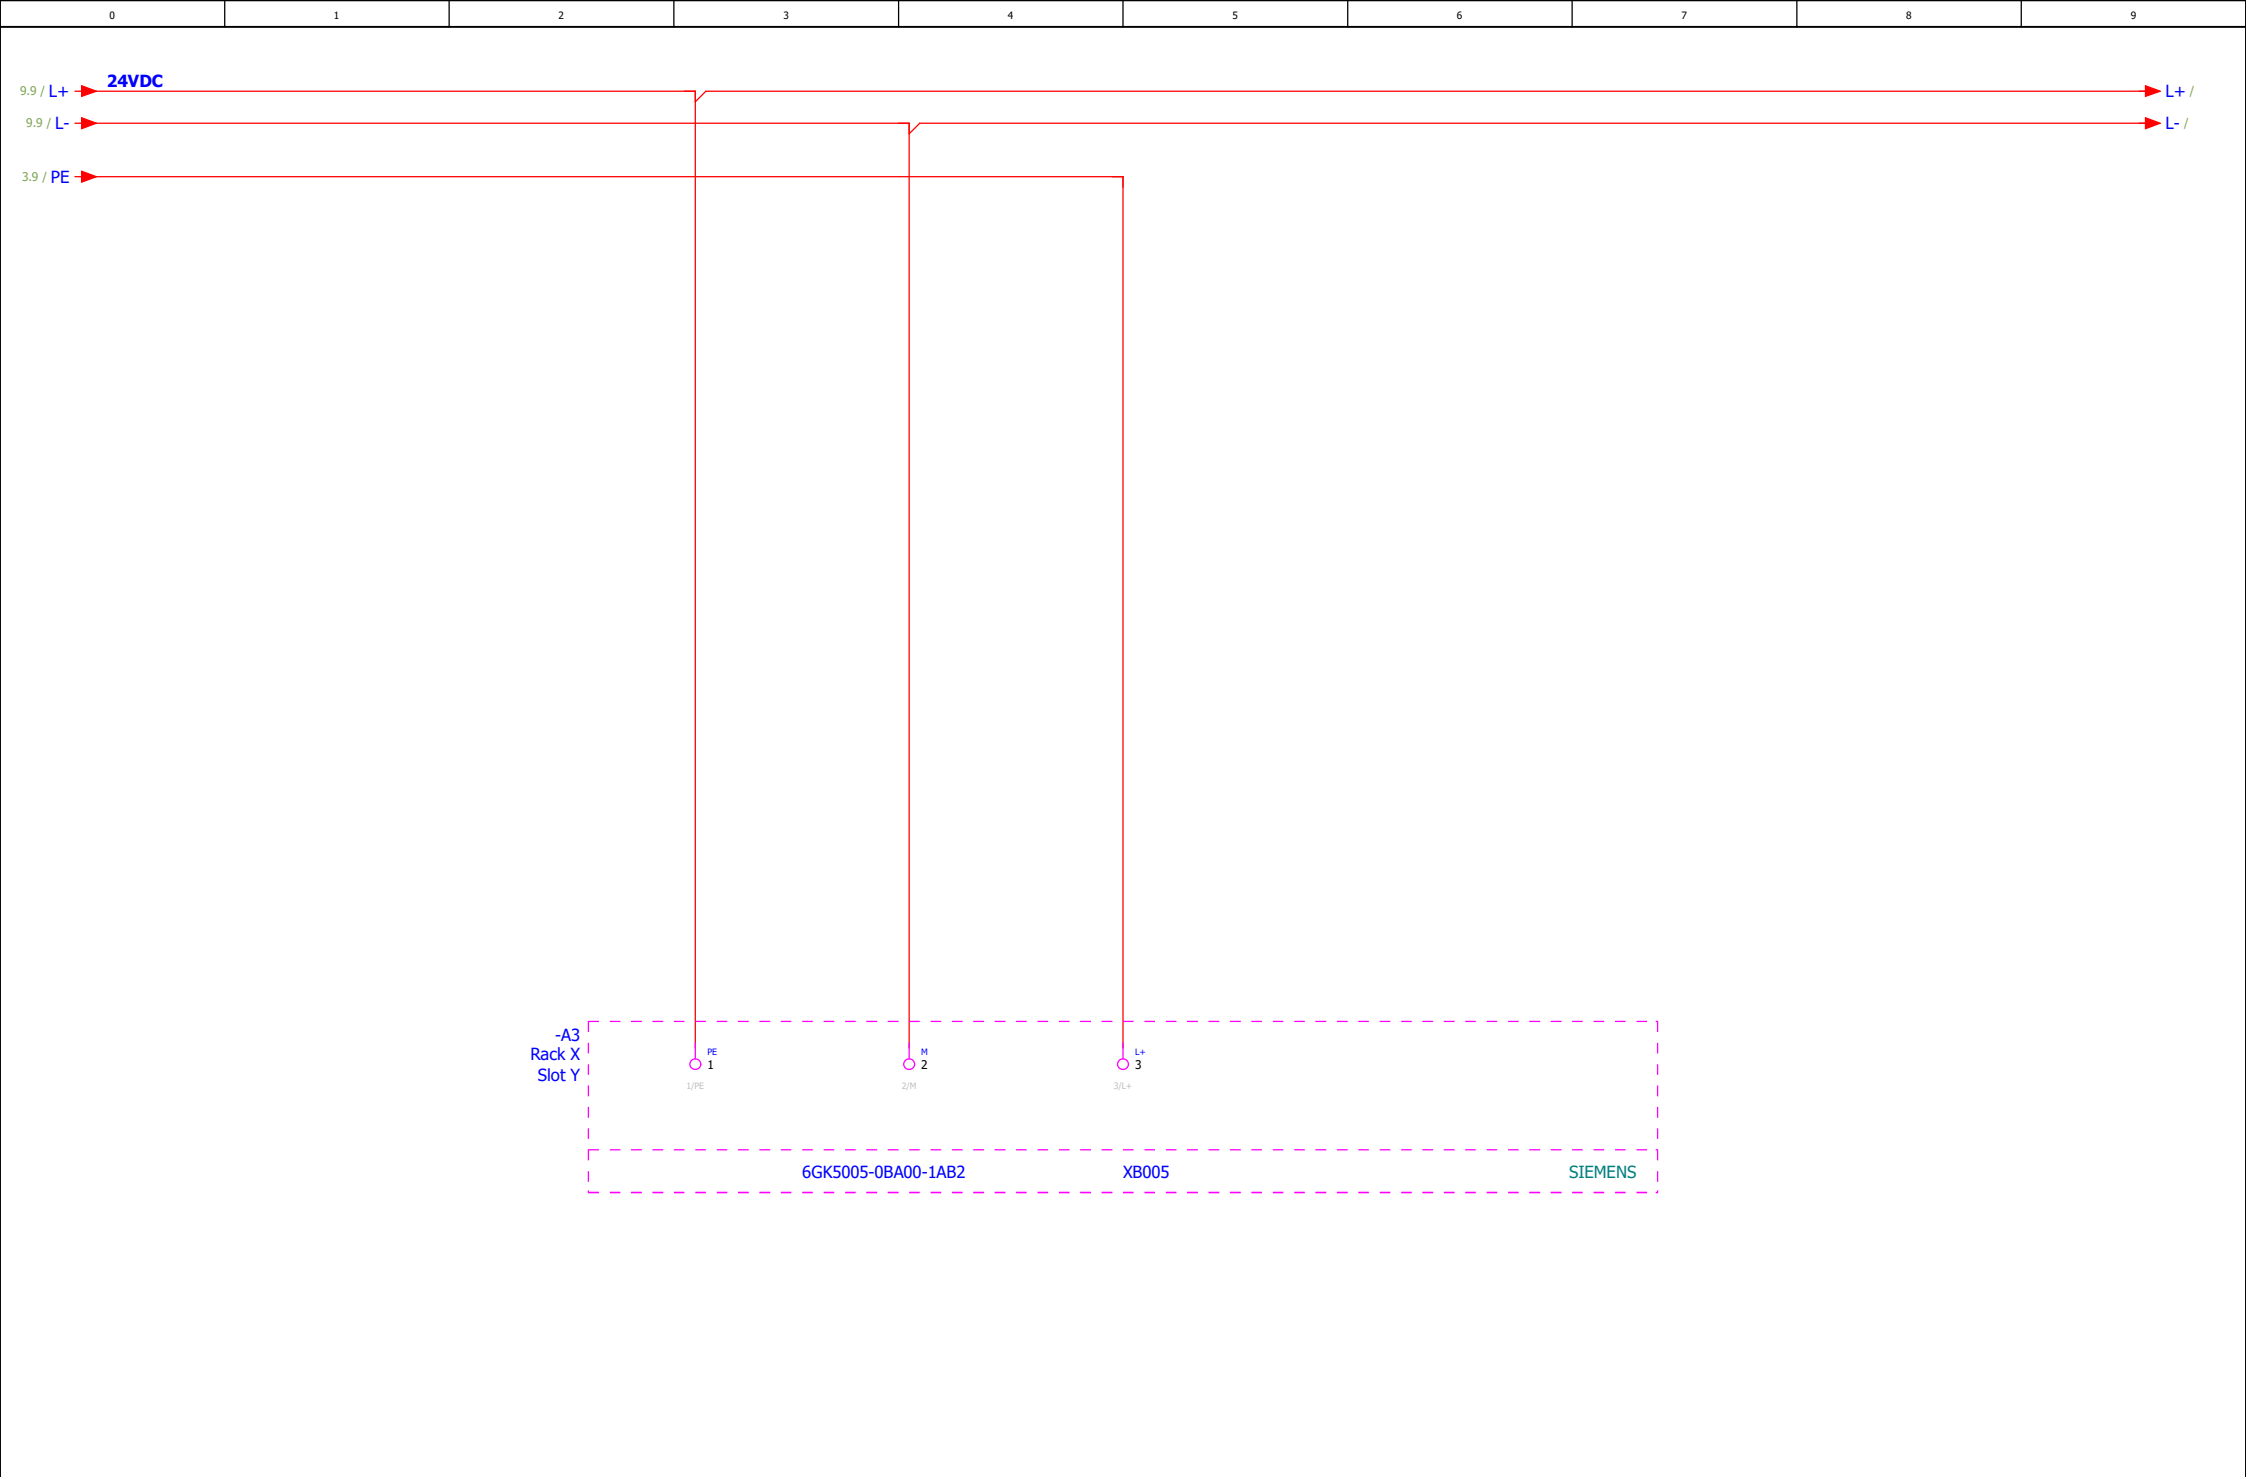

+FIELD

External Main Power Supply from CEE 32A, 400V, 5-pole wall socket outlet

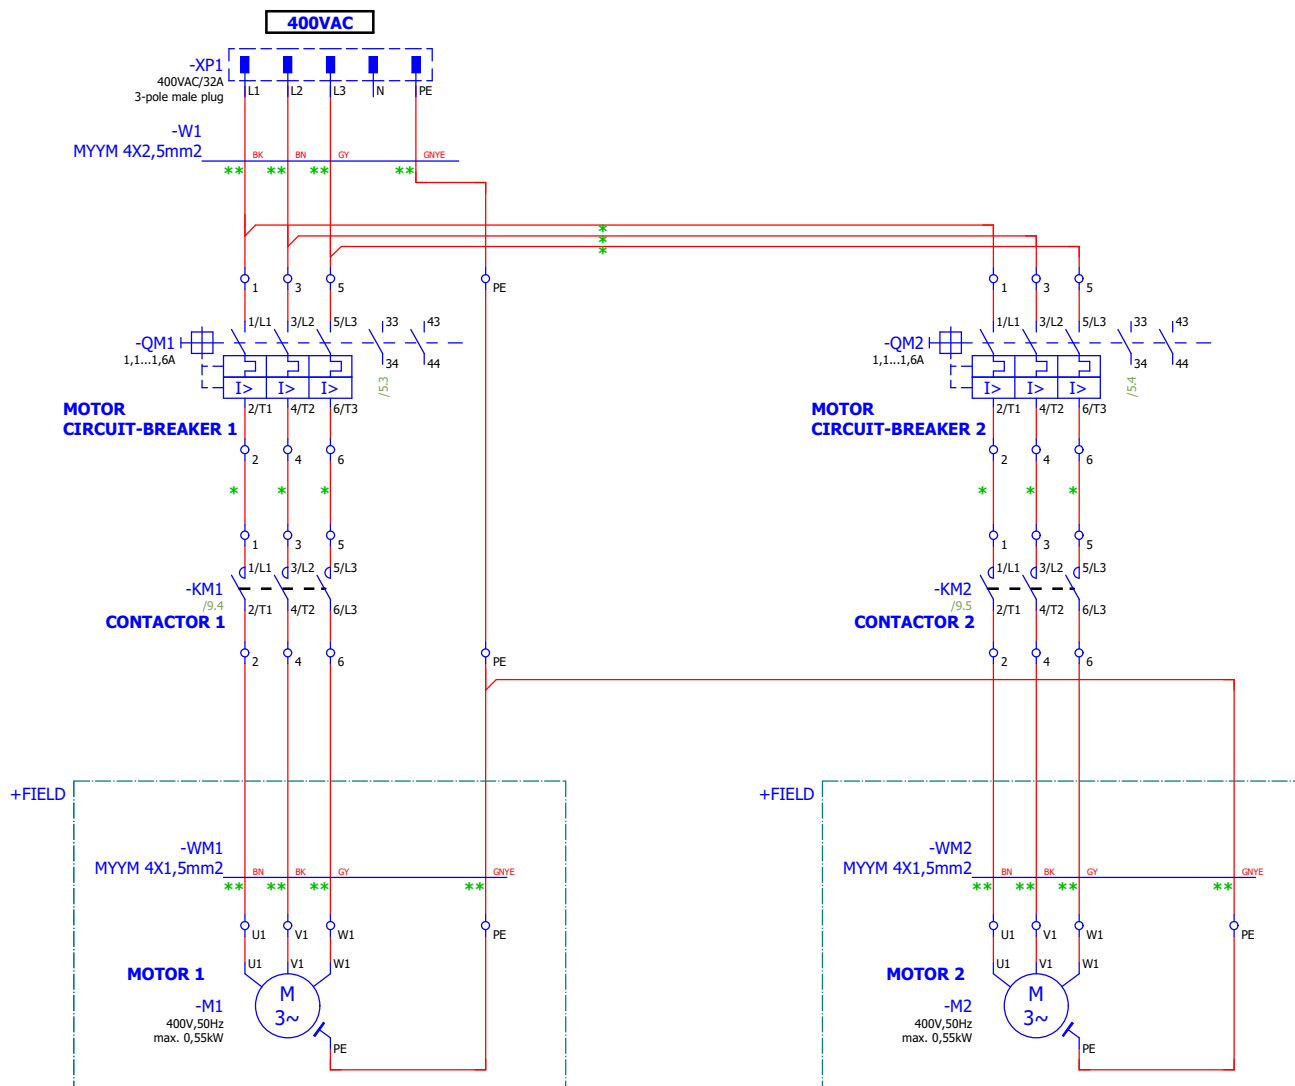

REMARK: * = CONNECTION TO BE MADE WITH SAFETY LEADS:



****=CONNECTION TO BE MADE WITH POWER CABLE WITH STRANDED COOPER CONDUCTORS.**

		Date	15/07/2020	-	DOL starting 2 motors wo. safety relay - switch c-trol	-	DOL (Direct-On-Line) motor starting	=		Page 11
		Ed	Cristian					+		Page 8 / 9
		Appr								
Modification	Date	Name	Original		Replacement of	Replaced by				

