


3										5									
			Date	08/07/2020	-			DI						=					
			Ed	Cristian															
			Appr								DOL starting with Reversing wo. safety relay - switch c-trol						+		
Modification	Date	Name	Original		Replacement of		Replaced by					-			Page 4				
																Page 3 / 9			








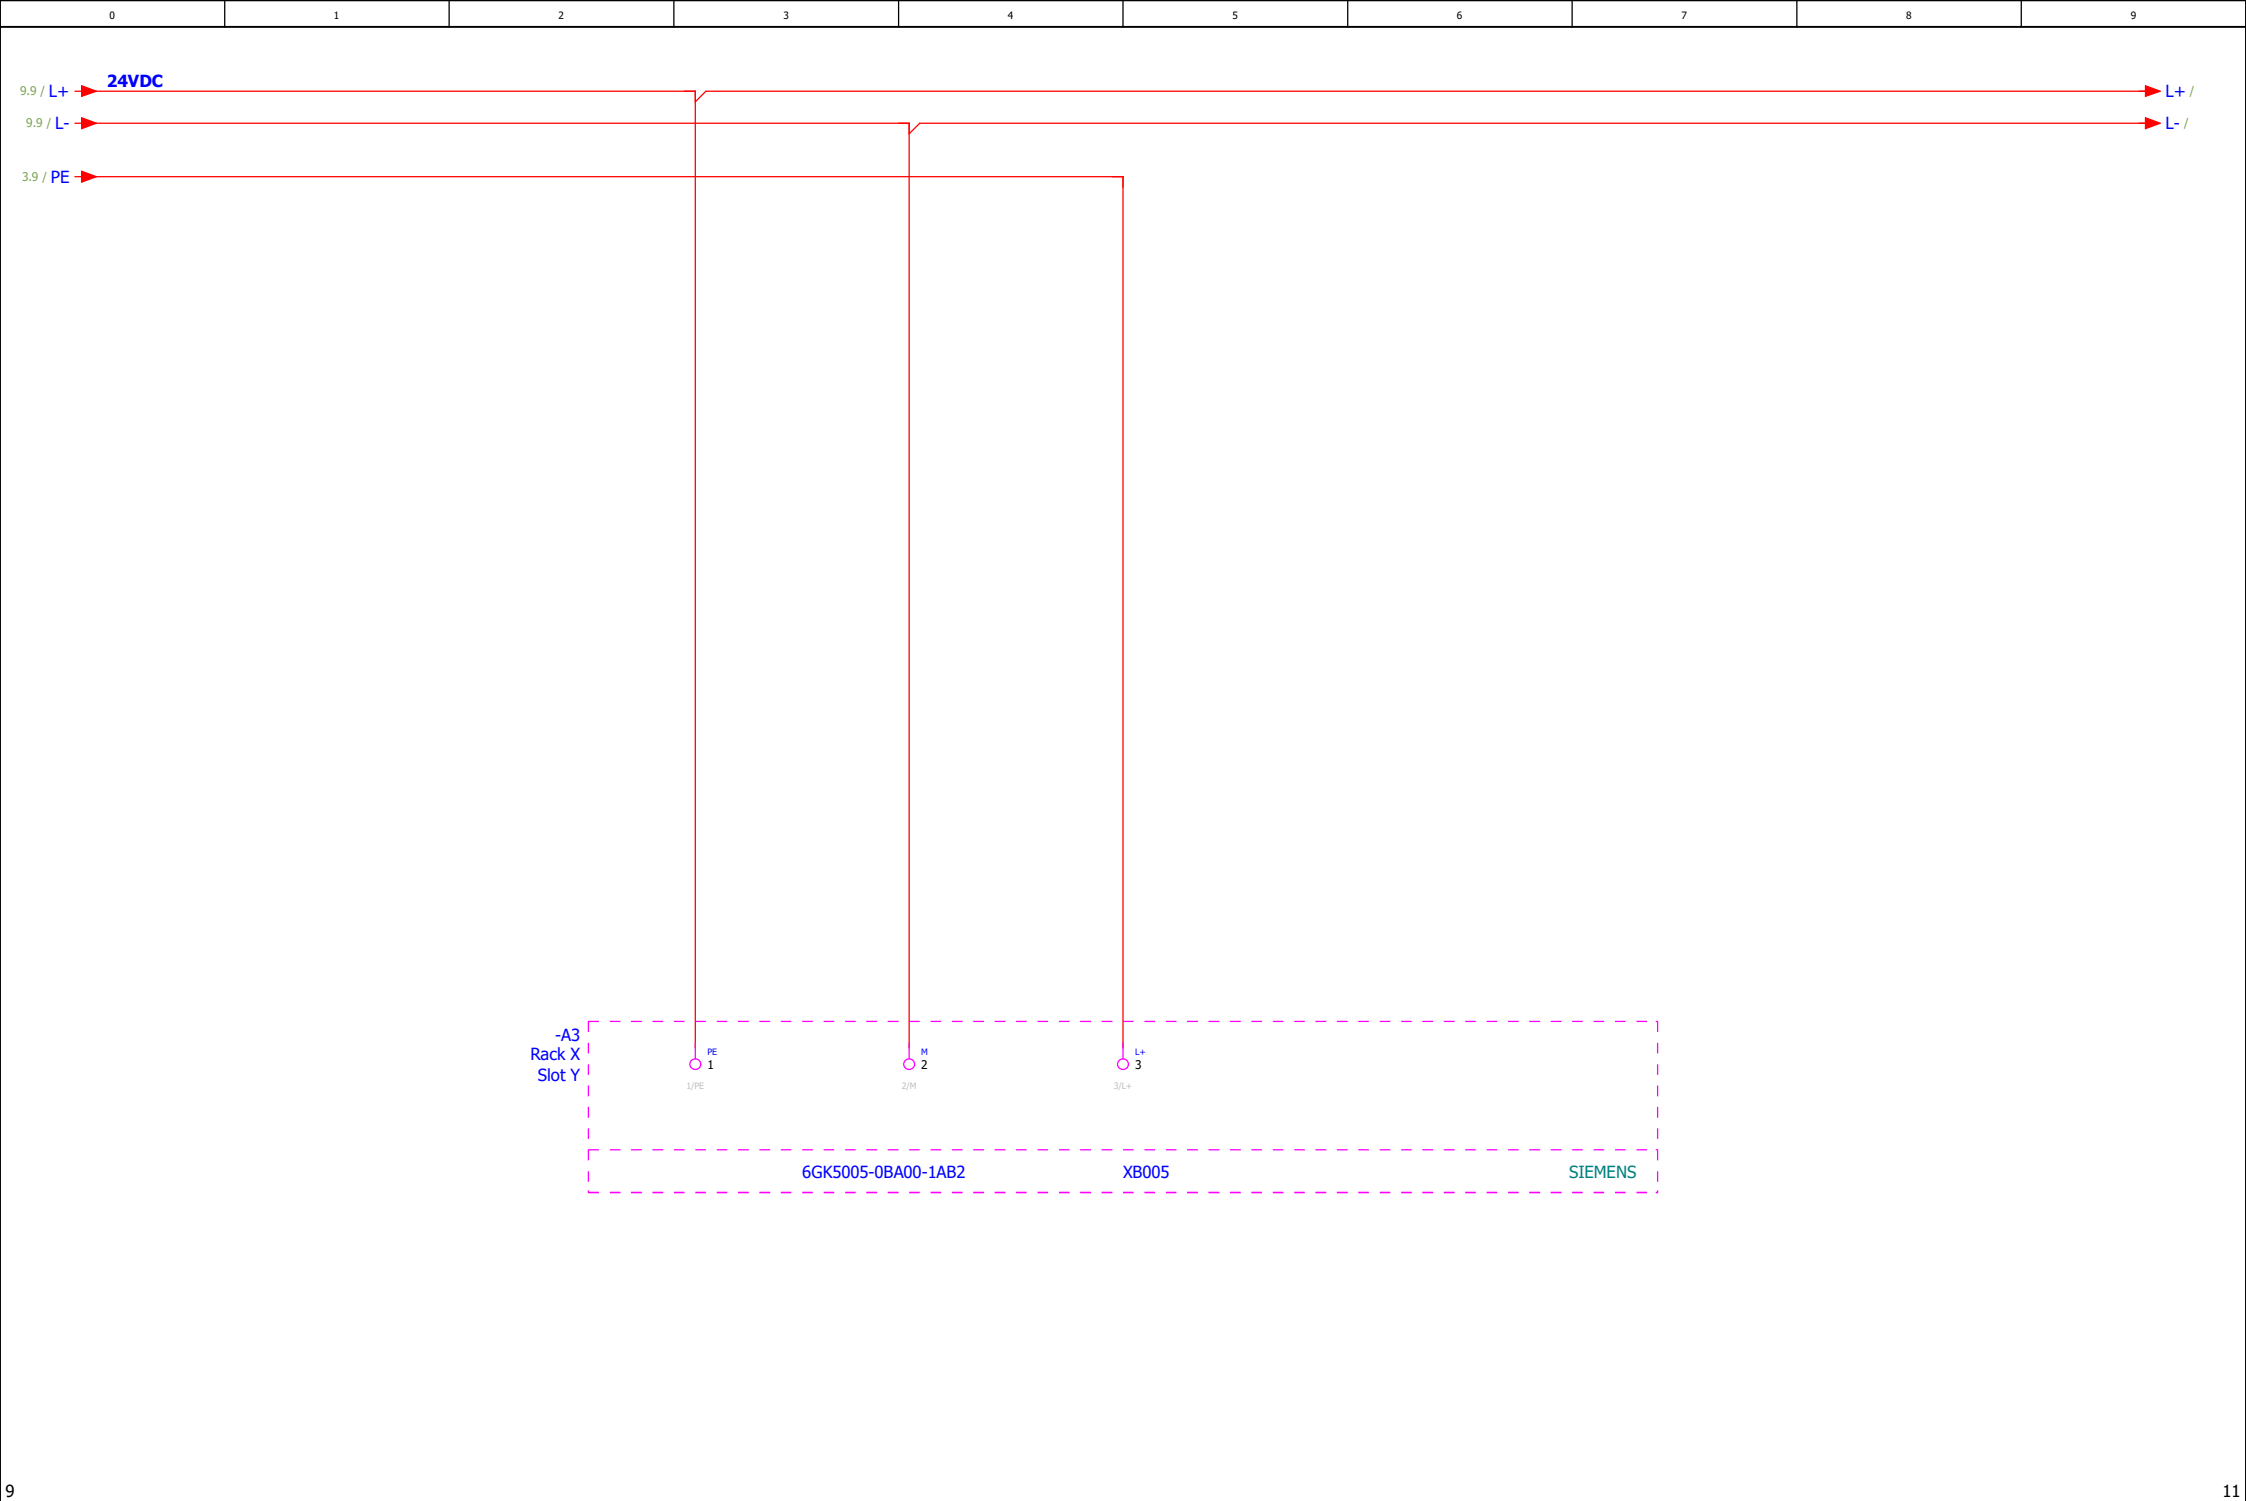

+FIELD

**External Main Power Supply from CEE 32A, 400V, 5-pole wall socket outlet**

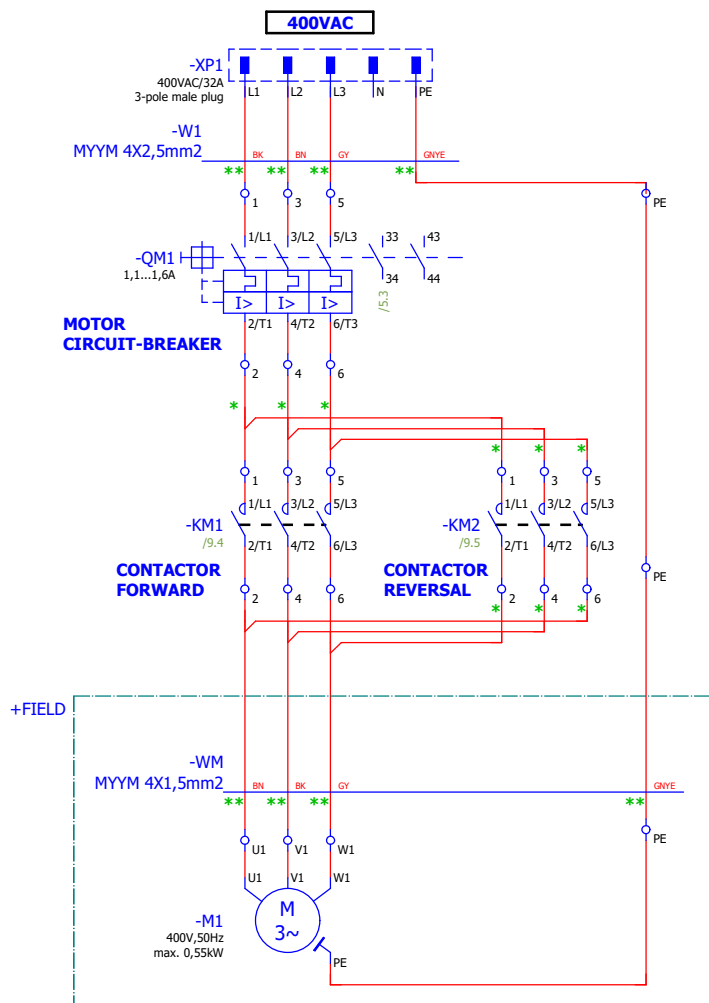

**REMARK: \* = CONNECTION TO BE MADE WITH SAFETY LEADS:**



**\*\*=CONNECTION TO BE MADE WITH POWER CABLE WITH STRANDED COOPER CONDUCTORS.**

			Date	15/07/2020	-	DOL (Direct-On-Line) with Reversing motor starting	=	
			Ed	Cristian			+	
			Appr		DOL starting with Reversing wo. safety relay - switch c-trol			
Modification	Date	Name	Original		Replacement of	Replaced by		



