


Hajipur HQ Railnet Connectivity Diagram

As on 12.09.2023

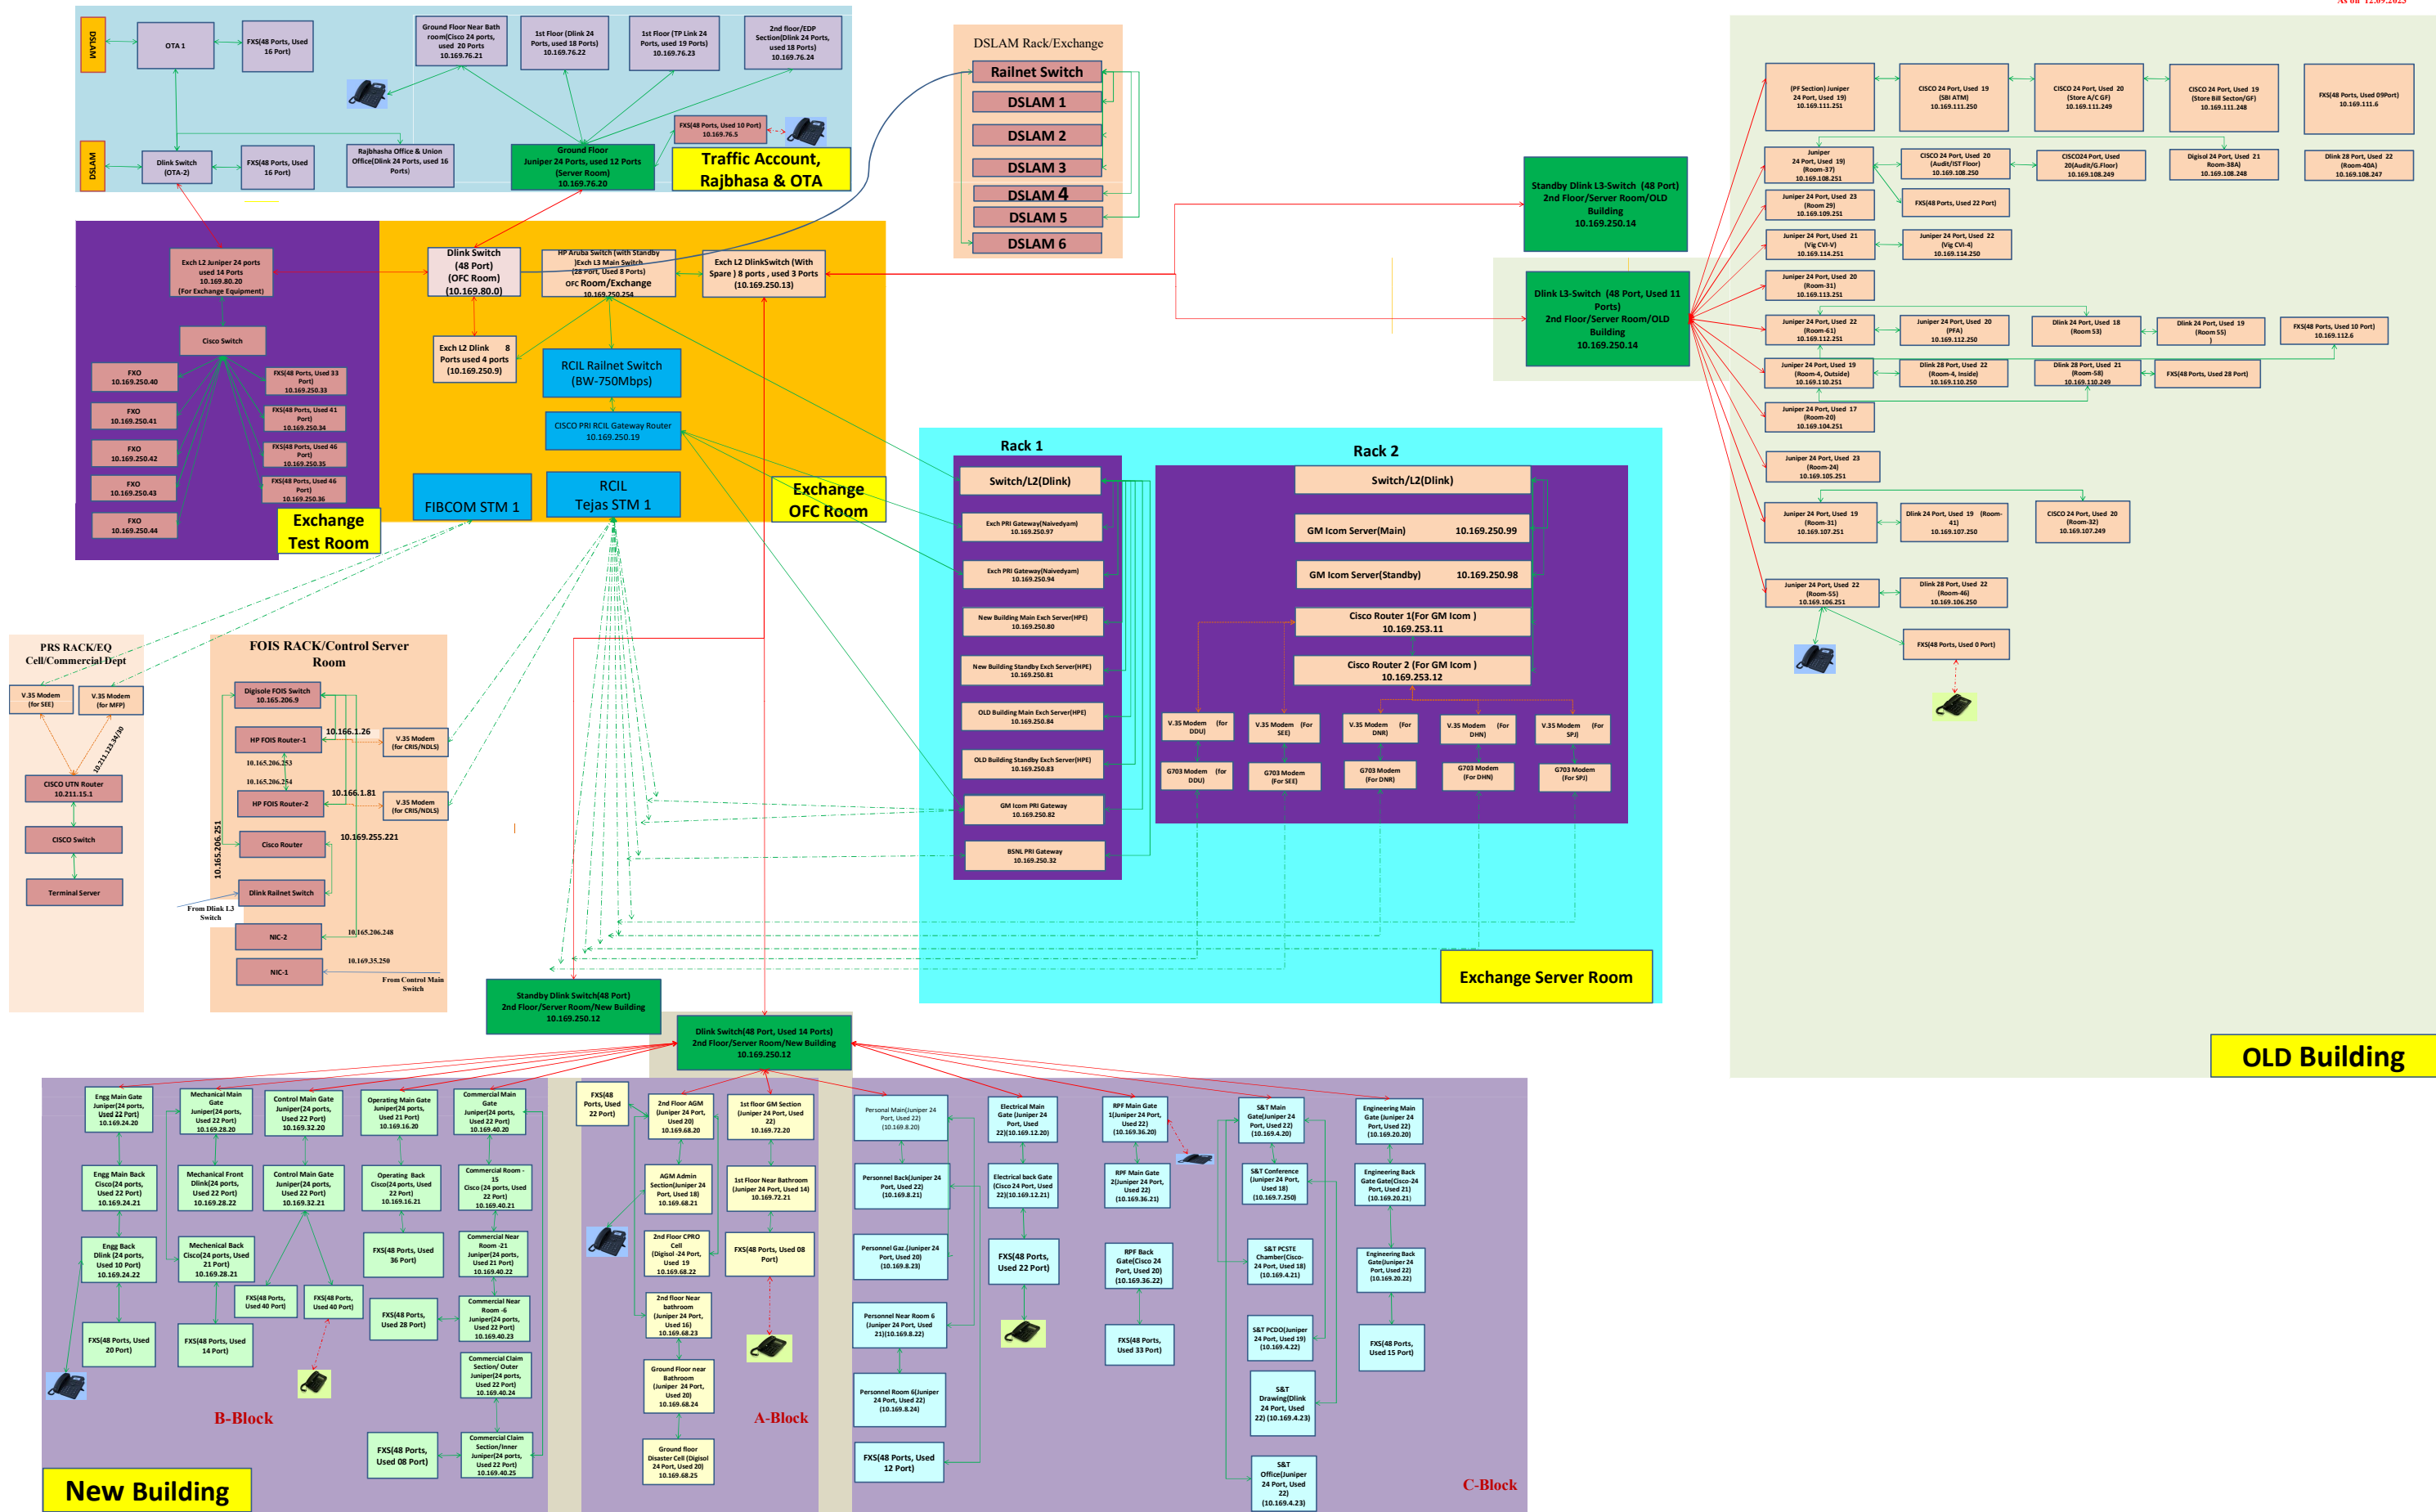

6KVA UPS/Delta Make-3No.(Working in Parallel & Installed in Server Room On 2nd floor control)For N/W Switches of New Building.

6KVA UPS/Delta Make -2Nos.(Working in Parallel & installed in Equipment Room/Old Conference Hall) For N/W Switches of Old Building.

6KVA UPS/Delta Make -2Nos. (Working in Parallel & Installed in Server Room/Ground Floor TA building) For N/W Switches of Traffic A/C Building & OTA.