



Commonwealth of Virginia

VIRGINIA DEPARTMENT OF ENVIRONMENTAL QUALITY

www.deq.virginia.gov

David L. Bulova
Secretary of Natural and Historic Resources

Michael S. Rolband, PE, PWD, PWS Emeritus
Director

July 29, 2026

Mr. Robb Truedinger
Authorized Representative
c/o Ms. Maddie Coates
Amazon Data Services, Inc.
13820 Sunrise Valley Drive
Herndon, VA 20171

Location: Fairfax County
Registration No.: 74239

Dear Mr. Truedinger:

Attached is a permit approval to construct and operate diesel engine generator sets (gen-sets) at a data center in accordance with the provisions of the Virginia State Air Pollution Control Board Regulations for the Control and Abatement of Air Pollution. This combined permit document supersedes your permit document dated September 9, 2022.

In the course of evaluating the application and arriving at a final decision to approve the project, the Department of Environmental Quality (DEQ) deemed the application complete on July 14, 2026.

This permit contains legally enforceable conditions. Failure to comply may result in a Notice of Violation and/or civil charges. Please read all permit conditions carefully.

This permit approval does not relieve Amazon Data Services, Inc. of the responsibility to comply with all other local, state and federal permit regulations. This permit does not evaluate, approve, or imply approval of any other permits or authorizations under the authority of the Virginia Department of Environmental Quality (DEQ). Issuance of this permit does not create, obligate, assure, or justify any financially backed expectation that additional permits from other DEQ programs will be issued. All future permit applications will be reviewed independently in accordance with the Code of Virginia, applicable regulations, and DEQ policies.

The proposed diesel fired emergency engine generator sets (engine gen-sets) may be subject to 40 CFR 63, Maximum Achievable Control Technology, (MACT) Subpart ZZZZ and 40 CFR 60, New Source Performance Standard (NSPS), Subpart IIII. Virginia has not accepted delegation of these rules. In summary, the units may be required to comply with certain federal emission

standards and operating limitations. The Department of Environmental Quality (DEQ) advises you to review the referenced MACT and NSPS to ensure compliance with applicable emission and operational limitations. As the owner/operator you may be also responsible for any monitoring, notification, reporting and recordkeeping requirements of the MACT and NSPS. Notifications shall only be sent to EPA, Region III.

To review any federal rules referenced in the above paragraph or in the attached permit, the US Government Publishing Office maintains the text of these rules at www.ecfr.gov, Title 40, Part 60 and 63.

The Board's Regulations as contained in Title 9 of the Virginia Administrative Code 5-170-200 provide that you may request a formal hearing from this case decision by filing a petition with the Board within 30 days after this case decision notice was mailed or delivered to you. Please consult the relevant regulations for additional requirements for such requests.

As provided by Rule 2A:2 of the Supreme Court of Virginia, you have 30 days from the date you actually received this permit or the date on which it was mailed to you, whichever occurred first, within which to initiate an appeal of this decision by filing a Notice of Appeal with:

Michael S. Rolband, Director
Department of Environmental Quality
P. O. Box 1105
Richmond, VA 23218

If this permit was delivered to you by mail, three days are added to the thirty-day period in which to file an appeal. Please refer to Part Two A of the Rules of the Supreme Court of Virginia for information on the required content of the Notice of Appeal and for additional requirements governing appeals from decisions of administrative agencies.

If you have any questions concerning this permit, please contact Ms. Katie DeVoss at (571) 866-6090 or katie.devoss@deq.virginia.gov.

Sincerely,



Justin A. Wilkinson, Regional Air Permit Manager
Virginia Department of Environmental Quality
justin.wilkinson@deq.virginia.gov
Northern Regional Office
13901 Crown Court, Woodbridge, VA 22193
(703) 583-3800

Attachment: Permit



Commonwealth of Virginia

VIRGINIA DEPARTMENT OF ENVIRONMENTAL QUALITY

www.deq.virginia.gov

David L. Bulova
Secretary of Natural and Historic Resources

Michael S. Rolband, PE, PWD, PWS Emeritus
Director

STATIONARY SOURCE PERMIT TO CONSTRUCT AND OPERATE

This permit document supersedes your permit document dated September 9, 2022.

In compliance with the Federal Clean Air Act and the Commonwealth of Virginia Regulations for the Control and Abatement of Air Pollution,

Amazon Data Services, Inc.
13820 Sunrise Valley Drive
Herndon, VA 20171
Registration No.: 74239

is authorized to construct and operate

emergency engine gen-sets

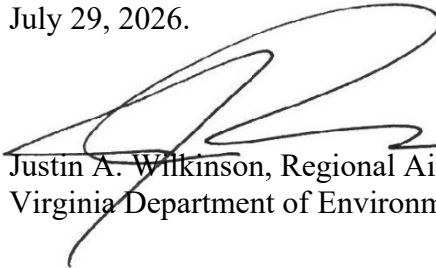
located at

IAD134, IAD135, and IAD136
3980, 3980A, 3960, and 3940 Virginia Mallory Drive
Chantilly, VA 20151
(Fairfax County)

in accordance with the Conditions of this permit.

Approved on

July 29, 2026.


Justin A. Wilkinson, Regional Air Permit Manager
Virginia Department of Environmental Quality

Permit consists of 16 pages.
Permit Conditions 1 to 29.

INTRODUCTION

This permit document is based on and combines permit terms and conditions in accordance with 9VAC5-80-1255 from the following permit approvals and the respective permit applications:

- mNSR dated July 29, 2026, based on the permit application dated May 23, 2026, including supplemental information dated June 26, 2026, and July 14, 2026.
- mNSR dated September 9, 2022, based on the permit application dated April 29, 2022, including supplemental information dated August 2, 2022.

Any changes in the permit application specifications or any existing facilities which alter the impact of the facility on air quality may require a permit. Failure to obtain such a permit prior to construction may result in enforcement action. In addition, this facility may be subject to additional applicable requirements not listed in this permit.

Words or terms used in this permit shall have meanings as provided in 9VAC5-10-10 of the State Air Pollution Control Board Regulations for the Control and Abatement of Air Pollution. The regulatory reference or authority for each condition is listed in parentheses () after each condition. The enabling permit program, or permit programs is provided below each permit condition in the regulatory authority parenthetical as follows: 9VAC5-80-850 for Article 5, 9VAC5-80-1180 for Article 6, 9VAC5-80-1985 for Article 8, and 9VAC5-80-2050 for Article 9. The most recent effective date for a term or condition is listed in brackets []. When identical conditions for one or more emission units are combined, the effective date listed in this permit does not alter the prior effective date(s) for any such conditions as issued in a previous permit action. In accordance with 9VAC5-80-1120F, any condition not marked as state-only enforceable (SOE) is state and federally enforceable.

Annual requirements to fulfill legal obligations to maintain current stationary source emissions data will necessitate a prompt response by the permittee to requests by the DEQ or the Board for information to include, as appropriate: process and production data; changes in control equipment; and operating schedules. Such requests for information from the DEQ will either be in writing or by personal contact.

The availability of information submitted to the DEQ or the Board will be governed by applicable provisions of the Freedom of Information Act, §§ 2.2-3700 through 2.2-3714 of the Code of Virginia, § 10.1-1314 (addressing information provided to the Board) of the Code of Virginia, and 9VAC5-170-60 of the State Air Pollution Control Board Regulations. Information provided to federal officials is subject to appropriate federal law and regulations governing confidentiality of such information.

Equipment List - Equipment at this facility covered by this permit consists of:

Equipment to be Constructed:

Ref. No.	Equipment Description	Rated Capacity	Referenced Federal Requirements	Original Permit Date
68	(1) Caterpillar Model C18 diesel fired emergency engine gen-set	909 bhp 600 ekW	N/A	July 29, 2026

Equipment Previously Permitted:

Ref. Nos.	Equipment Description	Rated Capacity (each)	Referenced Federal Requirements	Original Permit Date
1 through 22	(22) Cummins Model QSK60-G26 diesel fired emergency engine gen-sets	3,640 bhp 2,500 ekW	N/A	September 9, 2022
23 through 62	(40) MTU Model 16V4000G94S diesel fired emergency engine gen-sets	3,617 bhp 2,500 ekW	N/A	September 9, 2022
63 and 64	(2) Cummins Model QST30-G5 diesel fired emergency engine gen-sets	1,098 bhp 750 ekW	N/A	September 9, 2022
65 through 67	(3) MTU Model 12V1600G80S diesel fired emergency engine gen-sets	873 bhp 600 ekW	N/A	September 9, 2022
T1 and T2	(2) Caterpillar Model 3516C transitory diesel fired emergency engine gen-sets	2,937 bhp 2,000 ekW	N/A	September 9, 2022

Specifications included in the above tables are for informational purposes only and do not form enforceable terms or conditions of the permit.

PROCESS REQUIREMENTS

1. **Emission Controls** – Emissions from the emergency diesel engine-gen-sets (Ref. Nos. 1 through 68, T1, and T2) shall be controlled by the following:
 - a. Nitrogen oxide (NO_x) emissions from each emergency diesel engine gen-set shall be controlled by engine design.
 - b. Carbon monoxide (CO), particulate (PM/PM₁₀/PM_{2.5}), volatile organic compounds (VOC), nitrogen oxide (NO_x), and visible emissions from the emergency diesel engine gen-sets shall be controlled by the use of good operating practices and performing maintenance in accordance with the manufacturer recommendations. In addition, the permittee may only change those settings that are permitted by the manufacturer and do not increase the air emissions from the emergency diesel engine gen-sets.

(9VAC5-80-1180 and 9VAC5-50-260) [7/29/2026]

2. Monitoring

- a. Fuel Flow: Each emergency diesel engine gen-set (Ref. Nos. 1 through 68, T1, and T2) shall be equipped with a fuel flow device to monitor the fuel throughput (in gallons).
- b. Engine Operating Hours: Each emergency diesel engine gen-set (Ref. Nos. 1 through 68, T1, and T2) shall be equipped with a non-resettable hour metering device to monitor the operating hours .

Each monitoring device (as required in a. and b. above) shall be observed by the permittee with a frequency of not less than once each day the emergency diesel engine gen-set is operated. The permittee shall keep a log of these observations.

Each monitoring device shall be installed, maintained, calibrated (as appropriate), and operated in accordance with approved procedures which shall include, as a minimum, the manufacturer's written requirements or recommendations. The details of the monitoring device calibrations are to be arranged with the Regional Air Compliance Manager of the DEQ's Northern Regional Office (NRO).

Each monitoring device shall be provided with adequate access for inspection and shall be in operation when the engine gen-sets are operating.
(9VAC5-80-1180 D) [7/29/2026]

OPERATING LIMITATIONS

3. **Emergency Power Generation** – The emergency diesel engine gen-sets (Ref. Nos. 1 through 68, T1, and T2) shall only be operated in the following modes:
 - a. In situations that arise from sudden and reasonably unforeseeable events where the primary energy or power source is disrupted or disconnected due to conditions beyond the control of an owner or operator of a facility including:
 - i. A failure of the electrical grid;
 - ii. On-site disaster or equipment failure; or
 - iii. Public service emergencies such as flood, fire, natural disaster, or severe weather conditions.
 - b. For participation in an ISO-declared emergency, where an ISO emergency is:
 - i. An abnormal system condition requiring manual or automatic action to maintain system frequency, to prevent loss of firm load, equipment damage, or tripping of

system elements that could adversely affect the reliability of an electric system or the safety of persons or property;

- ii. Capacity deficiency or capacity excess conditions;
 - iii. A fuel shortage requiring departure from normal operating procedures in order to minimize the use of such scarce fuel;
 - iv. Abnormal natural events or man-made threats that would require conservative operations to posture the system in a more reliable state; or
 - v. An abnormal event external to the ISO service territory that may require ISO action.
- c. For scheduled maintenance checks and readiness testing (Scheduled MCRT).
 - d. For unscheduled maintenance, performance testing, and operator training.
 - e. For the integration operational period, which is the period of time beginning with the first time the affected units is started on-site and ending when the affected unit is fully integrated with the sources electrical system.

(9VAC5-80-1180) [7/29/2026]

- 4. **Operation of the Engine Gen-Sets** – The permittee shall operate and maintain each emergency diesel engine gen-set (Ref. Nos. 1 through 68, T1, and T2) and control device according to the manufacturer’s written instructions or procedures developed by the permittee that are approved by the engine manufacturer. In addition, the permittee may only change those settings that are permitted by the manufacturer and do not increase air emissions.

(9VAC5-80-1180) [7/29/2026]

- 5. **Operating Limitations (Ozone Season)** – No emergency diesel engine gen-set (Ref. Nos. 1 through 68, T1, and T2) shall be operated for scheduled maintenance checks and readiness testing (Scheduled MCRT), performance testing, or operator training (that involves fuel combustion) between the hours of 7 a.m. to 5 p.m. any day during May 1 through September 30. The permittee may petition the Regional Air Compliance Manager of DEQ’s Northern Regional Office (NRO) for exceptions to this requirement, with approvals made on a case-by-case basis.

(9VAC5-80-1180) [7/29/2026]

6. **Operating Limitations (Ozone Season) – Integration Operational Period** – During the integration operational period of each emergency diesel engine gen-set (Ref. Nos. 1 through 68, T1, and T2), any operation of the unit (that involves fuel combustion) between the hours of 7 a.m. to 5 p.m. any day during the ozone season of May 1 through September 30 shall only occur if the forecast Air Quality index (AQI) for ozone as published on the AirNow website (<https://airnow.gov>) for Northern Virginia for that day is less than or equal to 100. In the event that AirNow-EnviroFlash (www.enviroflash.info) issues an Air Alert for Northern Virginia for a day which the forecasted AQI for ozone was less than or equal to 100, operation of each unit (which involves fuel combustion) shall be minimized to the maximum extent practical.

The IOP is defined as the period of time beginning with the first time the affected unit is started on-site and ending when the affected unit is fully integrated with the source's electrical system.

(9VAC5-80-1180) [7/29/2026]

7. **Operating Hours** – Each individual emergency diesel engine gen-set (Ref. Nos. 1 through 67, T1, and T2) shall not operate more than 32 hours per year for scheduled maintenance checks and readiness testing (Scheduled MCRT, as provided in Condition 3.c).

The individual emergency diesel engine gen-set (Ref. No. 68) shall not operate more than 35 hours per year for scheduled maintenance checks and readiness testing (Scheduled MCRT, as provided in Condition 3.c).

Each individual emergency diesel engine gen-set (Ref. Nos. 1 through 68, T1, and T2) shall not operate more than 500 hours per year for all purposes (as provided in Condition 3) combined.

The annual limits for hours of operation shall be calculated monthly as the sum of each consecutive 12-month period. Compliance for the consecutive 12-month period shall be demonstrated monthly by adding the total for the most recently completed calendar month to the individual monthly totals for the preceding 11 months.

(9VAC5-80-1180) [7/29/2026]

8. **Fuel Specification** – The approved fuel for the emergency diesel engine gen-sets (Ref. Nos. 1 through 68, T1, and T2) is ultra-low sulfur diesel fuel oil, and shall meet the specifications below:

ULTRA LOW SULFUR DIESEL FUEL OIL:

- a. Does not exceed the American Society for Testing and Materials (ASTM) specification, D975, for grade ultra-low sulfur 1-D S15 or grade 2-D S15, or
- b. Has a maximum sulfur content not to exceed 0.0015% by weight (15 ppm), and either a minimum cetane number of 40 or maximum aromatic content of 35 volume percent.

Exceedance of these specifications may be considered credible evidence of an exceedance of emission limits. A change in the fuel type or the fuel sulfur content may require a permit to modify and operate.

(9VAC5-80-1180) [7/29/2026]

9. **Fuel Certification** – The permittee shall obtain a certification from the fuel supplier with each shipment of diesel fuel. Each fuel supplier certification shall include the following:
 - a. The name of the fuel supplier;
 - b. The date on which the diesel fuel was received;
 - c. The quantity of diesel fuel delivered in the shipment; and
 - d. A statement that the diesel fuel:
 - i. complies with the ASTM specifications for Grade No. 1-D S15 or Grade No. 2-D S15 (also known as ultra-low sulfur diesel (ULSD)); or
 - ii. has a sulfur content per shipment not to exceed 0.0015% by weight (15 ppm) and either a minimum cetane number of forty or maximum aromatic content of thirty-five percent by volume.

Alternatively, the permittee must obtain approval from DEQ's NRO's Regional Air Compliance Manager, if other documentation will be used to certify the diesel fuel type.

Fuel sampling and analysis, independent of that used for certification, as may be periodically required or conducted by DEQ may be used to determine compliance with the fuel specifications stipulated in Condition 8. Exceedance of these specifications may be considered credible evidence of the exceedance of emission limits.

(9VAC5-80-1180) [7/29/2026]

10. **Diesel Fuel Throughput Limit (Stationary Units)** – The emergency diesel engine gensets (Ref. Nos. 1 through 68) combined shall consume no more than 669,094 gallons of diesel fuel oil per year, calculated daily as the sum of each consecutive 365-day period (all uses). Compliance for the consecutive 365-day period shall be demonstrated daily by adding the total for the most recently completed calendar day to the individual daily totals for the preceding 364 days.
(9VAC5-80-1180) [7/29/2026]
11. **Diesel Fuel Throughput Limit (Transitory Units)** – The emergency diesel engine gensets (Ref. Nos. T1 and T2) combined shall consume no more than 20,460 gallons of diesel fuel oil per year, calculated daily as the sum of each consecutive 365-day period (all uses).

Compliance for the consecutive 365-day period shall be demonstrated daily by adding the total for the most recently completed calendar day to the individual daily totals for the preceding 364 days.
(9VAC5-80-1180) [9/9/2022]

EMISSION LIMITS

12. **Emission Limits (Hourly)** – Emissions from the operation of each emergency diesel engine gen-set (Ref. Nos. 1 through 68, T1, and T2) shall not exceed the limits specified below:

Pollutant	Cummins 2,500 ekW (Ref. Nos. 1 – 22)	MTU 2,500 ekW (Ref. Nos. 23 – 62)	Cummins 750 ekW (Ref. Nos. 63 & 64)
Nitrogen Oxides (NO _x as NO ₂)	47.91 lbs/hr	47.77 lbs/hr	12.18 lbs/hr
Carbon Monoxide (CO)	6.56 lbs/hr	9.81 lbs/hr	2.18 lbs/hr
Volatile Organic Compounds (VOC)	0.72 lbs/hr	1.70 lbs/hr	0.36 lbs/hr
Particulate Matter (PM)	0.80 lbs/hr	0.68 lbs/hr	0.61 lbs/hr
Particulate Matter (PM ₁₀)	0.80 lbs/hr	0.68 lbs/hr	0.61 lbs/hr
Particulate Matter (PM _{2.5})	0.80 lbs/hr	0.68 lbs/hr	0.61 lbs/hr

Pollutant	MTU 600 ekW (Ref. Nos. 65 – 67)	Caterpillar 600 ekW (Ref. No. 68)	Caterpillar 2,000 ekW (Ref. Nos. T1 & T2)
Nitrogen Oxides (NO _x as NO ₂)	11.53 lbs/hr	9.58 lbs/hr	38.85 lbs/hr
Carbon Monoxide (CO)	1.04 lbs/hr	1.59 lbs/hr	3.95 lbs/hr
Volatile Organic Compounds (VOC)	0.42 lbs/hr	0.32 lbs/hr	1.14 lbs/hr
Particulate Matter (PM)	0.19 lbs/hr	0.11 lbs/hr	0.57 lbs/hr
Particulate Matter (PM ₁₀)	0.19 lbs/hr	0.11 lbs/hr	0.57 lbs/hr
Particulate Matter (PM _{2.5})	0.19 lbs/hr	0.11 lbs/hr	0.57 lbs/hr

(9VAC5-80-1180 and 9VAC5-50-260) [7/29/2026]

13. **Emission Limits (Annual)** – Emissions from the operation of the emergency diesel engine gen-sets (Ref. Nos. 1 through 68, T1, and T2) shall not exceed the limits specified below:

Pollutant	(Ref. Nos. 1 through 68)	(Ref. Nos. T1 and T2)	(Ref. Nos. 1 through 68, T1, and T2)
Nitrogen Oxides (NO _x as NO ₂)	91.26 tpy	2.88 tpy	94.14 tpy
Carbon Monoxide (CO)	35.24 tpy	1.53 tpy	36.77 tpy
Volatile Organic Compounds (VOC)	9.47 tpy	0.38 tpy	9.85 tpy
Particulate Matter (PM)	3.21 tpy	0.17 tpy	3.38 tpy
Particulate Matter (PM ₁₀)	3.21 tpy	0.17 tpy	3.38 tpy
Particulate Matter (PM _{2.5})	3.21 tpy	0.17 tpy	3.38 tpy

These emissions are derived from the estimated overall emission contribution from operating limits. Exceedance of the operating limits may be considered credible evidence of the exceedance of emission limits. Compliance with the annual emission limits may be determined as stated in Conditions 1, 10, 11 and 12.
(9VAC5-80-1180) [7/29/2026]

14. **Visible Emission Limit** – Visible emissions from each emergency diesel engine gen-set (Ref. Nos. 1 through 68, T1, and T2) exhausts shall not exceed 5% opacity except during one 6-minute period in any one hour in which visible emissions shall not exceed 10% opacity as determined by EPA Method 9 (reference 40 CFR 60, Appendix A). This condition applies at all times except during startup and shutdown.

During startup and shutdown, visible emissions from each emergency diesel engine gen-set shall not exceed 10% opacity except during one 6-minute period in any one hour in which visible emissions shall not exceed 20% opacity as determined by EPA Method 9 (reference 40 CFR 60, Appendix A).
(9VAC5-80-1180 and 9VAC5-50-260) [7/29/2026]

CONTINUING COMPLIANCE DETERMINATION

15. **Facility Construction** – The emergency diesel engine gen-sets (Ref. Nos. 1 through 68, T1, and T2) shall be constructed so as to allow for emissions testing upon reasonable notice at any times, using appropriate methods. This includes constructing the facility/equipment such that volumetric flow rates and pollutant emission rates can be determined by applicable test methods and providing a stack or duct that is free from cyclonic flow. Sampling ports shall be provided when requested at the appropriate locations and safe sampling platforms and access shall be provided.
(9VAC5-50-30 F and 9VAC5-80-1180) [7/29/2026]

16. **Emission Testing/Visible Emissions Evaluation** – Upon request by the DEQ, the permittee shall conduct stack tests and/or VEEs of the emergency diesel engine gen-sets (Ref. Nos. 1 through 68, T1, and T2) to demonstrate compliance with the emission limits contained in this permit. The details of the tests shall be arranged with the Regional Air Compliance Manager of the DEQ’s NRO.
(9VAC5-80-1200 and 9VAC5-50-30 G) [7/29/2026]

RECORDS

17. **On Site Records** – The permittee shall maintain records of emission data and operating parameters as necessary to demonstrate compliance with this permit. The content and format of such records shall be arranged with the Regional Air Compliance Manager of the DEQ’s NRO. These records shall include, but are not limited to:
- a. Documentation from the manufacturer that each emergency diesel engine gen-set (Ref. Nos. 1 through 68, T1, and T2) is certified to meet the EPA Tier 2 emission standards.
 - b. Engine information including make, model, serial number, model year, maximum engine power (bhp), and engine displacement for each emergency diesel engine gen-set (Ref. Nos. 1 through 68, T1, and T2).
 - c. A log of monitoring device observations as required by Condition 2.
 - d. The manufacturer’s written operating instructions or procedures developed by the owner/operator that are approved by the engine manufacturer for each emergency diesel engine gen-set (Ref. Nos. 1 through 68, T1, and T2).
 - e. Monthly and annual hours of operation of each emergency diesel engine gen-set (Ref. Nos. 1 through 68, T1, and T2), with annual hours of operation calculated monthly as the sum of each consecutive 12-month period.
 - f. Monthly and annual hours of operation of each emergency diesel engine gen-set (Ref. Nos. 1 through 68, T1, and T2), for purposes of scheduled maintenance check and readiness testing (Scheduled MCRT), calculated monthly as the sum of each consecutive 12-month period.
 - g. All fuel supplier certifications to verify compliance with Condition 9.
 - h. Daily and annual fuel consumption of each emergency diesel engine gen-set (Ref. Nos. 1 through 68, T1, and T2), for all purposes, with the annual fuel consumption calculated daily as the sum of each consecutive 365-day period.
 - i. Daily and annual fuel consumption for the combined operation of the emergency diesel engine gen-sets (Ref. Nos. 1 through 68), calculated daily as the sum of each

consecutive 365-day period, to verify compliance with the fuel throughput limitations specified in Condition 10.

- j. Daily and annual fuel consumption for the combined operation of the transitory emergency diesel engine gen-sets (Ref. Nos. T1 and T2), calculated daily as the sum of each consecutive 365-day period, to verify compliance with the fuel throughput limitations specified in Condition 10.
- k. Daily and annual emissions calculations for NO_x (as NO₂), CO, VOC, PM, PM₁₀, and PM_{2.5} from the emergency diesel engine gen-sets (Ref. Nos. 1 through 68), with annual emissions, calculated daily, as the sum of each consecutive 365-day period, to verify compliance with the annual emission limits in Condition 13.
- l. Daily and annual emissions calculations for NO_x (as NO₂), CO, VOC, PM, PM₁₀, and PM_{2.5} from the emergency diesel engine gen-sets (Ref. Nos. T1 and T2), with annual emissions, calculated daily, as the sum of each consecutive 365-day period, to verify compliance with the annual emission limits in Condition 13.
- m. Daily and annual emissions calculations for NO_x (as NO₂), CO, VOC, PM, PM₁₀, and PM_{2.5} from the emergency diesel engine gen-sets (Ref. Nos. 1 through 68, T1, and T2), with annual emissions, calculated daily, as the sum of each consecutive 365-day period, to verify compliance with the annual emission limits in Condition 13.
- n. Results of all stack tests and VEEs.
- o. Records of scheduled maintenance checks and readiness testing (Scheduled MCRT).
- p. Records of unscheduled maintenance and operator training.
- q. Records as required by Condition 24.
- r. Records of changes in settings that are permitted by the manufacturer of the emergency diesel engine gen-sets (Ref. Nos. 1 through 68, T1, and T2).
- s. Records of the reasons for operation for each emergency diesel engine gen-set (Ref. Nos. 1 through 68, T1, and T2), including, but not limited to, the date, cause of operation, cause of the emergency, the ISO-declared emergency notification, and the hours of operation.
- t. Records, as necessary, to demonstrate compliance with the operating limitations of Condition 5; which includes but is not limited to: times, dates and reasons for operation of each diesel engine gen-set that was operating between May 1 and September 30.

- u. To verify compliance with Condition 6, maintain records for the emergency diesel engine gen-sets (Ref. Nos. 1 through 68, T1, and T2) of:
 - i. The forecasted AQI, as determined by the AirNow website for Northern Virginia, for ozone for the days that an emergency diesel engine gen-set operated during the integration operational period;
 - ii. The measured AQI, as determined by the AirNow website for Northern Virginia, for ozone for the days that an emergency diesel engine gen-set operated during the integration operational period;
 - iii. Documentation recording any Air Alerts issued for that operating day, as determined by Airnow-EnviroFlash; and
 - iv. Details of commissioning activities, to include, but not limited to, clock hours, and duration.

Compliance for the consecutive 12-month period in the subsections above (as applicable) shall be demonstrated monthly by adding the total for the most recently completed month to the individual monthly totals for the preceding 11 months.

Compliance for the consecutive 365-day period in the subsections above (as applicable) shall be demonstrated daily by adding the total for the most recently completed day to the individual daily totals for the preceding 364 days.

These records shall be available for inspection by the DEQ and shall be current for the most recent five years.

(9VAC5-80-1180 and 9VAC5-50-50) [7/29/2026]

NOTIFICATIONS

18. **Initial Notifications** – The permittee shall furnish written notification of the items below to the Regional Air Compliance Manager of the DEQ’s NRO at the following address:

Regional Air Compliance Manager
Department of Environmental Quality
13901 Crown Court
Woodbridge, VA 22193

The permittee shall submit notification(s) for each building containing the information as described below:

- a. The actual date on which installation of the emergency diesel engine gen-sets (Ref. Nos. 1 through 68) commenced in each building, within 30 days after such date. The notification must contain the following:

- i. Name and address of the permittee;
 - ii. The building;
 - iii. Unit reference number of the initial unit installed; and
 - iv. The date installation commenced.
- b. The start and end dates of the integration operational period for each emergency diesel engine gen-set (Ref. Nos. 1 through 68) within 15 days after the last generator at each building completes its integration operational period. If a period of construction is paused or halted for ≥ 45 days, this notification shall be provided to the DEQ within 15 days after completion of the integration operational period for the most recently installed engine gen-set. The notification must contain the following:
- i. Unit reference number;
 - ii. Engine information including make, model, engine family, serial number, model year, maximum engine power, engine displacement, fuel used;
 - iii. Installation date; and
 - iv. Integration operational period start and end dates.

For the purpose of this notification, the integration operational period is defined as the period of time beginning with the first time the affected unit is started on-site and ending when the affected unit is fully integrated with the source's electrical system.
(9VAC5-50-20) [7/29/2026]

SPECIAL CONDITIONS - TRANSITORY ENGINE-GENERATOR SETS

19. **Operation of the Transitory Engine Gen-Sets** – The facility shall only operate the transitory emergency diesel engine gen-sets (Ref. Nos. T1 and T2) in support of the facility such as serving as back up during construction, commissioning, and maintenance of engine gen-sets (Ref. Nos. 1 through 68).
(9VAC5-80-1180) [7/29/2026]
20. **Notifications** – The permittee shall furnish the following written notifications to the Regional Air Compliance Manager of the DEQ's NRO (see address in Condition 18) of:
- a. The actual date and reason for each occurrence that each transitory emergency diesel engine gen-set (Ref. Nos. T1 and T2) was placed into service within 15 days after such date. The notification must include the following:

- i. Name and address of the permittee;
 - ii. The address of the affected source;
 - iii. Engine information including make, model, engine family, serial number, model year, maximum engine power and engine displacement;
 - iv. Fuel used; and
 - v. Hours operated.
- b. The actual date of the removal of each transitory emergency diesel engine gen-set (Ref. Nos. T1 and T2) within 15 days after such date.

(9VAC5-80-1180) [9/9/2022]

GENERAL CONDITIONS

21. **Permit Invalidation** – This permit to construct the stationary emergency diesel engine gen-sets (Ref. Nos. 1 through 68) shall become invalid, unless an extension is granted by the DEQ, if:

- a. A program of continuous construction is not commenced within 18 months from the ‘Original Permit Date’ specified in the equipment list in the Introduction section of this permit; or if
- b. A program of construction is discontinued for a period of 18 months or more, or is not completed within a reasonable time.

(9VAC5-80-1210)

22. **Permit Suspension/Revocation** – This permit may be suspended or revoked if the permittee:

- a. Knowingly makes material misstatements in the permit application or any amendments to it;
- b. Fails to comply with the conditions of this permit;
- c. Fails to comply with any emission standards applicable to a permitted emissions unit;
- d. Causes emissions from the stationary source which result in violations of, or interfere with the attainment and maintenance of, any ambient air quality standard; or

- e. Fails to operate in conformance with any applicable control strategy, including any emission standards or emissions limitations, in the State Implementation Plan in effect at the time an application for this permit is submitted.

(9VAC5-80-1210 G)

23. **Right of Entry** – The permittee shall allow authorized local, state, and federal representatives, upon the presentation of credentials:

- a. To enter upon the permittee's premises on which the facility is located or in which any records are required to be kept under the terms and conditions of this permit;
- b. To have access to and copy at reasonable times any records required to be kept under the terms and conditions of this permit or the State Air Pollution Control Board Regulations;
- c. To inspect at reasonable times any facility, equipment, or process subject to the terms and conditions of this permit or the State Air Pollution Control Board Regulations;
and
- d. To sample or test at reasonable times.

For purposes of this condition, the time for inspection shall be deemed reasonable during regular business hours or whenever the facility is in operation. Nothing contained herein shall make an inspection time unreasonable during an emergency.

(9VAC5-170-130 and 9VAC5-80-1180)

24. **Maintenance/Operating Procedures** – At all times, including periods of start-up, shutdown, soot blowing, and malfunction, the permittee shall, to the extent practicable, maintain and operate the affected source, including associated air pollution control equipment, in a manner consistent with good air pollution control practices for minimizing emissions.

The permittee shall take the following measures in order to minimize the duration and frequency of excess emissions:

- a. Develop a maintenance schedule and maintain records of all scheduled and non-scheduled maintenance.
- b. Maintain an inventory of spare parts.
- c. Have available written operating procedures for equipment. These procedures shall be based on the manufacturer's recommendations, at a minimum.

- d. Train operators in the proper operation of all such equipment and familiarize the operators with the written operating procedures, prior to their first operation of such equipment. The permittee shall maintain records of the training provided including the names of trainees, the date of training and the nature of the training.

Records of maintenance and training shall be maintained on site for a period of five years and shall be made available to DEQ personnel upon request.
(9VAC5-50-20 E and 9VAC5-80-1180 D)

25. **Record of Malfunctions** – The permittee shall maintain records of the occurrence and duration of any bypass, malfunction, shutdown or failure of the facility or its associated air pollution control equipment that results in excess emissions for more than one hour. Records shall include the date, time, duration, description (emission unit, pollutant affected, cause of malfunction), corrective action, preventive measures taken and name of person generating the record.
(9VAC5-20-180 J and 9VAC5-80-1180 D)
26. **Notification for Facility or Control Equipment Malfunction** – The permittee shall furnish notification to the Regional Air Compliance Manager of the DEQ's NRO of malfunctions of the affected facility or related air pollution control equipment that may cause excess emissions for more than one hour. Such notification shall be made no later than four daytime business hours after the malfunction is discovered. The permittee shall provide a written statement giving all pertinent facts, including the estimated duration of the breakdown, within 14 days of discovery of the malfunction. When the condition causing the failure or malfunction has been corrected and the equipment is again in operation, the permittee shall notify the Regional Air Compliance Manager of the DEQ's NRO.
(9VAC5-20-180 C and 9VAC5-80-1180)
27. **Violation of Ambient Air Quality Standard** – The permittee shall, upon request of the DEQ, reduce the level of operation or shut down a facility, as necessary to avoid violating any primary ambient air quality standard and shall not return to normal operation until such time as the ambient air quality standard will not be violated.
(9VAC5-20-180 I and 9VAC5-80-1180)
28. **Change of Ownership** – In the case of a transfer of ownership of a stationary source, the new owner shall abide by any current minor NSR permit issued to the previous owner. The new owner shall notify the NRO of the change of ownership within 30 days of the transfer.
(9VAC5-80-1240)
29. **Permit Copy** – The permittee shall keep a copy of this permit on the premises of the facility to which it applies.
(9VAC5-80-1180)