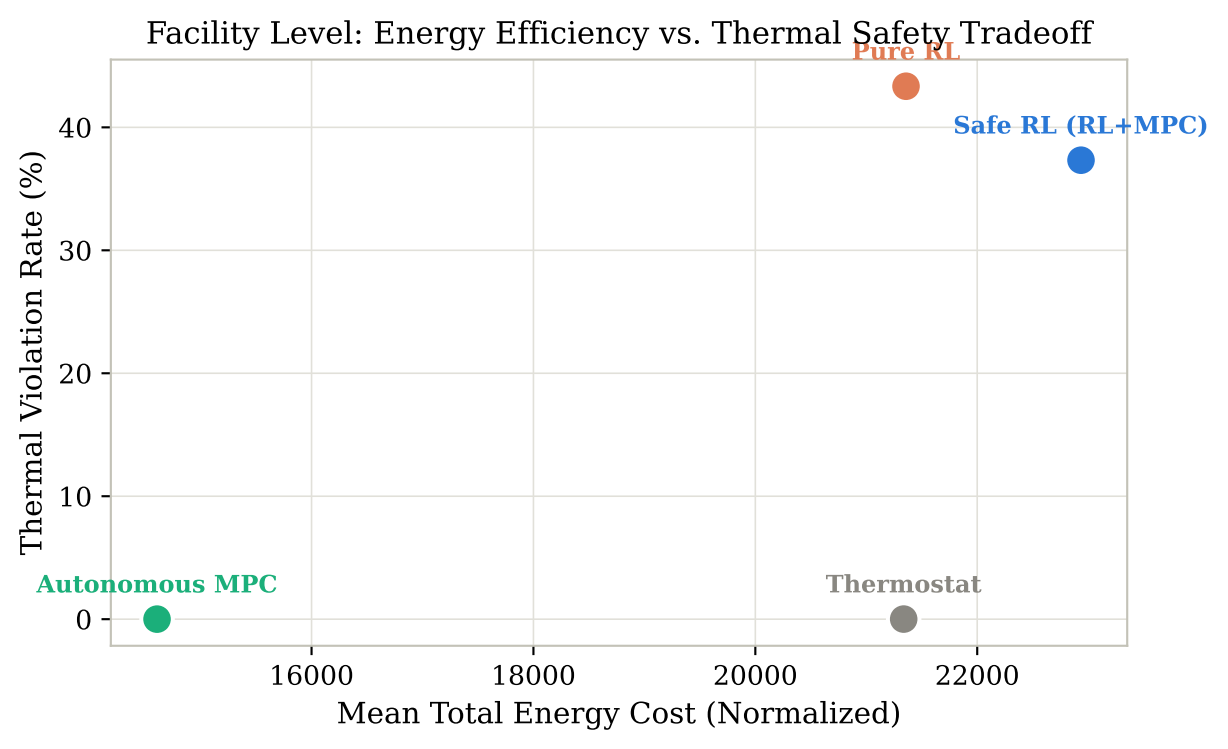
Facility Level: Energy Efficiency vs. Thermal Safety Tradeoff
Pure RL
Safe RL (RL+MPC)
Autonomous MPC
Thermostat
Thermal Violation Rate (%)
0
10
20
30
40
16000
18000
20000
22000
Mean Total Energy Cost (Normalized)