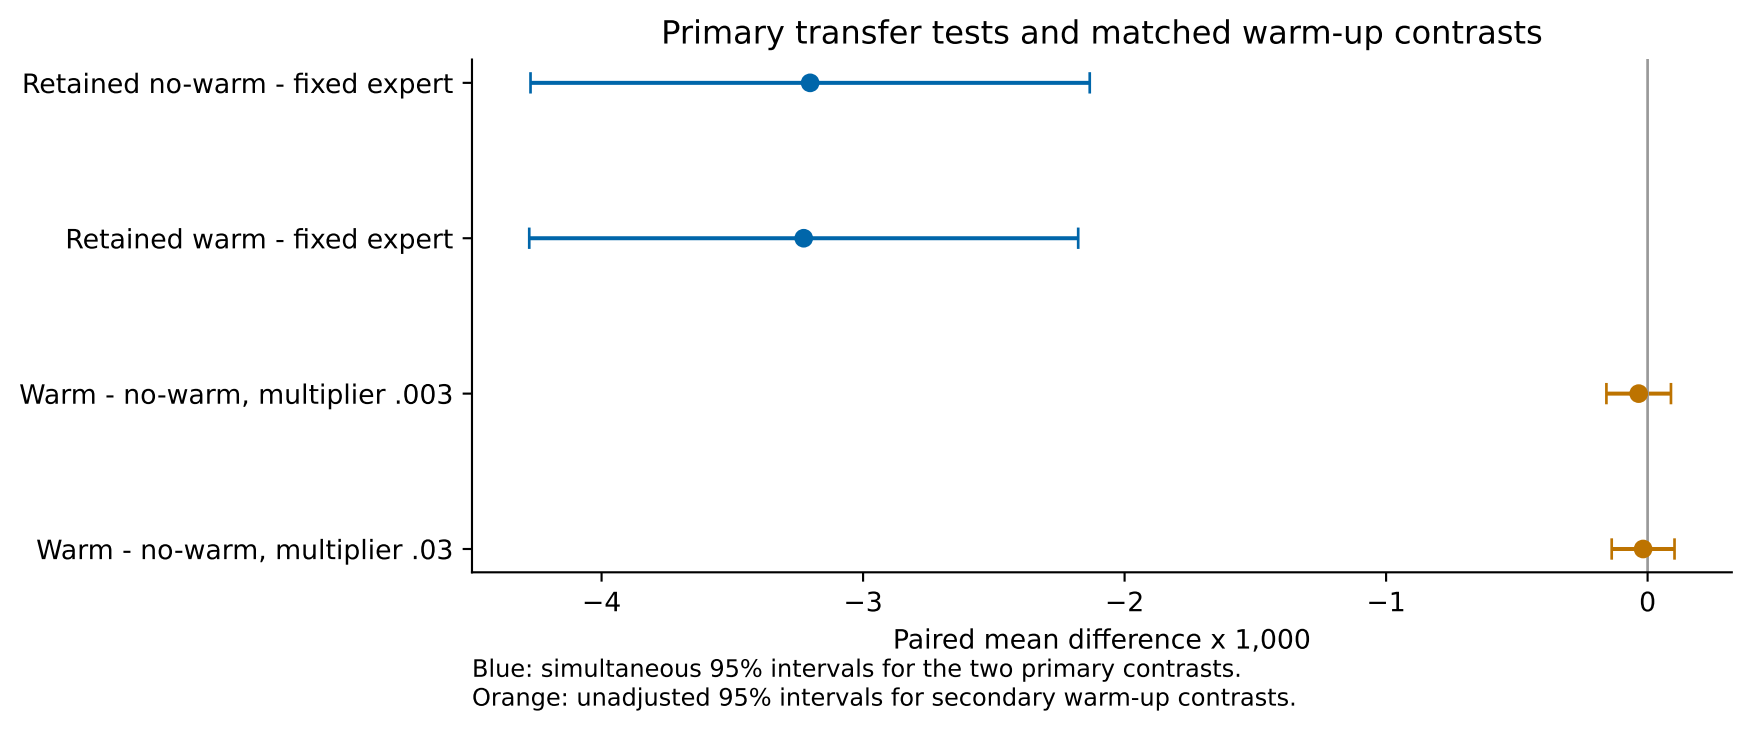
Primary transfer tests and matched warm-up contrasts
Retained no-warm - fixed expert
Retained warm - fixed expert
Warm - no-warm, multiplier .003
Warm - no-warm, multiplier .03
−4
−3
−2
−1
0
Paired mean difference x 1,000
Blue: simultaneous 95% intervals for the two primary contrasts.
Orange: unadjusted 95% intervals for secondary warm-up contrasts.