


G:\Shared drives\projects\22\151\215101\215101A2_1lines.dwg

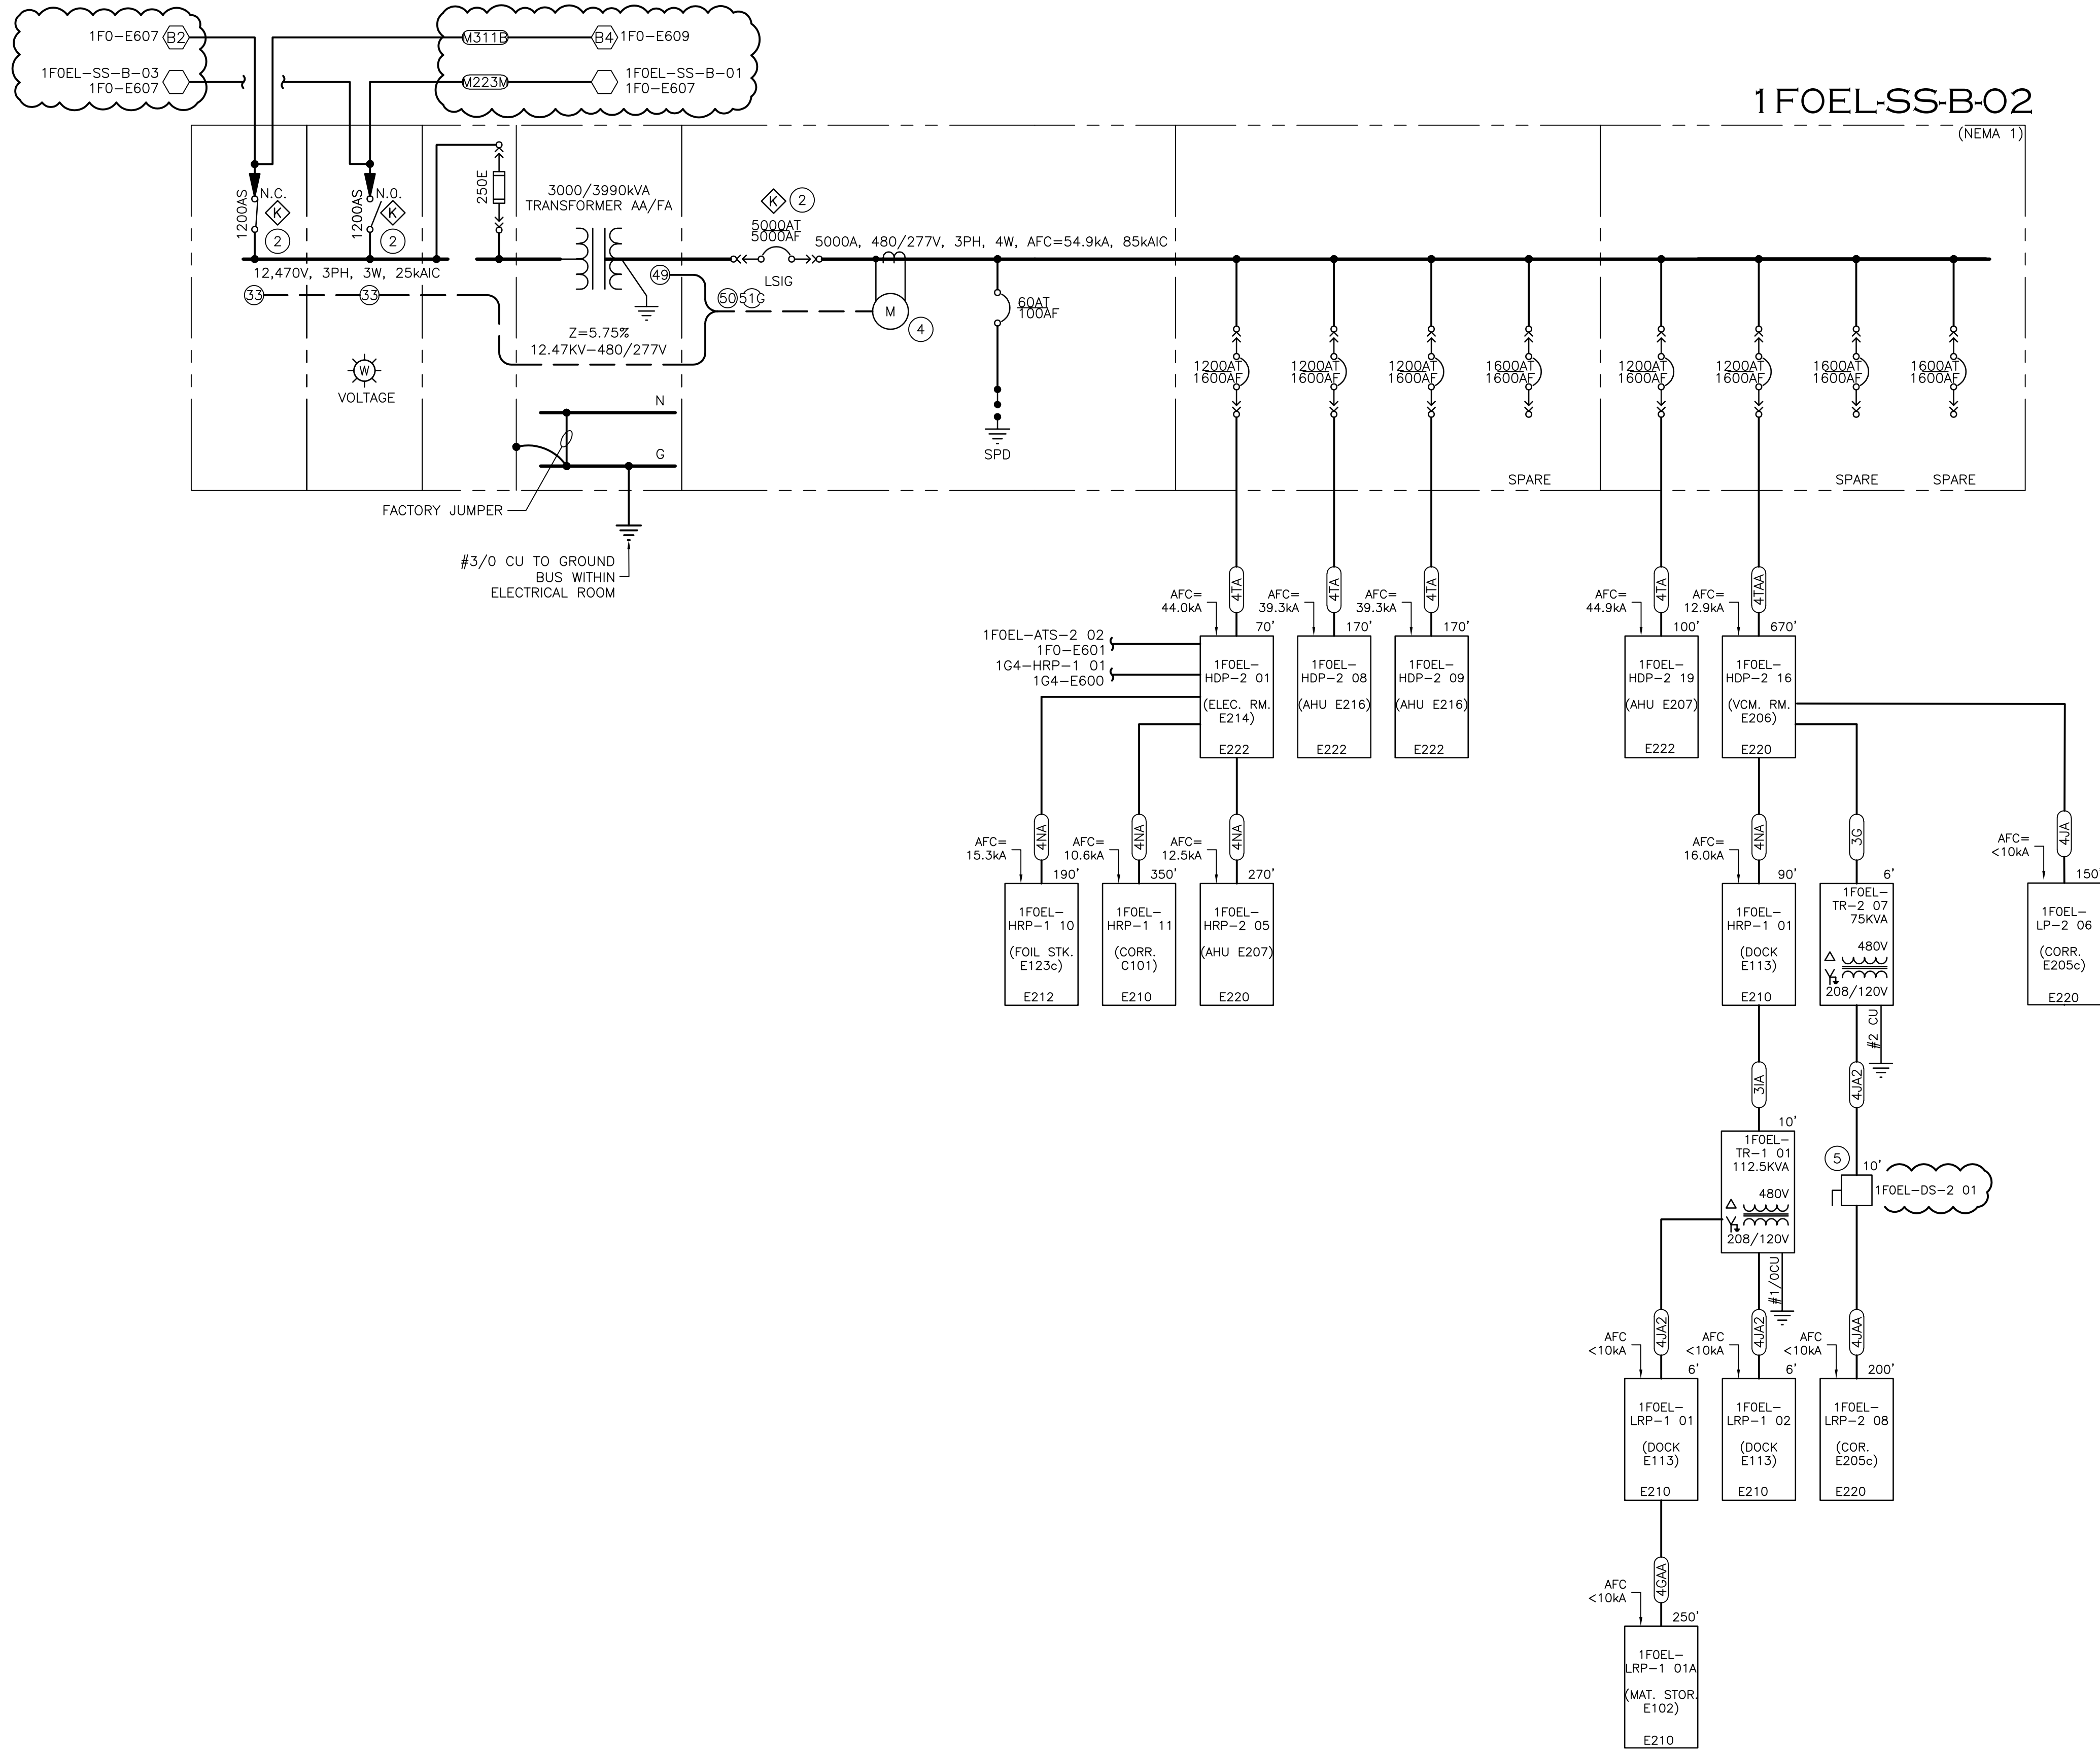

① ONE LINE DIAGRAM - (1FO) ELECTRODE "B" (PARTIAL)
NO SCALE

INCOMING	INCOMING	TRANSITION	TRANSFORMER	TRANSITION	MAIN CIRCUIT BREAKER	ACB	ACB
						ACB	ACB
						ACB	ACB
						ACB	ACB

② EQUIPMENT ELEVATION
NO SCALE

GENERAL NOTES

- REFERENCE FEEDER SCHEDULE, E011
- CABLE LENGTHS WHEN INDICATED ON ONE-LINE ARE APPROXIMATE, AND ARE FOR REFERENCE ONLY FOR CALCULATIONS AND ARE NOT TO BE USED FOR MATERIAL TAKEOFFS.
- SECONDARY UNIT SUBSTATIONS: REFER TO SPECIFICATION #26 11 16 12.
- UNIT SUBSTATION SCADA COMMUNICATIONS SHALL INCLUDE ALL HARDWARE DEVICES TO COMMUNICATE I/O (VIA MODBUS TCP COMMUNICATIONS) INCLUDING, BUT NOT LIMITED TO, THE FOLLOWING:
 - PRIMARY SWITCH STATUS (OPEN/CLOSED)
 - TRANSFORMER WINDING TEMPERATURE
 - TRANSFORMER FAN RUN STATUS
 - BREAKER STATUS
 - POWER METER DATA
- ALL SWITCHBOARDS, SWITCHGEAR, AND PANELBOARDS SUPPLIED BY FEEDERS SHALL BE PERMANENTLY MARKED TO INDICATE EACH DEVICE OR EQUIPMENT WHERE THE POWER ORIGINATES. THE LABEL SHALL BE PERMANENTLY AFFIXED, OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED, AND NOT HANDWRITTEN.

KEYED NOTES

- NOT USED.
- PRIOR TO CLOSING A SWITCH, THE OTHER SWITCH MUST BE OPENED USING KIRK KEY INTERLOCK TO PREVENT CONNECTION OF MULTIPLE SOURCES. REFER TO SEQUENCE OF OPERATIONS BY MANUFACTURER IN EQUIPMENT SUBMITTAL.
- NOT USED.
- SQUARE D/ SCHNEIDER ION 9000 WITH RS-485 COMMUNICATIONS.
- FOR TRANSFORMER TAPS OVER 10' PROVIDE AND INSTALL CIRCUIT BREAKER DISCONNECT (200A/3P/N1/10kA) WITHIN 10' OF TRANSFORMER SECONDARY.

ELECTRICAL ONE LINE DIAGRAM



DATE	REVISIONS	REMARKS
06/25/2024	1FO - 2170 REVISIONS	
06/25/2024	PERMIT RESUBMISSION B25-140	
10/12/2024	1FO CD PROGRESS SET (MEP ONLY)	
11/07/2024	1FO CD PROGRESS SET (MEP ONLY)	
11/07/2024	1FO CD PROGRESS SET (MEP ONLY)	
02/11/2025	1FO CD REVISIONS	
03/11/2025	1FO CD REVISIONS	

PA/PM:	WB
DRAWN BY:	ETS/AO/AUG
JOB NO.:	PHX21-5038-00

SHEET
1F0-E608

PLOT DATE: 03/11/2025

PROJECT ALPHA
1F0 - MAIN MANUFACTURING BUILDING
EAST PECOS ROAD
QUEEN CREEK, ARIZONA 85140

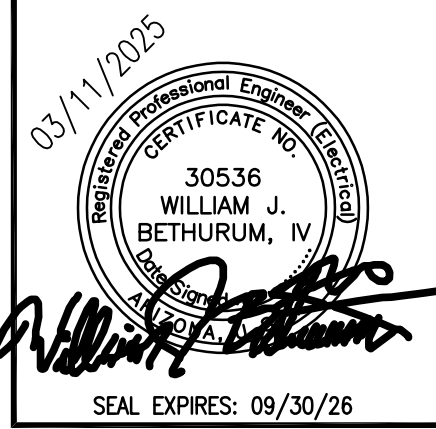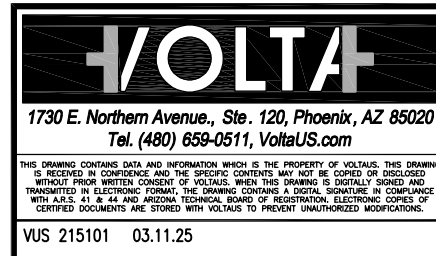

WARE MALCOMB
ARCHITECTURE CIVIL ENGINEERING
PLANNING BRANDING
INTERIORS BUILDING MEASUREMENT

2777 E Camelback Rd. Suite #205
Phoenix, AZ 85016
P 480.907.2288

CAUTION: IF THIS SHEET IS NOT 30"x42" IT IS A REDUCED PRINT