


GENERAL NOTES

- A. REFERENCE FEEDER SCHEDULE, E011
- B. CABLE LENGTHS WHEN INDICATED ON ONE-LINE ARE APPROXIMATE AND ARE FOR REFERENCE ONLY FOR CALCULATIONS AND ARE NOT TO BE USED FOR MATERIAL TAKEOFFS.
- C. SECONDARY UNIT SUBSTATIONS: REFER TO SPECIFICATION #26 11 16 12.
- D. UNIT SUBSTATION SCADA COMMUNICATIONS SHALL INCLUDE ALL HARDWARE DEVICES TO COMMUNICATE I/O (VIA MODBUS TCP COMMUNICATIONS) INCLUDING, BUT NOT LIMITED TO, THE FOLLOWING:
- PRIMARY SWITCH STATUS (OPEN/CLOSED)
 - TRANSFORMER WINDING TEMPERATURE
 - TRANSFORMER FAN RUN STATUS
 - BREAKER STATUS
 - POWER METER DATA
- E. ALL SWITCHBOARDS, SWITCHGEAR, AND PANELBOARDS SUPPLIED BY FEEDERS SHALL BE PERMANENTLY MARKED TO INDICATE EACH DEVICE OR EQUIPMENT WHERE THE POWER ORIGINATES. THE LABEL SHALL BE PERMANENTLY AFFIXED, OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED, AND NOT HANDWRITTEN.

KEYED NOTES

1. NOT USED.
2. PRIOR TO CLOSING A SWITCH, THE OTHER SWITCH MUST BE OPENED USING KIRK KEY INTERLOCK TO PREVENT CONNECTION OF MULTIPLE SOURCES. REFER TO SEQUENCE OF OPERATIONS BY MANUFACTURER IN EQUIPMENT SUBMITTAL.
3. NOT USED
4. SQUARE D/ SCHNEIDER ION 9000 WITH RS-485 COMMUNICATIONS.
5. ENGINEERED CABLE BUS ASSEMBLY, CONDUIT, OR CABLE TRAY TO BUS DUCT CABLE TAP BOX.

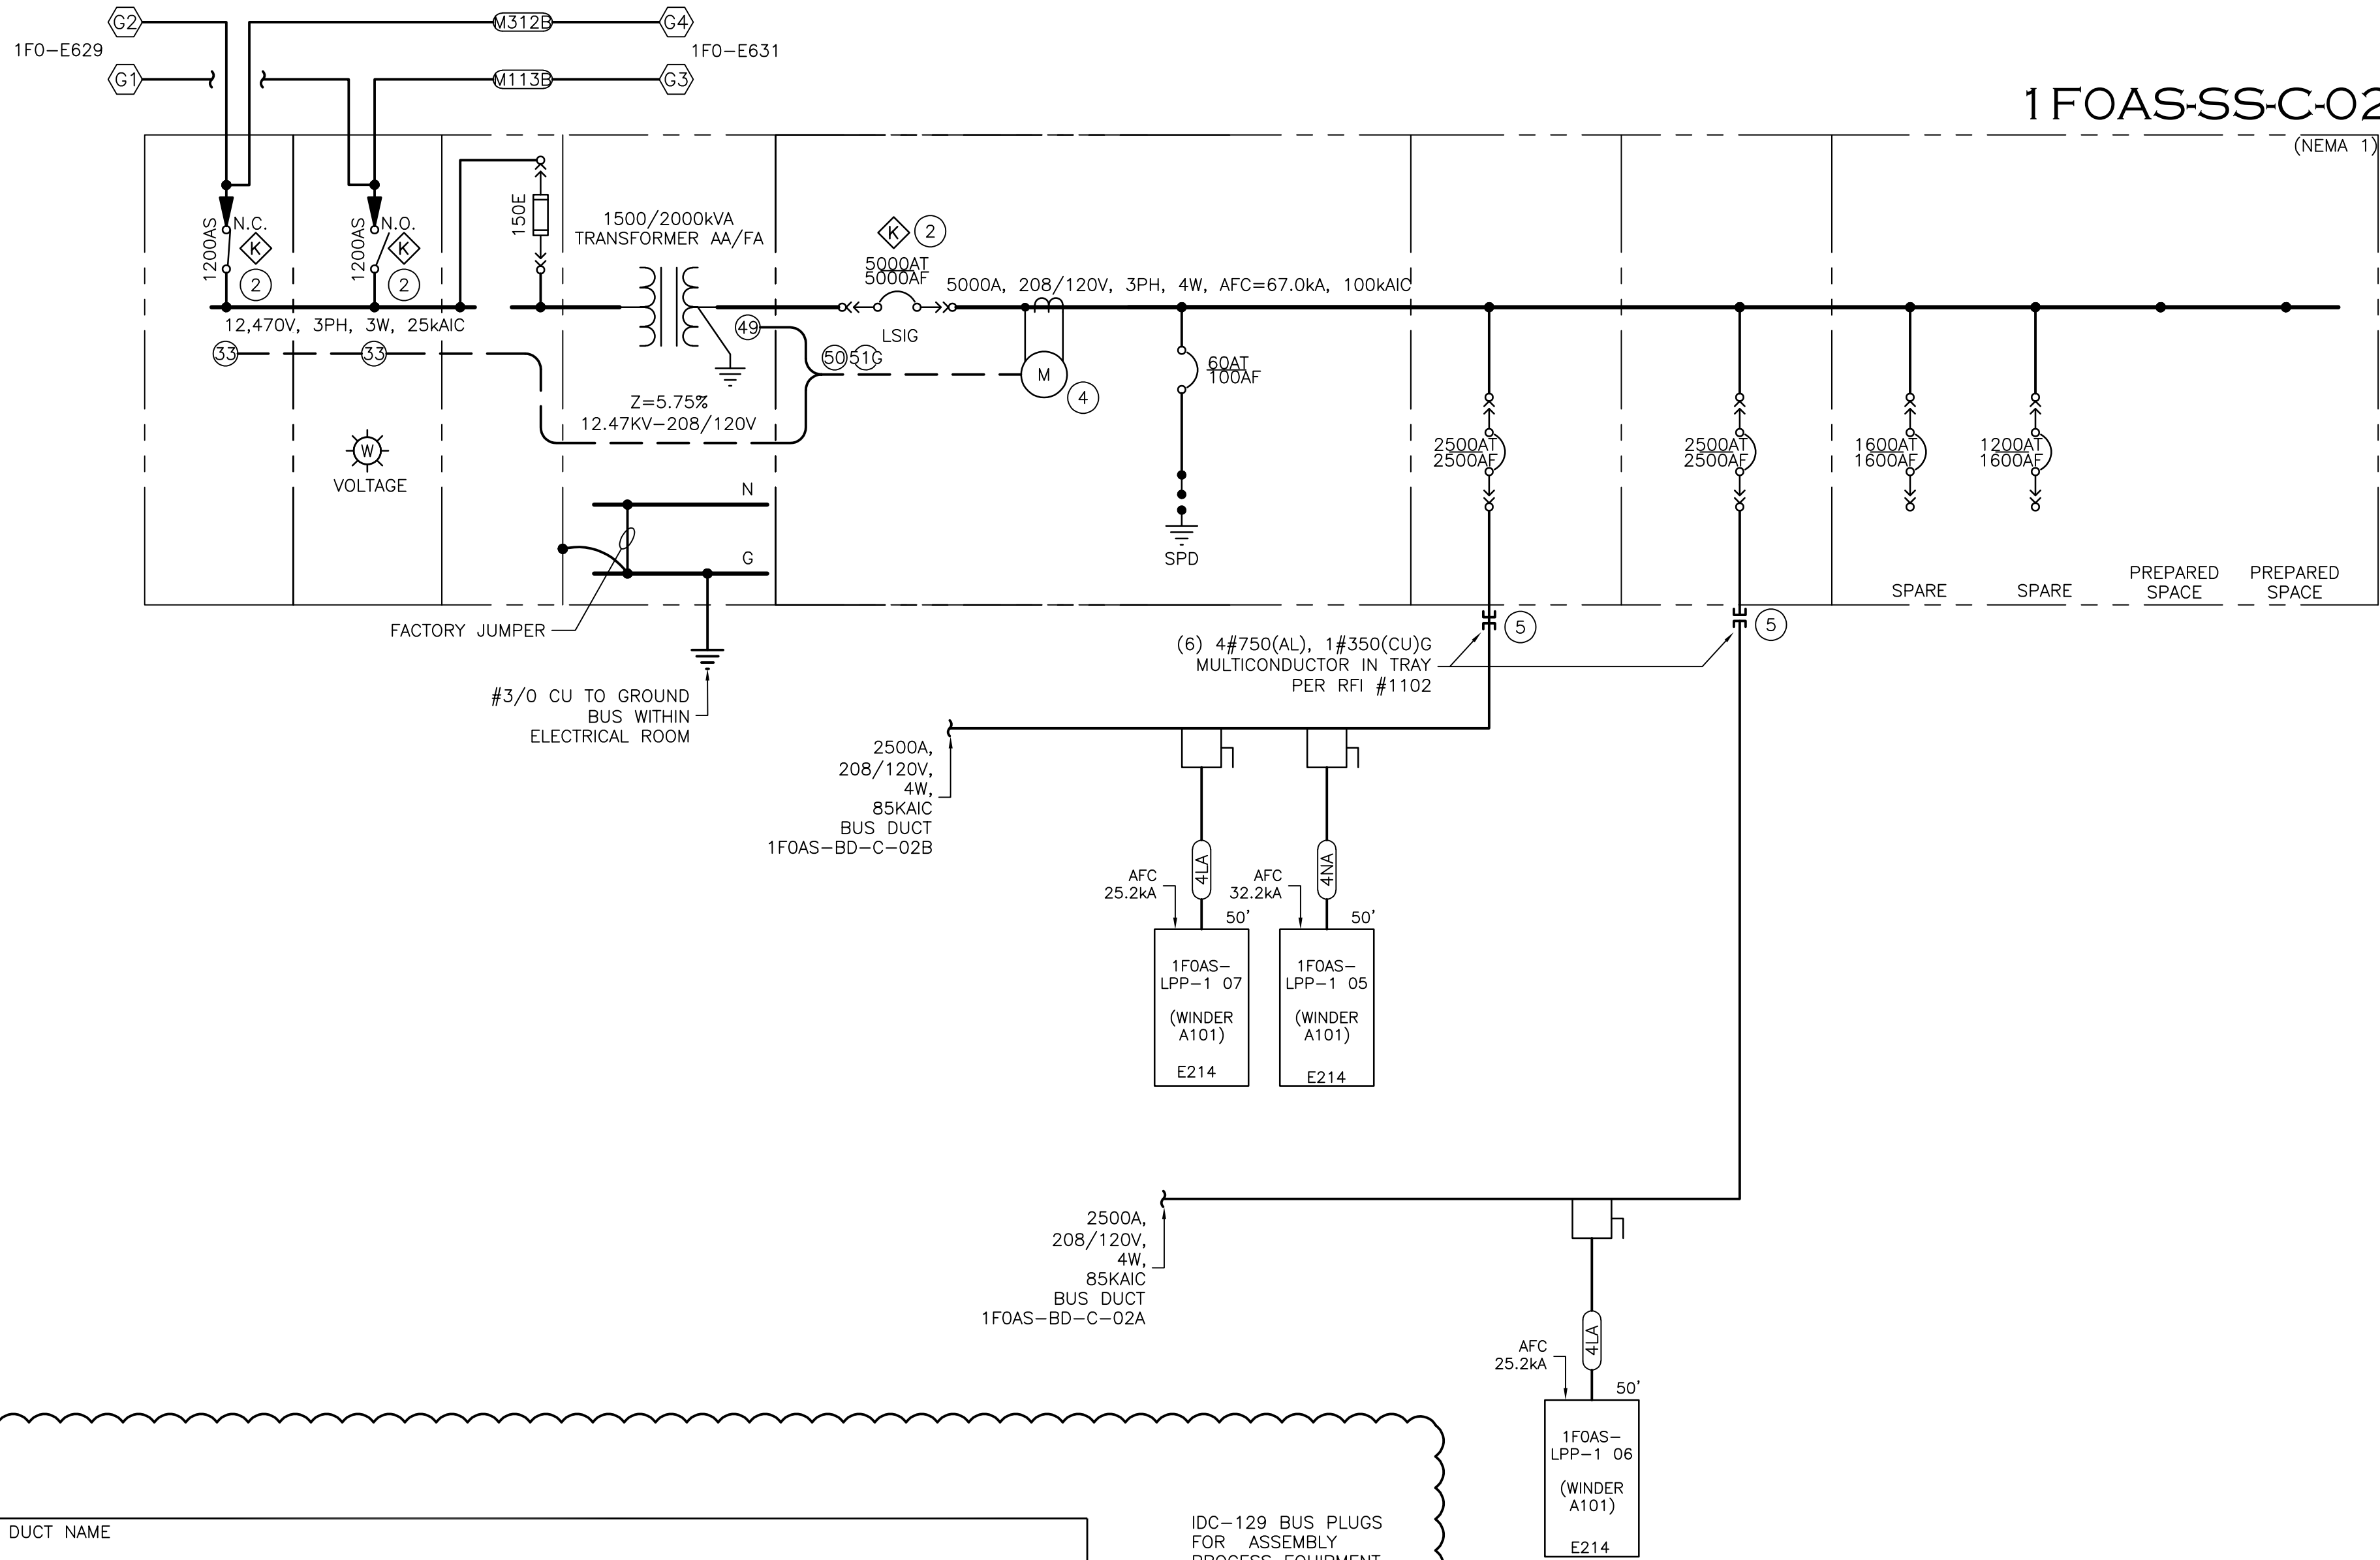

1 ONE LINE DIAGRAM - (1FO) ASSEMBLY-2 "C" (PARTIAL)
NO SCALE

BUS DUCT NAME											
1FOAS-BDC-02A											
BUS PLUG		RATINGS					LOADING (KVA)			NOTES	
		EQUIPMENT	TAG #	VOLTS	AMP FRAME	TRIP	LOAD	DEM	DEM LOAD		FLA
COMMON NOTCHING WINDER		1	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		2	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		3	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		4	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		5	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		6	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		7	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		8	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		9	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		10	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		11	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		12	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		13	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		14	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		15	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		16	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		17	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		18	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		19	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		20	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		21	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		22	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		23	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		24	208	150	80	22	0.4	9	60		
1FOAS-LPP-1 06		25	208	250	250	15	1.0	15	40		

NOTES:
*800A AND ABOVE BUS PLUGS REQUIRE MANUFACTURER INSTALLED BUS PLATE. SEE POWER PLAN FOR LOCATION

TOTAL LOAD (KVA) 533

222 TOTAL DEMAND LOAD (KVA)
616.349 DEMAND AMPS
2500 RATING (A)
25 % LOADING

BUS DUCT NAME											
1FOAS-BD-C-02B											
BUS PLUG		RATINGS					LOADING (KVA)			NOTES	
		EQUIPMENT	TAG #	VOLTS	FRAME	TRIP	LOAD	DEM	DEM		
COMMON NOTCHING WINDER		1	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		2	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		3	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		4	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		5	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		6	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		7	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		8	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		9	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		10	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		11	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		12	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		13	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		14	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		15	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		16	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		17	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		18	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		19	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		20	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		21	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		22	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		23	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		24	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		25	208	150	80	22	0.4	9	60		
COMMON NOTCHING WINDER		26	208	150	80	22	0.4	9	60		

NOTES:
*800A AND ABOVE BUS PLUGS REQUIRE MANUFACTURER INSTALLED BUS PLATE. SEE POWER PLAN FOR LOCATION

TOTAL LOAD (KVA) 579


242 TOTAL DEMAND LOAD (KVA)
671.57 DEMAND AMPS
2500 RATING (A)
27 % LOADING

IDC-129 BUS PLUGS FOR ASSEMBLY PROCESS EQUIPMENT 3 AND 4 ARE FUTURE ORDER BY OTHERS

PROVIDE AND INSTALL BUS PLUGS FOR PANELS

3 BUS DUCT LOAD SCHEDULE
NO SCALE

2 EQUIPMENT ELEVATION
NO SCALE

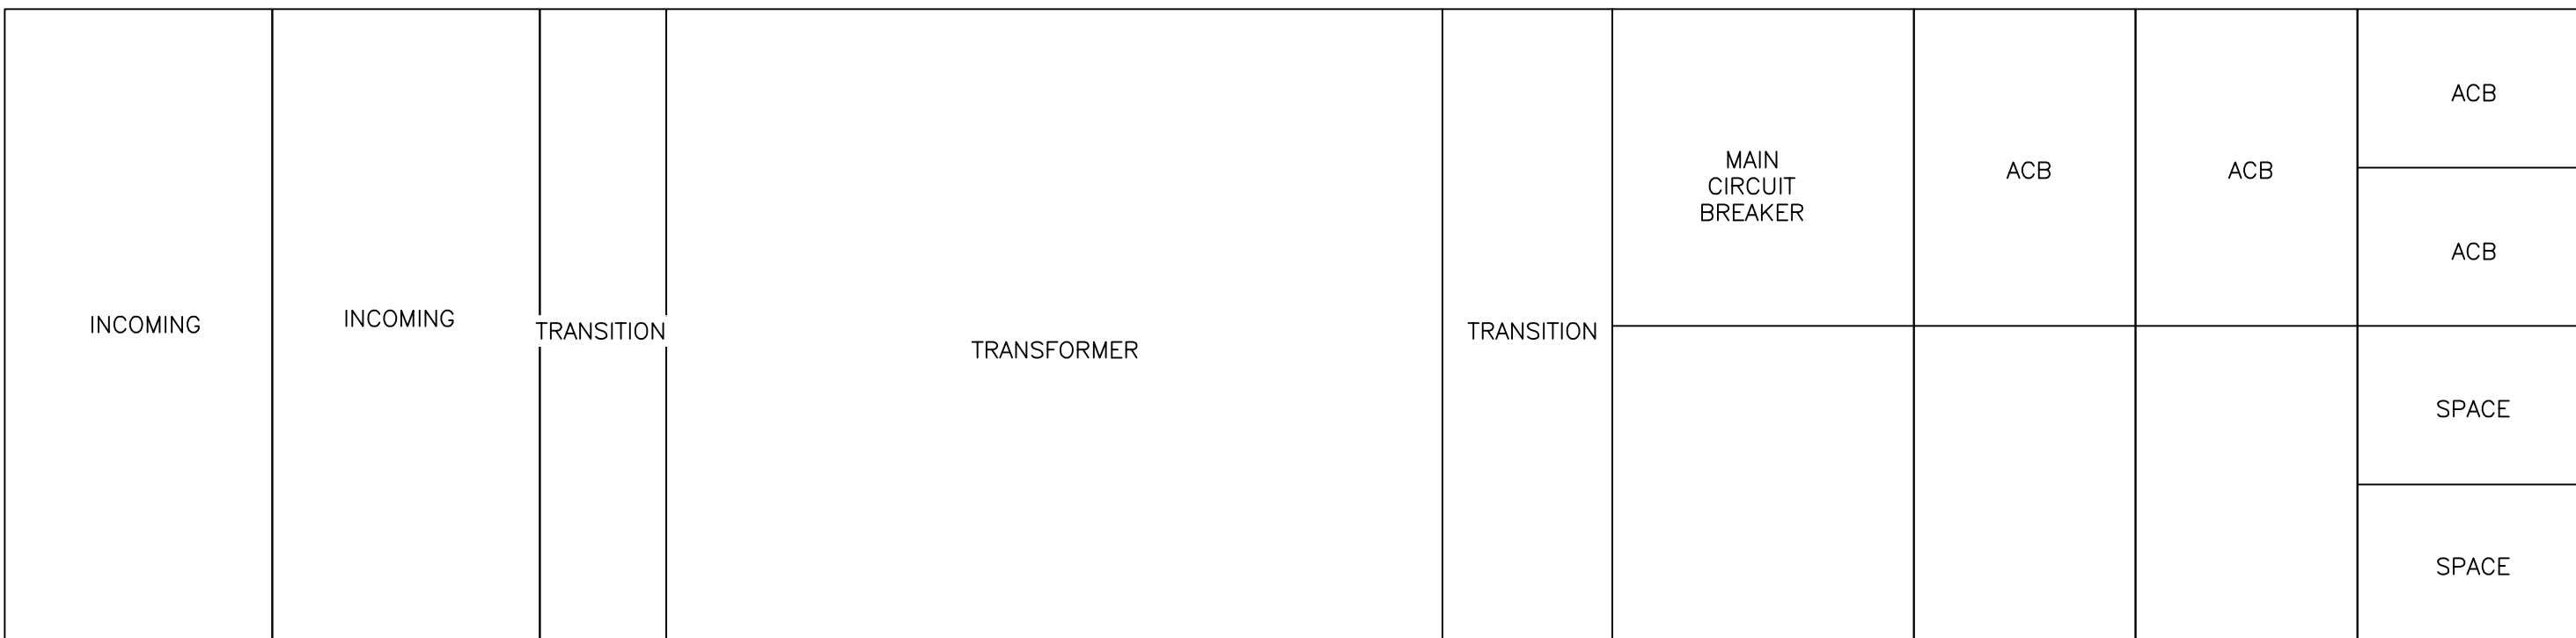

ELECTRICAL ONE LINE DIAGRAM

DATE	REVISIONS
12/17/2024	1FO DC-074 REVISIONS
02/11/2025	1FO CD REVISIONS
03/11/2025	1FO CD REVISIONS
05/12/2025	1FO CD REVISIONS
07/24/2025	1FO CD PERMIT RESUBMISSION
08/21/2025	1FO CD PERMIT ADDENDUM

PA/PM:	WB
DRAWN BY:	ETS/AO/AUG
JOB NO.:	PHX21-5038-00