



NO SCALE

A. REFERENCE FEEDER SCHEDULE, E011

B. CABLE LENGTHS WHEN INDICATED ON ONE-LINE ARE APPROXIMATE AND ARE FOR REFERENCE ONLY FOR CALCULATIONS AND ARE NOT TO BE USED FOR MATERIAL TAKEOFFS.

C. SECONDARY UNIT SUBSTATIONS: REFER TO SPECIFICATION #26 11 16 12.

D. UNIT SUBSTATION SCADA COMMUNICATIONS SHALL INCLUDE ALL HARDWARE DEVICES TO COMMUNICATE I/O (VIA MODBUS TCP COMMUNICATIONS) INCLUDING, BUT NOT LIMITED TO, THE FOLLOWING:

- PRIMARY SWITCH STATUS (OPEN/CLOSED)
- TRANSFORMER WINDING TEMPERATURE
- TRANSFORMER FAN RUN STATUS
- BREAKER STATUS
- POWER METER DATA

E. ALL SWITCHBOARDS, SWITCHGEAR, AND PANELEBOARDS SUPPLIED BY FEEDERS SHALL BE PERMANENTLY MARKED TO IDENTIFY EACH DEVICE OR EQUIPMENT WHERE THE POWER ORIGINATES. THE LABEL SHALL BE PERMANENTLY AFFIXED OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED, AND NOT HANDWRITTEN.

1. NOT USED.
2. PRIOR TO CLOSING A SWITCH, THE OTHER SWITCH MUST BE OPENED USING KIRK KEY INTERLOCK TO PREVENT CONNECTION OF MULTIPLE SOURCES. REFER TO SEQUENCE OF OPERATIONS BY MANUFACTURER IN EQUIPMENT SUBMITTAL.
3. NOT USED
4. SQUARE D/ SCHNEIDER ION 9000 WITH RS-485 COMMUNICATIONS.
5. NOT USED



ELECTRICAL ONE LINE DIAGRAM

	DATE	REMARKS
	06/28/2024	PERMIT RESUBMISSION B23-1400
	10/16/2024	IDC-074 1F0 CD PROGRESS SET (MEP ONLY)

PA/PM:	WE
PR/PM:	ET

1F0-E640

PROJECT ALPHA
1F0 - MAIN MANUFACTURING BUILDING
EAST PECOS ROAD
QUEEN CREEK, ARIZONA 85140

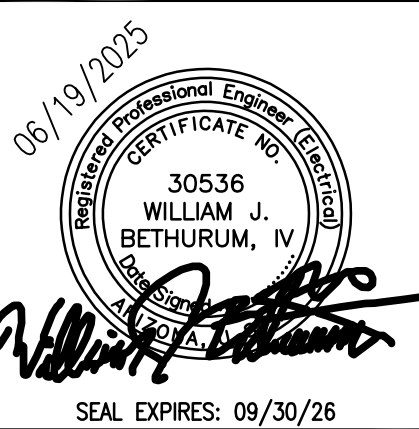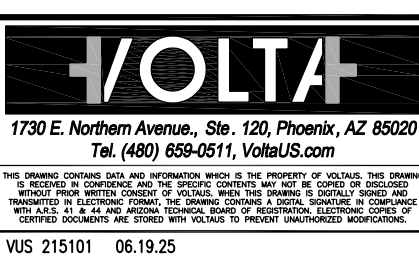

ARCHITECTURE
PLANNING
INTERIORS
CIVIL ENGINEERING
BRANDING
BUILDING MEASUREMENTS

CIVIL ENGINEERING
BRANDING
BUILDING MEASUREMENT